

Date 2/3/81

No. 8912

BOARD OF HEALTH OF JACKSON

CERTIFICATE OF COMPLIANCE

Issued to E.G.G. Development Group
(Owner or Contractor)

THIS IS TO CERTIFY That the

INDIVIDUAL SEWAGE SYSTEM #8912

INDIVIDUAL WATER SYSTEM _____

INDIVIDUAL PLUMBING SYSTEM _____

Installed at Block No. 115

Lot. No. 9 is in compliance with the

Application for Permit to Locate and Construct or

Alter Such Systems.

No. 8912 dated 11/26/80

The issuance of this certification shall not be construed as a guarantee that the system will function satisfactorily nor shall it in any way restrict the powers or responsibilities of the Board of Health in the enforcement of any law or ordinance relating to public health.

[Signature]

Date 2-17-81

No. 51-8712

BOARD OF HEALTH OF JACKSON

CERTIFICATE OF COMPLIANCE

Issued to E G G Development Group Inc,
(Owner or Contractor)

THIS IS TO CERTIFY That the

INDIVIDUAL SEWAGE SYSTEM _____

INDIVIDUAL WATER SYSTEM 58712

INDIVIDUAL PLUMBING SYSTEM _____

Installed at Block No. 115

Lot. No. 9 is in compliance with the

Application for Permit to Locate and Construct or

Alter Such Systems.

No. 58712 dated 2-17-81

The issuance of this certification shall not be construed as a guarantee that the system will function satisfactorily nor shall it in any way restrict the powers or responsibilities of the Board of Health in the enforcement of any law or ordinance relating to public health.

NOTE: WELL WPS GROUPE.

[Signature]

TOWNSHIP OF JACKSON
JOHN C. KIEBLER, TOWNSHIP CLERK
R. D. 4, Box 52, Jackson, N. J. 08527
(201) 928-1200 Ext. 30, 41, 42

LETTER OF TRANSMITTAL

TO: _____
Ellen Gerfen

Date	11-17-80	File No.	108
Attention:	Site Plan		
Re:	Site Plan Prel & Final		
R.A.C. DEV. GROUP			

GENTLEMEN:
WE ARE SENDING YOU ☐ ATTACHED
☐ SEPARATE COVER
VIA: _____

Fee Paid \$350.00
Prel, Final & Inspection Fees
100.00 150.00 100.00

THE FOLLOWING:

- ☐ Applications for Site Plan BLOCK 115 LOT 9
- ☐ Maps: Translucent _____ Prints _____ Other _____
- ☐ Copy of Proposed Ordinance No. _____ Subject _____
- ☐ Resolution No. _____
- ☐ Copies of Taxes Paid till Feb 1, 1981, Application, Check List,
- ☐ OTHER Maps, Notification to Property Owners, Letter to Asbury Park

DESCRIPTION AND/or REMARKS: Press, Jackson HUA, Fire Comm., Inv. Comm.

KINDLY FOLLOW-UP AS FOLLOWS:

THESE ARE TRANSMITTED AS CHECKED BELOW:

- ☐ For approval ☐ for your use ☐ as requested ☐ for signature
- ☐ For review and comment ☐ return _____ copies
- ☐ For recommendation ☐ returned for correction ☐ PROCESS AS USUAL

Copies to:

Township Committee	Planning Board:
Police	Members
Court	Secretary
Zoning Board	Board Attorney
Tax Collector	Chairperson
Tax Assessors	Planning Dept.
Board of Health	Twp. Engineer
File & Outgoing Mail	Planner

Twp. Attorney	_____
Code Enforcer	_____
Bldg. Inspector	_____
Environmental Comm.	_____
Industrial Comm.	_____
Administrator	_____
Fire Commissioners	_____

By: _____

XXXXXXXXXXXXXXXXXXXX
JOHN C. KIEBLER, Township Clerk
Director of Planning, Zoning & Insp

JACKSON TOWNSHIP HEALTH DEPARTMENT

MUNICIPAL BUILDING, ROUTE 528, JACKSON, NEW JERSEY 08527

REVISION APPROVED BY
OCEAN COUNTY HEALTH DEPARTMENT

DATE

11-26-80

INSPECTOR

(REVISED DESIGN)
OF S-8712

APPLICATION FOR A PERMIT:

X to locate and construct an individual Sewage System
— to alter or supplement an existing Sewage System

Location - Address BENNETT'S MILLS - VAN HISEVILLE ROAD Blk. 115 Lot 9
Owner E.G.G. DEVELOPING GROUP Phone 363-5600
Present Address RTE. 9 & 2ND ST. HOWELL TWP., N.J.
Directions and Landmarks to Location 100' WEST OF MAPLE ST. ON NORTH SIDE OF
BENNETT'S MILLS - VAN HISEVILLE RD.

Type of Building to be served RESIDENTIAL (Other than Residential consult Health Dept.)
Dwelling Unit: No. of Bedrooms 3 Expansion Attic, Den or Rec. Rm. Yes No ☒
Dimensions of Property: 312'± x 79'± (IRREGULAR) Sq. Ft. 0-47 ACRES ±

SEPTIC TANK: Shape CYLINDRICAL Material PRECAST REINFORCED CONCRETE
Capacities: Required Gal. 900 Designed for 1000 Gals.

DISPOSAL TRENCHES: Width (Min. & Max) _____ Depth _____ Lineal Ft. _____
Min. & Max. Distance between Trenches _____ Type of Pipe _____
Required Square Footage _____ Designed Square Footage _____

DISPOSAL BED: Width 9.0' Length 40-0' Disposal Area Sq. Ft. 360
Ft. of Pipe 108 Type of Pipe 4" PEEL. P.V.C. Distance between pipe 3'
Required Square Ft. 345 Designed Square Ft. 360

SEEPAGE PIT: Number _____ Shape _____ Material _____
Diameter or Width _____ Length _____ Liquid Depth _____
Required Square Ft. _____ Designed Square Ft. _____ Amount & Type of Stone _____

PERCOLATION TESTS

HOLE NO.	NO. OF SATURATIONS	DEPTH	PERC. RATE MIN PER IN.
1	2	30"	9.1 min
			10 min/in. USED

SOIL BORING LOG

SOIL LAYER, TYPE, THICKNESS, GR UND WATER
0"-5" SANDY LOAM
5"-29" SAND, LARGE GRAVEL TRACE CLAY
29"-71" TAN SAND, GRAVEL TRACES
71"-102" FINE SAND TAN
102"-126" FINE WHITE - TAN SUGAR SAND
No WATER ENCOUNTERED

Redesigned
Performed By LEROY T. CATTANEO N.J. P.E. License No. 23769
LEESVILLE PROF. BUILDING
Address P.O. DRAWER H, JACKSON, N.J. 08527 Phone 928-1739

If Witnessed, by Whom _____

Date of Tests 7-31-80 Weather Conditions _____

Installing CONTRACTOR _____

Permit will only be issued to same and only by owner's signature.

OWNERS Signature (acknowledging design & installer) _____

(Need not be signed for this approval, but must be signed before installation permit will be issued.)

See Special Note on Reverse Side

9/18/80

To Mr Joe Gallas

From C.C. Widdis

The attached is a record of
the field notes taken for the
soil boring and percolation test
on July 30, 31, 1980 at
Lot 9 Block 115 - Bennett's Mills
Road.

I called Harry Widdis today
in Long Branch and he reported
this information.

The field data substantiates
that the percolation rate is
1" in 10 min.

I will have my men re-do
this test and notify you if there
is any problem.

Charles C Widdis

Bennett's Mills Rd

Jackson Twp

BK 115 Lot 9

July 30, 1980 Steven Widdis

0-5" Sandy loam

5'-24" Sand, Large Gravel Trace Clay

24'-71" Tan Sand, Some Gravel

71'-102" Fine tan sugar sand

102"-120" Fine white sugar sand

Time - 3:33 PM Start Saturation

Not Finished

no perc test

July 31, 1980 Art King

Time - 10:15 AM Start Saturation
in 30" Deep Hole

11:30 AM Complete
Hole Empty

Time - 11:40 AM Start 7"

11:45 5 1/2"

11:50 5"

11:55 AM 4 1/2"

12:00 Noon 3"

12:05 PM 2 1/2"

12:10 2"

12:35 1 1/2"

12:40 0"



OCEAN COUNTY HEALTH DEPARTMENT

C. N. 2191

Toms River, N. J. 08753

201 - 341-9700

CHARLES KAUFFMAN
PUBLIC HEALTH COORDINATOR

PERCOLATION WITNESSING REPORT

Date 7-30-80

Municipality JACKSON

Block 115

Lot 9

Engineering Firm CHAS C WIDDIE

Individual Conducting Test _____


Depth of Perc Test Hole 30"

Soil Encountered 5" LOAM - 25" FINE^{LIGHT} TAN SAND TRACES GRAVEL
SOME SILT

Soil
BORING

0 TO 5	GRAY SANDY LOAM
5 TO 24"	TAN SAND TRACES CLAY & 3/4" AND BUTTER GRAVEL
24" TO 71"	TAN SAND TRACES GRAVEL
71" TO 102"	FINE TAN SUGAR SAND
102" TO 120"	FINE LIGHT TAN SUGAR SAND
NO WATER ENCOUNTERED	

VACANT

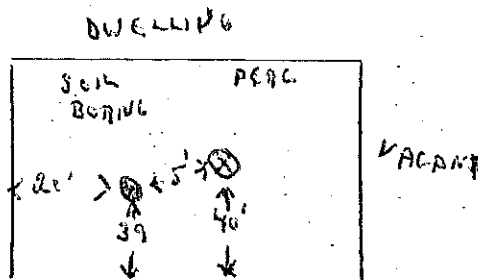

0 TO 5"	GRAY SANDY LOAM
5" TO 30"	FINE TAN (LIGHT) SAND TRACES GRAVEL SOME SILT

PERC
TEST
BORING

BENNETT MILL RD

Map indicating perc test and soil boring. Give Approximate distance to property lines. Identify adjoining properties (vacant or occupied) also identify streets.

Percolation Rate SATURATION DID NOT DRAIN FROM PERC HOLE

Witnessing Inspector Frank J. Nemeth

PERCOLATION WITNESSING REPORT

Date 7-31-80

Municipality JACKSON

Block 115 Lot 9

Engineering Firm CHAS C WIDMILL

Individual Conducting Test Art Kung

Depth of Perc Test Hole 30'

Soil Encountered 5" LOAM 25' TAN FINE SAND TRACES GRAVEL SOME SILT


PERC
HOLE #1

0 TO 5"	LOAM
5" TO 20"	TAN FINE SAND TRACES GRAVEL SOME SILT
20"	VACANT

DWELLING

PERC HOLE #2

0 TO 5"	LOAM
5" TO 30"	TAN FINE SAND TRACES GRAVEL SOME SILT
30" TO 36"	TAN FINE SAND VACANT SOME SILT

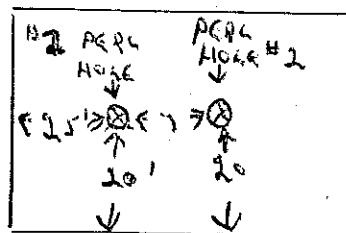

BENNETT MILL RD

Map indicating perc test and soil boring. Give Approximate distance to property lines. Identify adjoining properties (vacant or occupied) also identify streets.

Percolation Rate 60 MIN PER INCH

Witnessing Inspector Frank J. Menneth

SATURATION DID NOT DRAIN FOR EITHER PERC HOLE

S-8712

PERCOLATION WITNESSING REPORT

Date 7-31-80

Municipality JACKSON

Block 115 Lot 9

Engineering Firm CHAS C WIDELL

Individual Conducting Test Art Kung

Depth of Perc Test Hole 30'


Soil Encountered 5" LOAM 25' TAN FINE SAND TRACES GRAVEL SOME SILT

PERC
HOLE #1

0 to 5"	LOAM
5" to 20"	TAN FINE SAND
20"	TRACES GRAVEL SOME SILT

VACANT

DWELLING

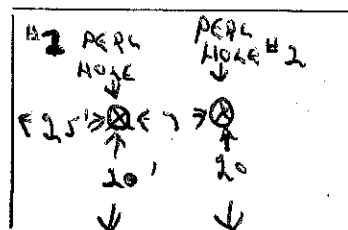

PERC HOLE #2

0 to 5"	LOAM
5" to 30"	TAN FINE SAND TRACES GRAVEL SOME SILT
30" to 36"	TAN FINE SAND VACANT SOME SILT


BETWEEN MILL RD

Map indicating perc test and soil boring. Give Approximate distance to property lines. Identify adjoining properties (vacant or occupied) also identify streets.

Percolation Rate 60 MIN PER INCH

Witnessing Inspector Frank J. Smith

SATURATION DID NOT DRAIN FOR EITHER PERC HOLE



OCEAN COUNTY HEALTH DEPARTMENT

C. N. 2191
Toms River, N. J. 08753
201 - 341-9700

CHARLES KAUFFMAN
PUBLIC HEALTH COORDINATOR

PERCOLATION WITNESSING REPORT

Date 7-30-80

Municipality JACKSON

Block 115

Lot 9

Engineering Firm CHAS C WIDDIS

Individual Conducting Test _____


Depth of Perc Test Hole 30"

Soil Encountered 5" LOAM - 25" FINE TAN SAND TRACES GRAVEL
SOME SILT

SOIL
BORING

0 TO 5	GRAY SANDY LOAM
5 TO 24"	TAN SAND TRACES CLAY & 3/4" AND BETTER GRAVEL
24" TO 71	TAN SAND TRACES GRAVEL
71 TO 102	FINE TAN SUGAR SAND
102 TO 120	FINE LIGHT TAN SUGAR SAND
NO WATER ENCOUNTERED	

VACANT

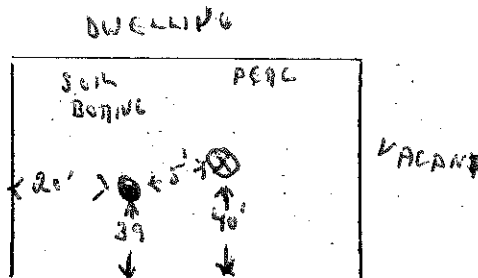

PERC TEST BORING

0 TO 5	GRAY SANDY LOAM
5 TO 30"	FINE TAN (LIGHT) SAND TRACES GRAVEL SOME SILT

BENNETT'S MILL RD

Map indicating perc test and soil boring. Give Approximate distance to property lines. Identify adjoining properties (vacant or occupied) also identify streets.

Percolation Rate SATURATION DID NOT DRAIN FROM PERC HOLE

Witnessing Inspector Frank J. Nemeth

LICENSES

NEW JERSEY - P. E. & L. S.
CONNECTICUT - P. E. & L. S.
NEW JERSEY PROF. PLANNER

MEMBER

N. J. SOC. PROF. ENGS.
N. J. SOC. MUNICIPAL ENGS.
FELLOW ASCE
N. J. SOC. PROF. PLANNERS

CHARLES C. WIDDIS

Professional Engineer - Land Surveyor - Professional Planner

206 WESTWOOD AVENUE
LONG BRANCH, NEW JERSEY 07740
222-8810

5-8712

July 30th

Environmenatl Health Dept.
Ocean County Board of Health
Sunset Avenue
Toms River, New Jersey

July 16, 1980

9:30

CN 2191

Re: Request for Percolation Tests.

Gentlemen,

I would like to schedule three percolation tests on the following lots:

Jackson Twp.

Block ~~84~~⁸³ Lot 45 - Bennett Mills Vanhiseville Road - CONDUCTED 7/30

Block 115 Lot 9 - Bennett Mills Vanhiseville Road - 7/30 & 7/31

Block 5 Lot 54 - Oakleaf Street - behind Rover Farm.

Thank you for your consideration.

2-31-80
WILL CALL A COUPLE OF DAYS PRIOR TO CONDUCTING PERL TEST
Jgr

Very truly yours,

Charles C. Widdis

Charles C. Widdis, P.E. & L.S.

CCW/bam

STATE GEOLOGIST

P.O. BOX 1390
TRENTON, N.J. 08625

STATE OF NEW JERSEY

DEPARTMENT OF ENVIRONMENTAL PROTECTION
OFFICE OF THE COMMISSIONER
TRENTON, N.J.Permit No. **28 11822**


PERMIT TO DRILL WELL VALID ONLY AFTER APPROVAL BY THE D.E.P.

Owner **EGG, Inc, Atn: Mr. H. Sacks**Driller **David Primost**Address **404 Park Ave. South**Address **PICKWICK WELL DRILLING
P.O. Box 6****New York, N.Y. 10016****Farmingdale, N.J.**

diameter of well 4 inches	proposed depth of well 75 feet	proposed capacity of pump 15 G.P.M.
method of drilling Rotary (cable-tool, rotary, jet, etc.)	use of well Domestic (semi-public, domestic, industrial, public-supply, test, etc.)	

LOCATION OF WELL
Bennets Mills Road

lot # 9	block # 115	municipality Jackson	county Ocean
-------------------	-----------------------	--------------------------------	------------------------

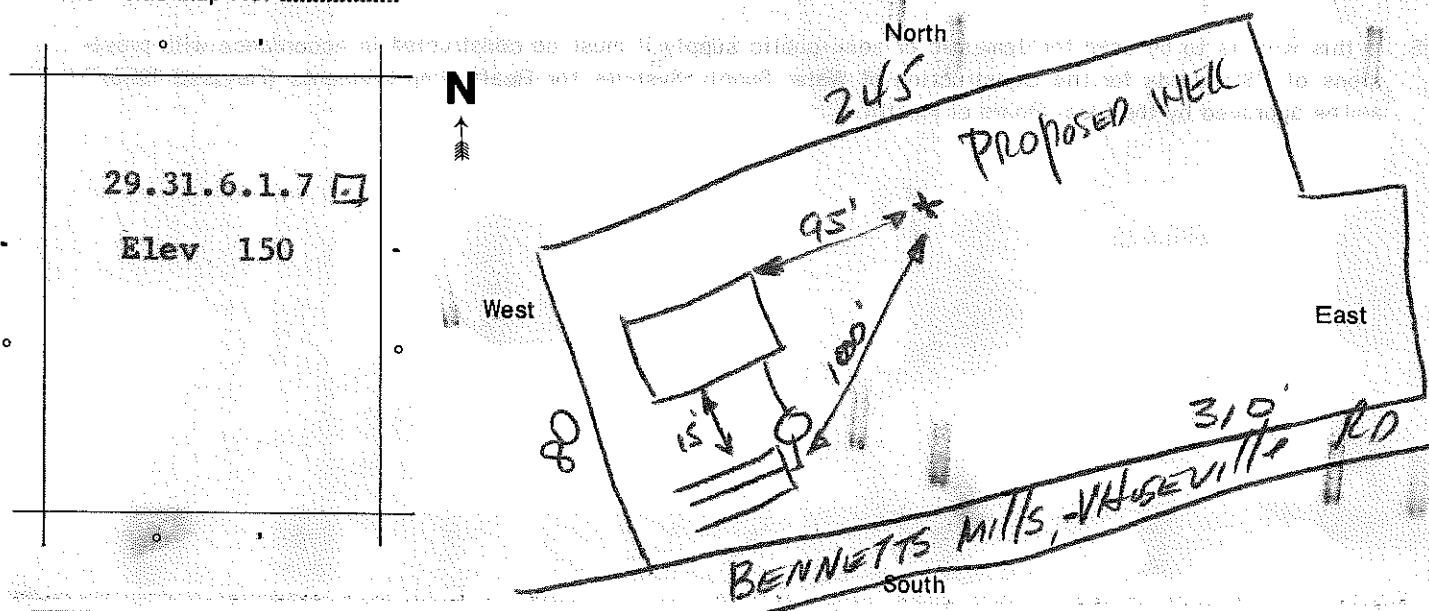Draw sketch showing distance and relations of well site to
nearest public roads, streets, septic systems, etc.State Atlas Map No. **29**

SEE REVERSE SIDE for IMPORTANT PROVISIONS AND REGULATIONS pertaining to this permit. APPROVAL of this permit is made SUBJECT TO acceptance of and compliance with the following ADDITIONAL CONDITIONS:

- ☐ Permit issued in accordance with provisions of letter of transmittal dated _____.
- ☐ It is necessary that Geophysical Logs of this well be made by the Division of Water Resources. The owner shall require the driller to notify the Division by PHONE (609-292-2232) when drilling is completed. Permanent pumping equipment SHALL NOT be installed until such logs are made.
- ☐ Samples of cuttings required every _____ feet.
- ☐ _____
- _____

This space for Approval Stamp

WELL PERMIT
APPROVED

SEP 5 1980

DEPT. ENV. PROTECTION
DIV. OF WATER RESOURCES
WATER ALLOCATION

In compliance with R. S. 58:4A-14, application is made for a permit to drill a well as described above.

Date **Sept 4, 1980**Signature of Owner *H. Sacks*



5-8712

OCEAN COUNTY HEALTH DEPARTMENT

C. N. 2191
Toms River, N. J. 08753
201 - 341-9700

CHARLES KAUFFMAN
PUBLIC HEALTH COORDINATOR

PERCOLATION WITNESSING REPORT

Date 9-23-80

Municipality JACKSON Block 115 Lot 9


Engineering Firm CAN WIDDIS & ASSO

Individual Conducting Test X A + KONG

Depth of Perc Test Hole 36


Soil Encountered 8 LOAM - 22' SAND - GRAVEL & SOME SILT

6' SAND & CLAY



0-8	LOAM
8-30	SAND GRAVEL
30	SOME SILT
30-36	SAND & CLAY

DWELLING X DWELLING 100' FT FROM PROPOSED SEPTIC SYSTEM

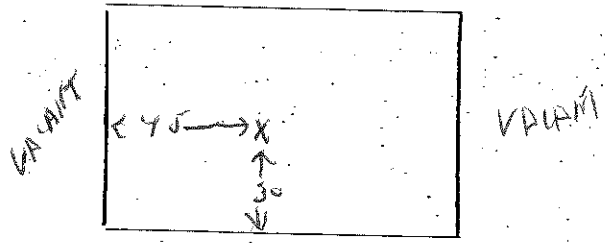

Map indicating perc test and soil boring. Give Approximate distance to property lines. Identify adjoining properties (vacant or occupied) also identify streets.

Percolation Rate 5 MIN PER INCH

Witnessing Inspector Frank J. Nemeth

SITE PLAN DETAIL REQUIREMENTS CHECKLIST

VARIANCE REQUIRED (IDENTIFY) _____ CONDITIONAL USE PERMIT REQUIRED _____
 CATEGORY: _____ NEW COMMERCIAL _____ NON-COMMERCIAL _____ RESIDENTIAL _____ BUILDING ALTERATION
 (BY VARIANCE PREVIOUSLY GRANTED)
☒ USE CHANGE _____ OPEN SPACE DEV. _____ PUBLIC, QUASI-PUBLIC INST. _____

APPLICANT ROBERT J. SEAMAN LOT(S) 9 BLOCK(S) 115
EDWARD R. MARKS, JR. & ASSOC.
 DEVELOPMENT NAME N/A ENGINEER _____ ZONE(S) R-40

APPROVAL SOUGHT: _____ PRELIMINARY _____ FINAL _____ PRELIMINARY & FINAL ☒
 (At Planning Board Discretion)

The following information must be shown on the submitted plat and the preparer must indicate compliance or non-compliance and state reasons in space provided if non-compliance

A. GENERAL	DETAIL WAIVER			
	YES	NO	N/A	SOUGHT
1. Standard size drawing.	☒	☐	☐	☐
2. Scale: Not less than 1"-50'.	☒	☐	☐	☐
3. Bearings, distances of each property line.	☒	☐	☐	☐
4. Zone(s), Zone Requirements.	☒	☐	☐	☐
5. Area of tract.	☒	☐	☐	☐
6. Building area(s).	☐	☐	☒	☐
7. Name and address of owner and applicant	☒	☐	☐	☐
8. Required parking and parking provided.	☒	☐	☐	☐
9. Tax map sheet, lot and block designation	☒	☐	☐	☐
10. Date of original and all revisions.	☒	☐	☐	☐
11. Owner's name, block and lot designation, and present use of all property within 200'.	☒	☐	☐	☐
12. Existing topography (min. 2' intervals).	☒	☐	☐	☐
13. Proposed lot grading with 1' contours and sufficient grades in paved areas to determine flow direction.	☒	☐	☐	☐
14. Existing Features:				
a. Existing buildings and structures.	☒	☐	☐	☐
b. Water courses.	☐	☐	☒	☐
c. Limits of wooded areas.	☒	☐	☐	☐
d. Easements.	☐	☐	☒	☐
15. All proposed uses and structures with setbacks from boundary lines.	☒	☐	☐	☐

	YES	NO	N/A	DETAILS SOUGHT
16. Location of existing and proposed signs, outdoor lighting, fencing, and buffer areas.	(✓)	()	()	()
** 17. Typical construction detail cross-section for curb, sidewalk, pavement, manholes, inlets, headwalls, etc.	()	()	()	(✓)
** 18. Architects renderings of proposed buildings with front, side, and rear elevations and floor plans.	()	()	(✓)	()
** 19. Plans and profiles of proposed sanitary sewers or show service connection to existing facilities.	()	()	(✓)	()
** 20. Design details and dimensions of fences, walls, signs, lighting and other similar facilities.	(✓)	()	()	()
** 21. Existing and proposed storm drainage facilities including plans and profiles, invert elevations, and drainage area map and calculations to substantiate adequacy of proposed storm drainage.	()	()	(✓)	()
** 22. Specifics of site ingress and egress i.e. curb radii, curb opening, lane widths, existing driveways within 100' of site, etc.	(✓)	()	()	()
23. Key map.	(✓)	()	()	()
24. Entire parcel shall be shown.	(✓)	()	()	()
25. Space for signature of Chairman and Township Engineer	()	()	(✓)	()
26. Space for appropriate county official (if applicable).	()	()	(✓)	()
27. Written description of proposed activities.	(✓)	()	()	()

In addition to the above, the following additional details shall be required by category.
 * (Except categories E,F,G where only details indicated need be submitted.)

B. CATEGORIES A AND B (NEW COMMERCIAL AND NON-COMMERICAL CONSTRUCTION)

1. Off-street parking layout (dimensions of aisles, parking spaces, loading areas, fire lanes, traffic lanes, etc.)	()	()	()	()
2. Direction of internal traffic flow.	()	()	()	()
3. Landscaping Plan.	()	()	()	()
4. Storage areas (Refuse, equipment, materials).	()	()	()	()
5. Soil borings - soil log (depth to ground water, ground elevation).	()	()	()	()

C. CATEGORY C - RESIDENTIAL HOUSING

1. Off-Street parking layout (dimensions of aisles parking spaces, loading areas, fire lanes, traffic lanes etc.)	()	()	()	()
2. Landscaping plan.	()	()	()	()

SITE PLAN DETAIL REQUIREMENTS CHECKLIST

Page three

DETAIL WAIVE

	YES	NO	N/A	SOUGHT
** 3. Architects renderings - elevations and typical floor plans.	()	()	()	()
4. Recreation areas - other public areas	()	()	()	()
5. Refuse storage and pick-up	()	()	()	()
6. Soil borings - soil log: depth to ground water; minimum depth 20'; ground elevation.	()	()	()	()
7. Compliance with applicable detail requirements of zoning ordinance pertaining to multi-family housing.	()	()	()	()

D. CATEGORY D - BUILDING ALTERATIONS

1. Off-street parking layout	()	()	()	()
2. Building elevations and floor plan for additions only	()	()	()	()
3. New setback dimensions	()	()	()	()
4. Proposed landscaping	()	()	()	()

E. CATEGORY E - USE CHANGE

1. Written description of proposed operation to evaluate parking requirements.	(✓)	()	()	()
2. Proposed off-street parking layout (dimensions of aisles, parking spaces, loading areas, fire lanes, traffic lanes).	(✓)	()	()	()
3. Direction of anticipated traffic flow.	()	()	(✓)	()
4. Landscaping plan.	()	()	(✓)	()
5. Items A 1-10, 13-16 and 23-26 above (check appropriately in Section A).	()	()	()	()

F. CATEGORY F - OPEN SPACE DEVELOPMENT

1. Items A, 1-12, 14, 24-27 above (complete appropriately in Section A.)	()	()	()	()
--	-----	-----	-----	-----

G. CATEGORY G - PUBLIC AND QUASI PUBLIC INSTITUTIONS AND AGENCIES


1. Items B, 1-6 above (complete appropriately in Sec. B).	()	()	()	()
---	-----	-----	-----	-----

NOTE: ** = Required for final site plan approval only.

If final or preliminary and final approval is sought all details must be shown.
Space below to be used to describe reason for non-compliance or reason for seeking detail waiver - indicate detail number and reason:

17. WAIVER OF CURB & WALKS SOUGHT TO ALLOW FOR NATURAL DRAINAGE - NO ADJACENT CURB OR WALKS EXISTING
6, 18, & 19. AS EXISTING BUILDING PERMITS HAVE ALREADY BEEN ISSUED, FELT THESE ITEMS NOT APPLICABLE
25 & 26. SPACES NOT PROVIDED AS MAP IS STAMPED BY GOVERNING AGENCIES AT TIME OF APPROVAL

11-11-80
DATE

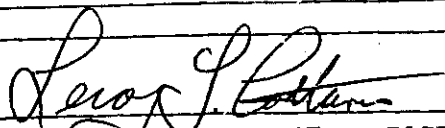
SIGNATURE AND SEAL OF PREPARER

EDWARD R. MARKS JR. & ASSOC.
P.O. DRAWER "H"
JACKSON, NEW JERSEY 08527

LETTER OF TRANSMITTAL

TO OCEAN COUNTY BOARD OF HEALTH
SUNSET AVE.
TOMS RIVER, N.J.

DATE	11-12-80	JOB NO	70566
ATTENTION	MR. JOSEPH GALLOS		
RE	INDIVIDUAL SEPTIC DESIGN		
	TAX Lot 9 BLOCK 115		
	JACKSON TOWNSHIP		
	E.GG DEVELOPING GROUP		
	YOUR FILE 58712		

GENTLEMEN:

WE ARE SENDING YOU ☒ Attached ☐ Under separate cover via _____ the following items:

☐ Shop drawings ☒ Prints ☐ Plans ☐ Samples ☐ Specifications
☐ Copy of letter ☐ Change order ☒ REVISED APPLICATIONS

COPIES	DATE	NO.	DESCRIPTION
2	11-11-80	70566	PRINTS OF SITE PLAN AND SEPTIC & GRADING DEPICTING REVISED DESIGN FOR INDIVIDUAL SEPTIC & WELL LOCATIONS FROM PREVIOUSLY APPROVED APPLICATION S-8712
4			APPLICATIONS FOR A PERMIT TO LOCATE & CONSTRUCT AN INDIVIDUAL SEWERAGE SYSTEM

THESE ARE TRANSMITTED as checked below:

- | | | |
|--|---|---|
| ☒ For approval | ☐ Approved as submitted | ☐ Resubmit _____ copies for approval |
| ☐ For your use | ☐ Approved as noted | ☐ Submit _____ copies for distribution |
| ☐ As requested | ☐ Returned for corrections | ☐ Return _____ corrected prints |
| ☐ For review and comment | ☐ _____ | |
| ☐ FOR BIDS DUE _____ 19 _____ ☐ PRINTS RETURNED AFTER LOAN TO US | | |

REMARKS AS DISCUSSED APPROXIMATELY TWO WEEKS AGO, THE ATTACHED FORMS AND PRINTS CONTAIN DESIGN DATA BASED ON THE PERCOLATION TEST AND SOIL BORING CONDUCTED FOR THE ORIGINALLY APPROVED APPLICATION S-8712. IT BECAME NECESSARY TO REDESIGN SAID SEPTIC SYSTEM DUE TO A MISLOCATION DURING STAKE OUT OF FOUNDATION, WHICH IS UNDER CONSTRUCTION.

THANKING YOU IN ADVANCE, FOR YOUR PROMPT ATTENTION TO THIS MATTER.

VERY TRULY YOURS

COPY TO MS. MARLENE LYNCH FORD, ESQUIRE

SIGNED:

Edward R. Marks Jr.

Township Of Jackson

58718

APPLICATION FOR A PERMIT TO CONSTRUCT AN INDIVIDUAL WATER SUPPLY & SYSTEM:

SEPT. 4, 1980

Date: August 12, 1980

Owner: EGG Development Group Inc.

PAID
4/25/80
75

PICKWICK WELL DRILLING

P. O. BOX 6

FARMINGDALE, N.J. 07727

201-338-3300 201-240-3707

Location: Bennetts Mills Rd., Jackson, N.J.

Name and Address of Contractor:

Type of well or water supply:

4" Cased Well

Estimated Depth:

75

Method of sealing:

Pitless Adapter

Pumping Equipment:

SUBMERSIBLE PUMP

Storage facilities:

EXTROL TYPE TANK (42 GAL EQUIV)

Purification facilities:

HTH CL, 1000

DRM

OCEAN COUNTY
HEALTH DEPARTMENT

On reverse side show sketch of property including the following information:

- (a) Size of lot.
- (b) Location of all buildings.
- (c) Location of sewerage facilities.

PLAN APPROVED:

DATE: 9-25-80

FINAL INSPECTION

APPROVAL

DATE:

NOTE: Applications for certification of individual water supplies and systems for realty improvements not covered in Sections 8.1.1 and 8.2.1 of this Code shall submit the following additional information:

A plan of the subdivision showing the following: *

- Lots with their dimensions.
- Contours of original grades.
- Proposed elevation of the final grading shown at corner lots or any contemplated change of slope.
- Location of all test wells drilled to investigate water supply potentialities.
- Location of all natural streams and storm water drainage channels on or abutting the subdivision or any contemplated relocation of same.
- Location of all private and public water supplies within 1000 feet of the subdivision.
- Location of storm and sanitary sewers.

* The plan of the subdivision to be submitted for certification of sewerage facilities may be used for this purpose.

The undersigned agree to construct the aforescribed water supply in accordance with the provisions of "AN ORDINANCE establishing a code regulating the location, construction, alteration, use and supervision of individual and semipublic water supplies, requiring certain permits, providing for the inspection of such supplies, the fixing of fees and prescribing penalties for violations", adopted by the Board of Health, Township of Jackson, New Jersey on

BLK. 115

LOT. 9

Owner

David Runk 1041

Contractor

This application must be accompanied by evidence that a well drilling permit has been obtained from the New Jersey State Department of Conservation and Economic Development except in the case of a drive point or dug well.

NJ STATE PERMIT NO. 28 11822

