



181 US Hwy 46
Mine Hill, NJ 07803
(908) 654-8068
(800) 783-0567
Fax 908-654-8069

LEAD IN DRINKING WATER REPORT

Performed At:

Paul Robeson - 199 Commercial Avenue
New Brunswick Middle School – 1125 Livingston Avenue
New Brunswick High School – 1000 Somerset Street
New Brunswick, NJ

Performed For:

New Brunswick Board of Education
Frank LoDolce
268 Baldwin Street
New Brunswick, NJ 08901

Prepared By:

LEW Corporation
181 US Hwy 46
Mine Hill, NJ 07803

Phone (908) 654-8068
Fax (908) 654-8069
Website <http://www.LEWCorp.com>

Inspection Date: 8/28/2018
Project Number: 180908

Table of Contents

Contact Information.....	3
Introduction	4
Sampling Methodology	4
Drinking Water Results	5
Recommendations	5
Additional Recommendations	5

Appendices


Appendix A	Exceedances
Appendix B	Recommendations
Appendix C	All results
Appendix D	Floor Plan(S)
Appendix E	Laboratory Data

Contact Information

Agency

Client Contact:	Frank LoDolce
Client Name:	New Brunswick Board of Education
Street Address	268 Baldwin Street New Brunswick, NJ 08901
Phone Number:	(609) 618-0407

Risk Assessor(s)

Site Assessor(s):	Mike Mosier
License:	NJDOH #033123
Signature:	
Date:	August 31 st , 2018
E-Mail	mmosier@lewcorp.com

Firm

Organization:	LEW Corporation
Certification #:	NJDCA 00015 E
Street:	181 US Hwy 46
City, State & Zip:	Mine Hill, NJ 07803
Phone Number:	908-654-8068
Web Address:	http://www.lewcorp.com

Laboratory

Organization:	Environmental Hazard Services, LLC
Street:	7469 Whitepine Road
City, State & Zip:	Richmond, VA 23237
NJDEP Certification #	VA008
Phone Number:	800-347-4010

Introduction

LEW Corporation was contracted by New Brunswick Board of Education to test for the presence of lead in drinking water in six schools in the district.

Sampling Methodology

LEW Corporation followed the July 13, 2016 amendments to NJAC 6A:26. Full details on sampling practices can be found in Districts Sampling Plan.

All samples were collected in 250mL wide mouth plastic containers that was prepackaged by the analytical laboratory. The sample containers may contain nitric acid, if expedited analysis is required. If not, nitric acid will be added to each sample upon arrival at the laboratory. At each sample location, the first draw sample was taken after it was determined that the water had been standing in the plumbing system for greater than eight hours but less than forty-eight hours. If second draw samples were collected, they were collecting following a flushing protocol outlined in the District's Sampling Plan.

Drinking Water Results

On August 24th, 2018, LEW Corporation collected the following number of water samples:

Paul Robeson Community School

- 15 first draw samples + 1 QAQC sample collected
- 1 sample above the 15ppb action level

New Brunswick Middle School

- 3 first draw samples + 1 QAQC sample collected
- 1 sample above the 15ppb action level

New Brunswick High School

- 1 first draw sample + 1 QAQC sample collected
- 0 samples above the 15ppb action level

Recommendations

Those outlets where the first draw sample tested below 15ppb are not considered to be elevated and no mitigation is necessary.

For those outlets where the first draw sample exceeds 15ppb the following steps are recommended:

- 1) Immediately discontinue use of the outlets.
- 2) Conduct second draw (flush) samples on these outlets to further delineate source of contamination.

A complete list of recommendations per outlet can be found in Appendix B.

Additional Recommendations

- 1) Follow-up samples should be collected after any remediation efforts in order to determine the efficacy of the work.
- 2) Any of the inoperable/non-functioning outlets listed above that are brought back into service should be sample.
- 3) Comply with all requirements set forth in NJAC 6A:26.

Appendix A Exceedances

Building	Date Collected	Analysis Date	Sample ID	Sample Description	Concentration (ug/L) Or ppb
1 st Draw Samples					
New Brunswick Middle School – 1125 Livingston Avenue					
New Brunswick Middle School	08/24/2018	08/31/2018	1125-11-FP-2	Kitchen Kettle 1	25.2
Paul Robeson Community School - 199 Commercial School					
199 Commercial School	08/24/2018	08/31/2018	199-42-S-2	RM 204	16.9

Appendix B Recommendations


Building	Sample ID	Sample Description	Remediation Recommendation
New Brunswick Middle School – 1125 Livingston Avenue			
New Brunswick Middle School	1125-11-FP-2	Kitchen Kettle 1	Remove and replace outlet and install filter up to the water line or flush and resample.
Paul Robeson Community School - 199 Commercial School			
199 Commercial School	199-42-S-2	RM 204	Remove and replace outlet and filter up to the water line or flush and resample.
*Improper flushing prior to clearance sampling may be a contributor to positive samples. *			


Appendix C All Results


Building	Date Collected	Analysis Date	Sample ID	Sample Description	Concentration (ug/L) Or ppb
New Brunswick Middle School – 1125 Livingston Avenue					
Middle School	8/24/2018	8/31/2018	1125-4-WF-2	RM 102 Hallway water fountain	1.14
Middle School	8/24/2018	8/31/2018	1125-11-FP-2	Kitchen Kettle 1	25.2
Middle School	8/24/2018	8/31/2018	1125-13-FP-2	Kitchen Kettle 33-2	7.00
Middle School	8/24/2018	8/31/2018	1125-14-S-2	Cafeteria Sink (QAQC)	<1.00
Paul Robeson Community School – 199 Commercial Avenue					
Paul Robeson	8/24/2018	8/31/2018	199-20-S-2	Room 105 Sink	1.95
Paul Robeson	8/24/2018	8/31/2018	199-33-S-2	Room 210 Sink	3.91
Paul Robeson	8/24/2018	8/31/2018	199-34-S-2	Room 208 Sink	6.99
Paul Robeson	8/24/2018	8/31/2018	199-35-S-2	Room 211 Sink	6.63
Paul Robeson	8/24/2018	8/31/2018	199-36-S-2	Room 207 Sink	3.95
Paul Robeson	8/24/2018	8/31/2018	199-37-S-2	Room 206 Sink	9.47
Paul Robeson	8/24/2018	8/31/2018	199-38-S-2	Room 212 Sink	2.74
Paul Robeson	8/24/2018	8/31/2018	199-39-S-2	Room 213 Sink	11.5
Paul Robeson	8/24/2018	8/31/2018	199-41-S-2	Room 205 Sink	2.98
Paul Robeson	8/24/2018	8/31/2018	199-42-S-2	Room 204 Sink	16.9
Paul Robeson	8/24/2018	8/31/2018	199-43-S-2	Room 203 Sink	4.44
Paul Robeson	8/24/2018	8/31/2018	199-44-S-2	Room 202 Sink	6.84
Paul Robeson	8/24/2018	8/31/2018	199-45-S-2	Room 201 Sink	2.63
Paul Robeson	8/24/2018	8/31/2018	199-46-S-2	Room 217 Sink	4.76
Paul Robeson	8/24/2018	8/31/2018	199-47-S-2	Room 218 Sink	1.21
Paul Robeson	8/24/2018	8/31/2018	199-48-S-2	Cafeteria Sink (QAQC)	<1.00
New Brunswick High School – 1000 Somerset Street					
High School	8/24/2018	8/31/2018	NBHS-44-FP-2	Kitchen Pot Filler	
High School	8/24/2018	8/31/2018	NBHS-45-S-2	Cafeteria Sink (QAQC)	


Appendix D Floor Plan(s)




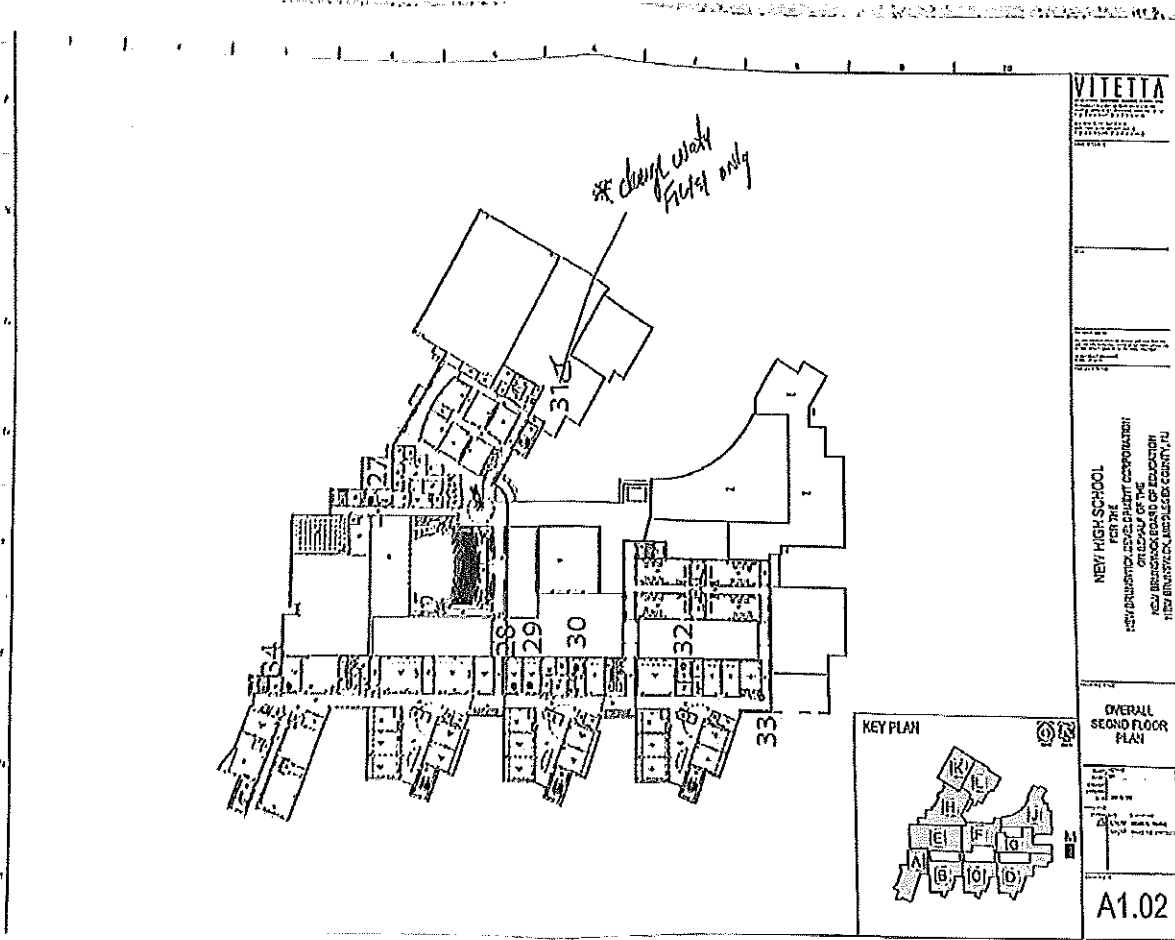

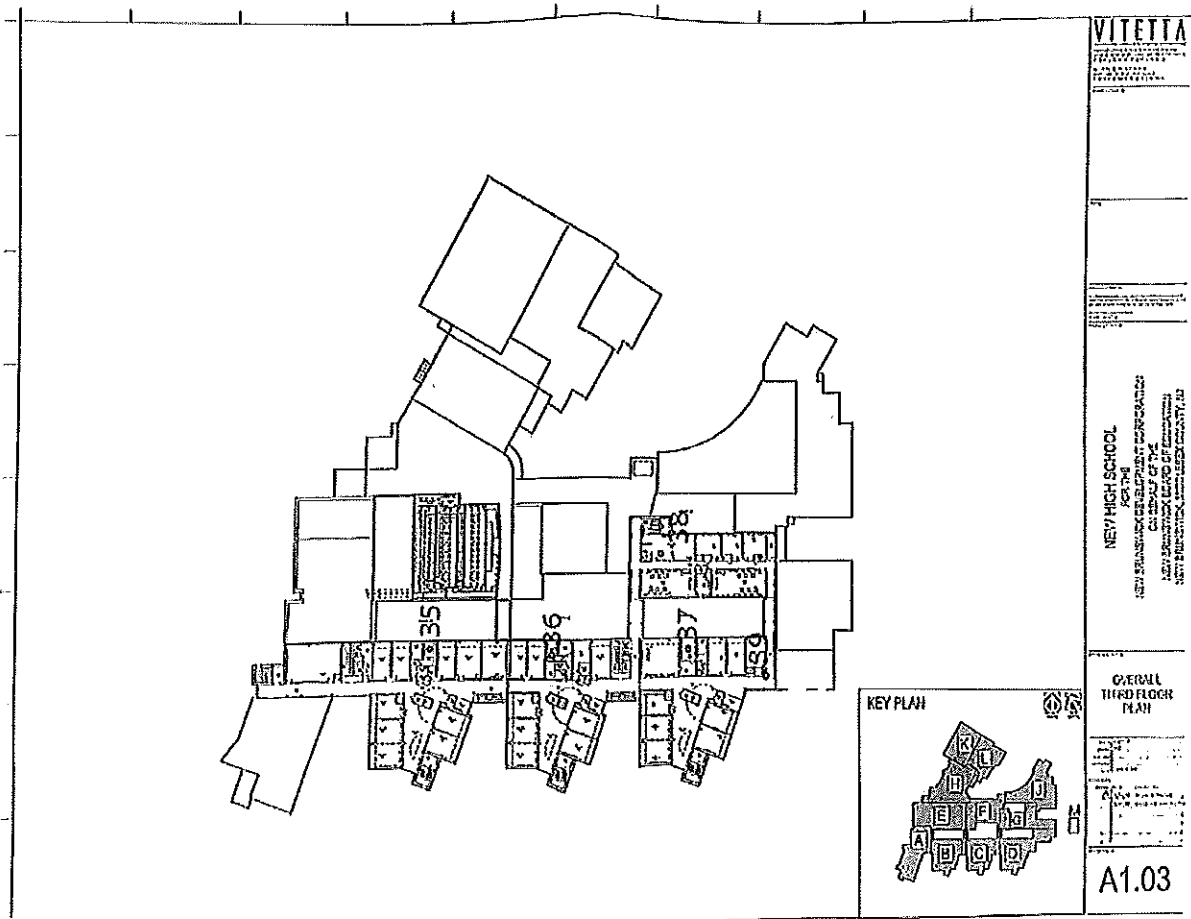

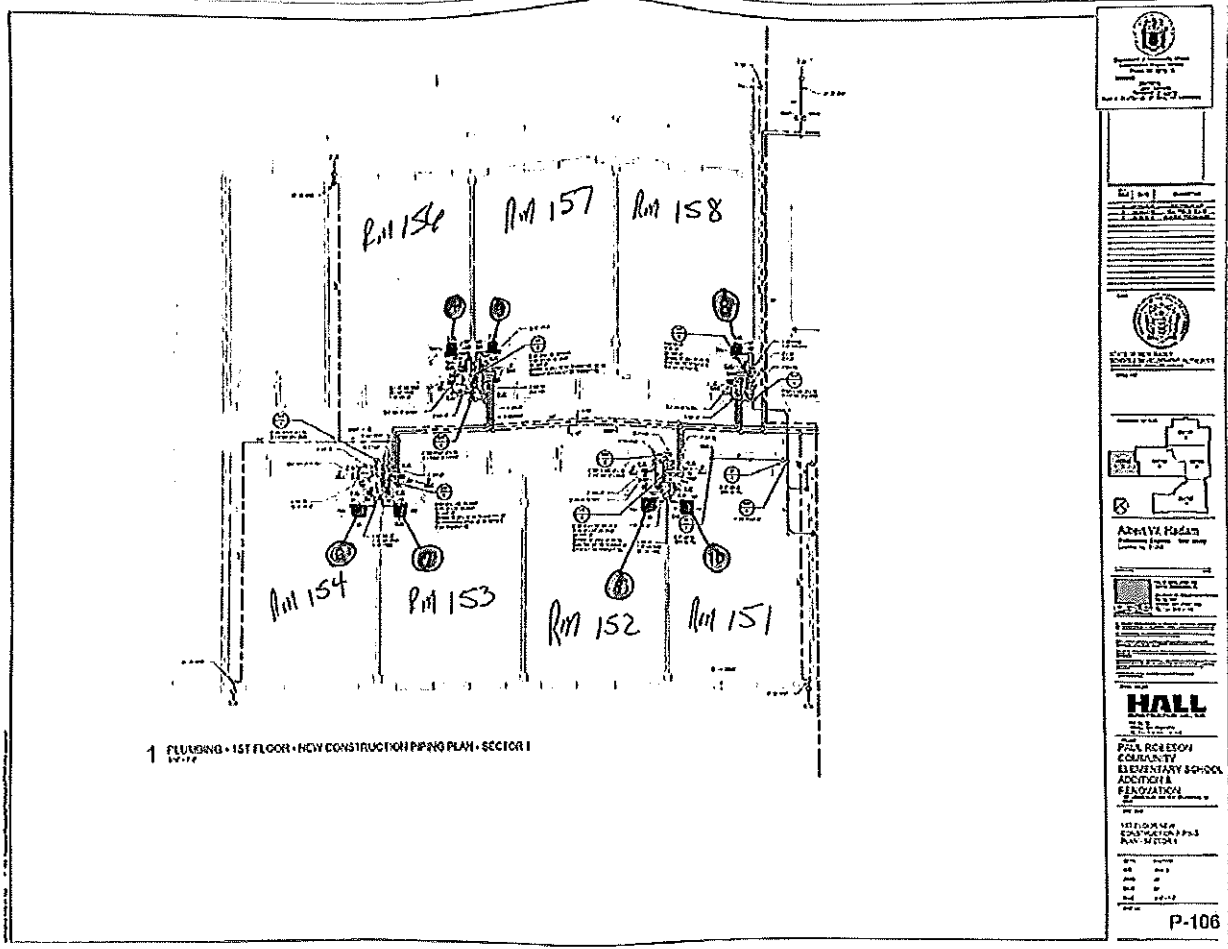


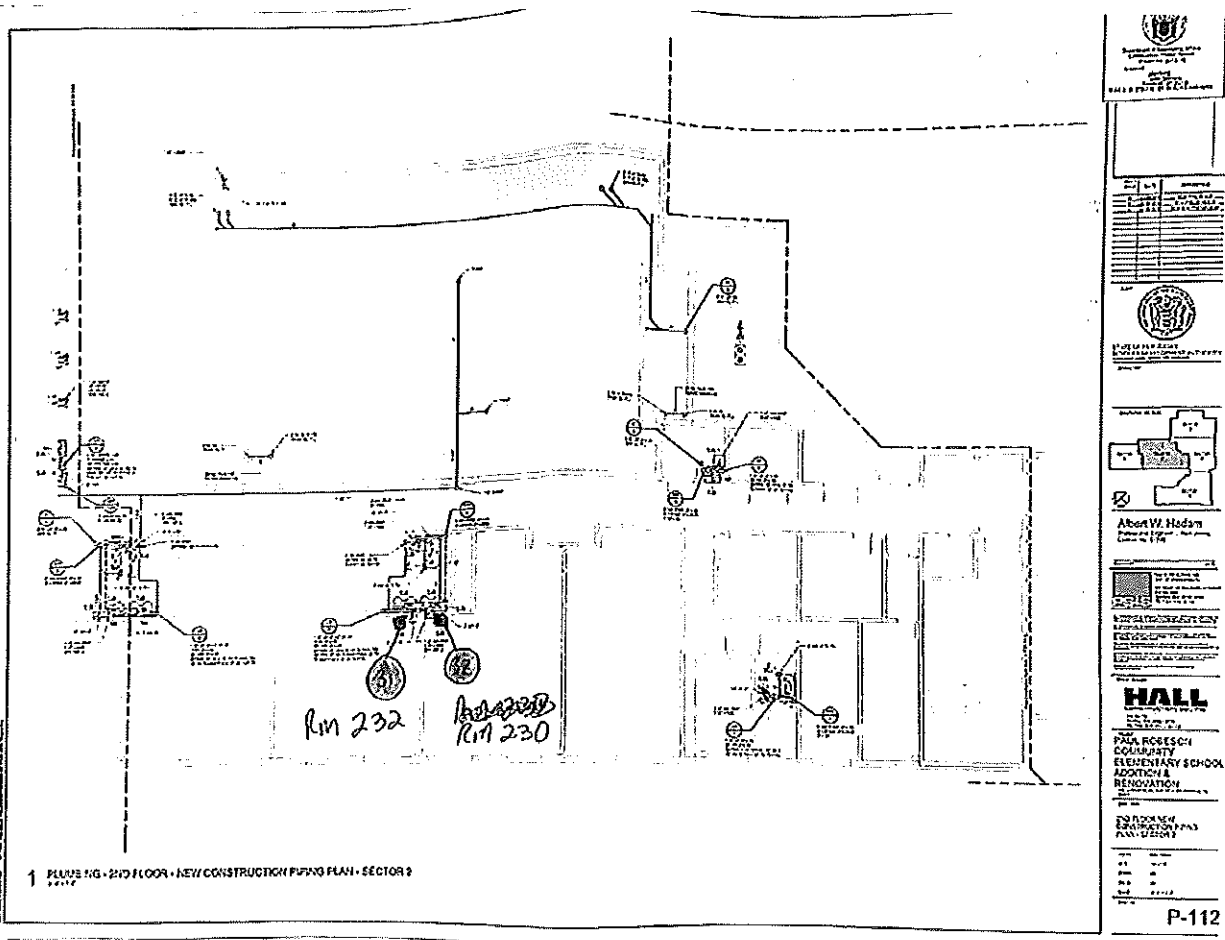


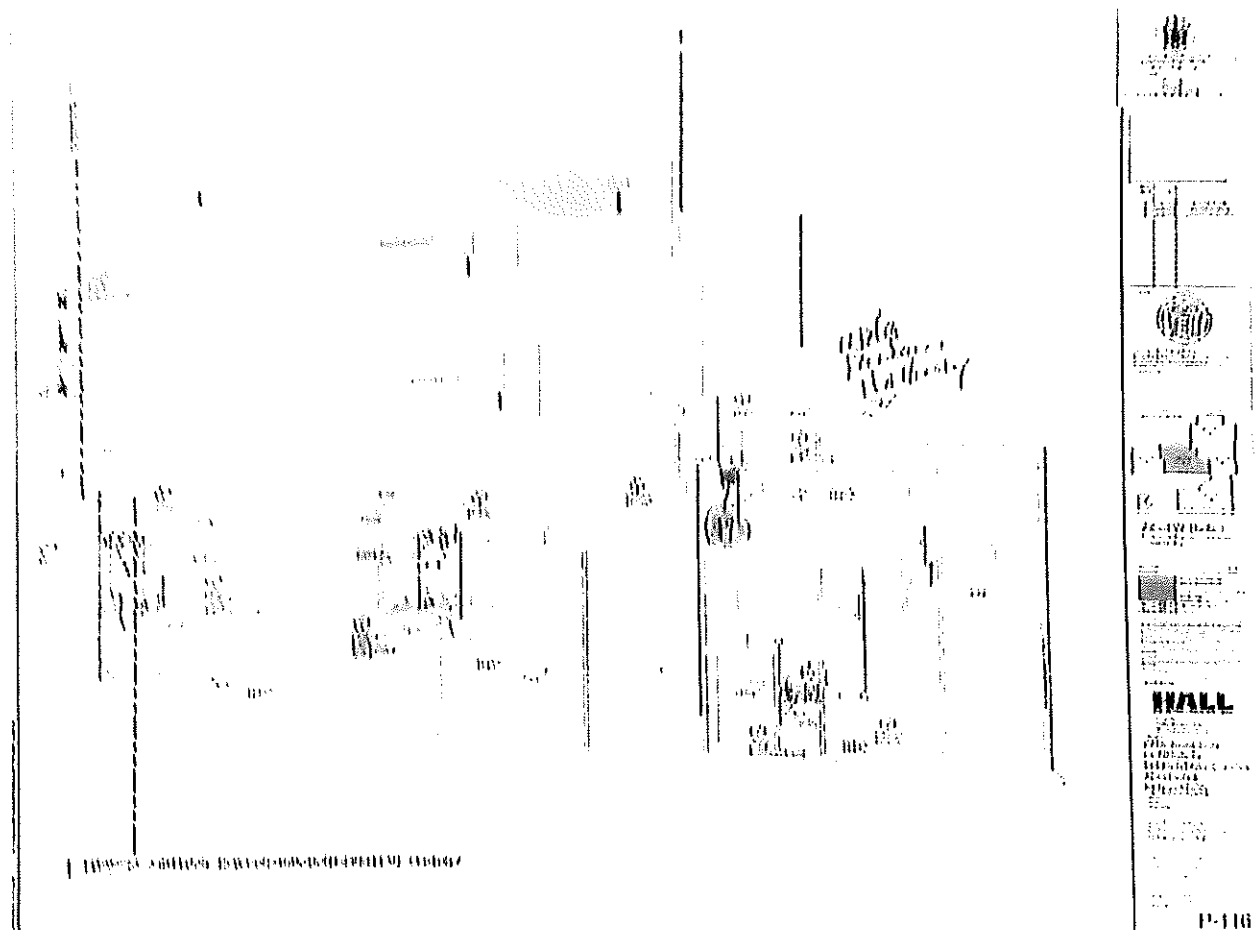

P-116



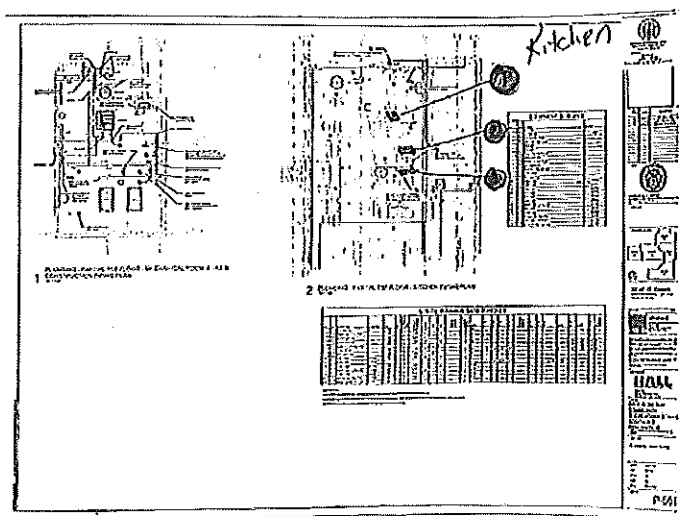

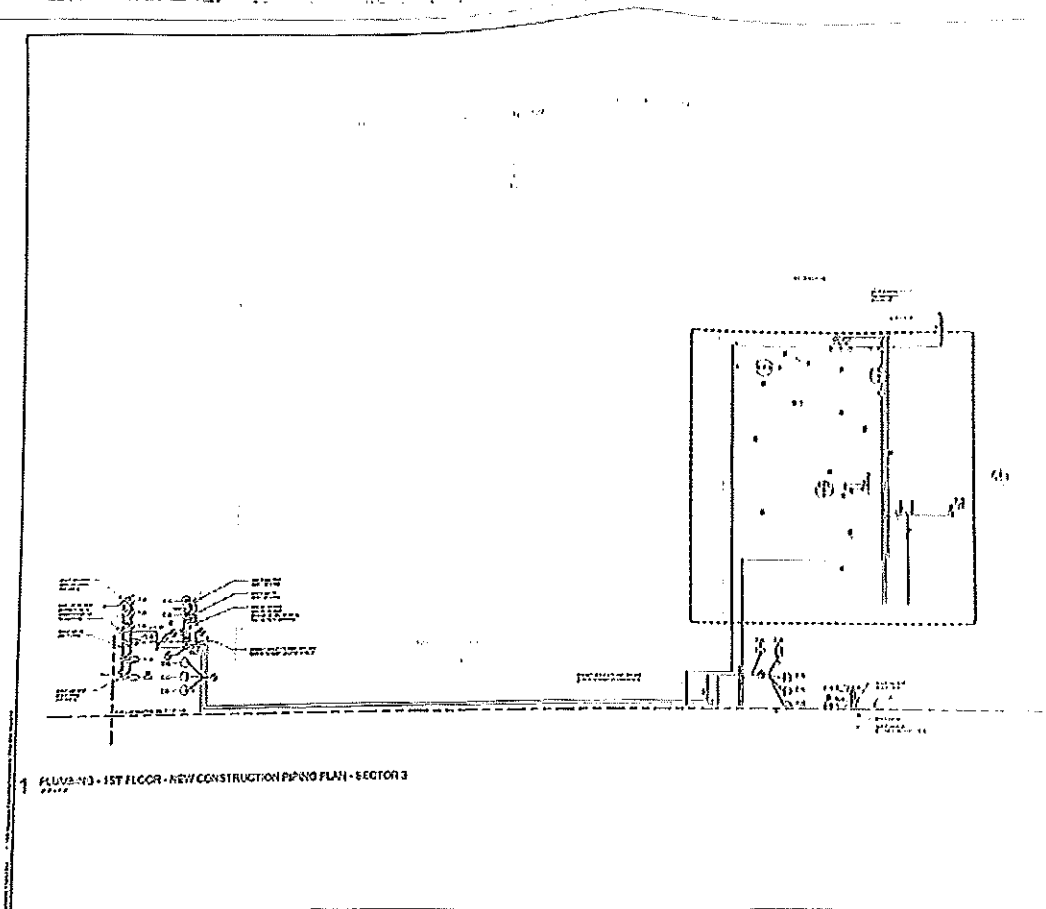

Appendix E Laboratory Data



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

August 31, 2018

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

180908; Paul Robeson Community School; 199 Commercial Ave; New
Project/Test Address: Brunswick, NJ

Report Number: 18-08-04634

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in black ink, appearing to read "Howard Varner".

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
7469 Whitepine Rd
Richmond, VA 23237
Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
181 US Hwy 46
Mine Hill, NJ 07803

Report Number: 18-08-04634

Received Date: 08/30/2018
Reported Date: 08/31/2018
Sampled By: Mike Mosier
Tech Certification #:

Project/Test Address: 180908; Paul Robeson Community School; 199 Commercial Ave; New Brunswick, NJ

Client Number:
201327

Laboratory Results

Fax Number:
Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
18-08-04634-001	199-20-S-2	08/28/2018	ROOM 105 SINK	1.95	08/31/2018	
18-08-04634-002	199-33-S-2	08/28/2018	ROOM 210 SINK	3.91	08/31/2018	
18-08-04634-003	199-34-S-2	08/28/2018	ROOM 208 SINK	6.99	08/31/2018	
18-08-04634-004	199-35-S-2	08/28/2018	ROOM 211 SINK	6.63	08/31/2018	
18-08-04634-005	199-36-S-2	08/28/2018	ROOM 207 SINK	3.95	08/31/2018	
18-08-04634-006	199-37-S-2	08/28/2018	ROOM 206 SINK	9.47	08/31/2018	
18-08-04634-007	199-38-S-2	08/28/2018	ROOM 212 SINK	2.74	08/31/2018	
18-08-04634-008	199-39-S-2	08/28/2018	ROOM 213 SINK	11.5	08/31/2018	
18-08-04634-009	199-41-S-2	08/28/2018	ROOM 205 SINK	2.98	08/31/2018	
18-08-04634-010	199-42-S-2	08/28/2018	ROOM 204 SINK	16.9	08/31/2018	
18-08-04634-011	199-43-S-2	08/28/2018	ROOM 203 SINK	4.44	08/31/2018	
18-08-04634-012	199-44-S-2	08/28/2018	ROOM 202 SINK	6.84	08/31/2018	

Environmental Hazards Services, L.L.C

Client Number: 201327

Report Number: 18-08-04634

Project/Test Address: 180908; Paul Robeson Community School; 199
Commercial Ave; New Brunswick, NJ

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
18-08-04634-013	199-45-S-2	08/28/2018	ROOM 201 SINK	2.63	08/31/2018	
18-08-04634-014	199-46-S-2	08/28/2018	ROOM 217 SINK	4.76	08/31/2018	
18-08-04634-015	199-47-S-2	08/28/2018	ROOM 218 SINK	1.21	08/31/2018	
18-08-04634-016	199-48-S-2	08/28/2018	CAFETERIA SINK	<1.00	08/31/2018	

Method: SM 3113B-2010

Analyst: Jennalee Zlotkowski

Accreditation #: NJ VA008

Reviewed By Authorized Signatory:



Missy Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L= micrograms per liter ppb = parts per billion



Page 1

Water Chain-of-Custody Form

EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Company Name: LEW CORP

Account #: 201327

Address: 181 US Highway 46

City/State/Zip: Mine Hill, NJ 07933

Phone: (908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: Paul Robeson Community School / 199 Commercial AveCity/State/Zip: NEW BRUNSWICK, NJProject #: 180908Sampled By: MICHAEL MOSIER

License # (If Required):

Water Source: (Check One) Public ☒ Well ☐

Well Tag # (If Applicable):

LDR - YES

5 Day Turnaround

3 Day Turnaround

2 Day Turnaround

1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	199-20-5-2	RM 165 SINK	8/28/18	8:38	AM/PM					
2	-33-5-	210		8:40	AM/PM					
3	-34-5-	208		8:42	AM/PM					
4	-35-5-	211		8:43	AM/PM					
5	-36-5-	207		8:44	AM/PM					
6	-37-5-	206		8:46	AM/PM					
7	-38-5-	212		8:47	AM/PM					
8	-39-5-	213		8:49	AM/PM					
9	-41-5-	205		8:50	AM/PM					
10	-42-5-	209		8:52	AM/PM					

Released by: MICHAEL MOSIER

Signature: Mic Mosier

Date/Time: 8/28/18

Released by:

Signature:

Date/Time:

33338/30/18DEZ MURK1 DAY TAT

18-08-04634

Due Date:
08/31/2018
(Friday)
AE

17



PAGE 2

Water Chain-of-Custody Form

EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

~ For Lab Use Only ~

Company Name: LEW CORP Account #: 201327

Address: 181 US Highway 46 City/State/Zip: Mine Hill, NJ 07803

Phone: (908-654-8068 Email: labresults@lewcorp.com Fax: 908-654-8069

Project Name / Collection Address: PAUL BOBBSON COMMUNITY SCHOOL / 199 COMMERCIAL AVE City/State/Zip: NEW BRUNSWICK, NJ

Project #: 180908 Sampled By: MICHAEL MOSIER License # (if Required):

Water Source: (Check One) Public ☒ Well ☐ Well Tag # (if Applicable):

LOA - YES

☐ 5 Day Turnaround	☐ 3 Day Turnaround	☒ 2 Day Turnaround	☐ 1 Day Turnaround * Call Ahead
---	---	--	--

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	199-43-25-2	LM 203 SINK	8/28/18	8:53	AM/PM					
12	-44-	202		8:54	AM/PM					
13	-45-	201		8:56	AM/PM					
14	-46-	217		8:57	AM/PM					
15	-47-	218		8:58	AM/PM					
16	V-48-V	CHARTRUA SINK		9:00	AM/PM					
7					AM/PM					
8					AM/PM					
9					AM/PM					
10					AM/PM					
Released by: <u>MICHAEL MOSIER</u>				Signature: <u>Mike Mosier</u>	Date/Time: <u>8/28/18</u>		Date/Time: <u>8/28/18</u>			
Released by: <u>GIVEN</u>				Signature: <u>Mike Mosier</u>	Date/Time: <u>8/30/18</u>		Date/Time: <u>8/30/18</u>			



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

August 31, 2018

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

180908; New Brunswick Middle School; 1125 Livingston Ave; New Brunswick,
Project/Test Address: NJ

Report Number: 18-08-04624

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in black ink, appearing to read "Howard Varner".

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
7469 Whitepine Rd
Richmond, VA 23237
Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
181 US Hwy 46
Mine Hill, NJ 07803

Report Number: 18-08-04624

Received Date: 08/30/2018
Reported Date: 08/31/2018
Sampled By: Mike Moiser
Tech Certification #:

Project/Test Address: 180908; New Brunswick Middle School; 1125 Livingston Ave; New Brunswick, NJ

Client Number:
201327

Laboratory Results

Fax Number:
Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
18-08-04624-001	1125-4-WF-2	08/28/2018	RM 102 HALLWAY WATER FOUNTAIN	1.14	08/31/2018	
18-08-04624-002	1125-11-FP-2	08/28/2018	KITCHEN KETTLE 1	25.2	08/31/2018	
18-08-04624-003	1125-13-FP-2	08/28/2018	KITCHEN KETTLE 33-2	7.00	08/31/2018	
18-08-04624-004	1125-14-S-2	08/28/2018	CAFETERIA SINK	<1.00	08/31/2018	

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:

Melissa Kanode

Missy Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.


LEGEND ug/L = micrograms per liter ppb = parts per billion



EHS Laboratories
ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form
SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237
Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

18-08-04624



Due Date:
08/31/2018
(Friday)
AE

Company Name: LEW CORP

Account #: 201327

Address: 181 US Highway 46

City/State/Zip: Mine Hill, NJ 07803

Phone: (908-654-8068)

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: NEW BRUNSWICK MIDDLE SCHOOL 1125 LIVINGSTON AVE

City/State/Zip: NEW BRUNSWICK, NJ

Project #: 180908

Sampled By: MICHAEL MOSIER

License # (If Required):

Water Source: (Check One) Public ☒ Well ☐

Well Tag # (If Applicable):

LPA-YES

5 Day Turnaround

3 Day Turnaround

2 Day Turnaround

1 Day Turnaround * Call Ahead

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
1	1125-4-WF-2	Rm 102 HALLWAY WATER TAP	8/28/18	9:18	AM/PM					
2	1-11-AP-1	KITCHEN KETTLE-1		9:22	AM/PM					
3	1-13-AP-1	KITCHEN KETTLE #32-2		9:24	AM/PM					
4	1-14-S-1	KITCHEN SINK		9:26	AM/PM					
5					AM/PM					
6					AM/PM					
7					AM/PM					
8					AM/PM					
9					AM/PM					
10					AM/PM					

Released by: MICHAEL MOSIER Signature: Mic Mosier Date/Time: 8/28/18

Released by: GREG Signature: GREG Date/Time: 8/30/18 11 PER MIXER CHANGE TO 1 DAY



Environmental Hazards Services, LLC

7469 Whitepine Rd. • Richmond, VA 23237 • 800-347-4010 • jdickerson@leadlab.com

August 31, 2018

LEW Corp
181 US Highway 46
Mine Hill, NJ 07803

PROJECT INFORMATION

180908; New Brunswick High School; 1000 Somerset Street; New Brunswick,
Project/Test Address: NJ

Report Number: 18-08-0 4610

Analysis Type: Lead – Standard Method 3113B

Lab Accreditation

Number: NJ-VA008/NY-11714

Results, Discussion

Qualifiers: N/A

A handwritten signature in black ink, appearing to read "Howard Varner".

Howard Varner
General Manager/Laboratory Director
Environmental Hazards Services, LLC



Environmental Hazards Services, L.L.C.
7469 Whitepine Rd
Richmond, VA 23237
Telephone: 800.347.4010

Lead in Drinking Water Analysis Report

Client: LEW Corp
181 US Hwy 46
Mine Hill, NJ 07803

Report Number: 18-08-04610

Received Date: 08/30/2018
Reported Date: 08/31/2018
Sampled By: Mike Mosier
Tech Certification #:

Project/Test Address: 180908; New Brunswick High School; 1000 Somerset Street; New Brunswick, NJ

Client Number:
201327

Laboratory Results

Fax Number:
Ext 18

Lab Sample Number	Client Sample ID	Collection Date	Collection Location	Concentration ug/L (ppb)	Analysis Date	Narrative ID
18-08-04610-001	NBHS-44-FP-2	08/28/2018	KITCHEN POT FILLER	<1.00	08/31/2018	
18-08-04610-002	NBHS-45-S-2	08/28/2018	CAFETERIA SINK	<1.00	08/31/2018	

Method: SM 3113B-2010
Analyst: Jennalee Zlotkowski
Accreditation #: NJ VA008

Reviewed By Authorized Signatory:

Melissa Kanode

Missy Kanode

QA/QC Clerk

Sample Results denoted with a "less than" (<) sign contain less than the reporting limit which is 1 ppb.

The EPA Maximum Contaminant Level for Lead in Drinking Water is 15 ppb. The results herein conform to NELAC standards, where applicable, unless otherwise narrated on this report. Results represent the analysis of samples submitted by the client. Sample location, description, field parameter results, etc., were provided by the client. This report cannot be reproduced, except in full, without written approval from Environmental Hazards Services, L.L.C.

LEGEND ug/L = micrograms per liter ppb = parts per billion



EHS Laboratories


ENVIRONMENTAL HAZARDS SERVICES, LLC

Water Chain-of-Custody Form

SHIP TO: 7469 Whitepine Rd. Richmond, VA 23237

Phone: (800) 347-4010 FAX: (804) 275-4907

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



18-08-04610

Due Date:

08/31/2018

(Friday)

AE

Company Name: LEW CORP

Account #: 201327

Address: 181 US Highway 46

City/State/Zip: Mine Hill, NJ 07803

Phone: (908-654-8068

Email: labresults@lewcorp.com

Fax: 908-654-8069

Project Name / Collection Address: NEW BRUNSWICK HIGH SCHOOL / 1000 SOWENSET STREET

City/State/Zip: NEW BRUNSWICK, NJ

Project #: 180908

Sampled By: MICHAEL MOSIER

License # (If Required):

Water Source: (Check One) Public ☒ Well ☐

Well Tag # (If Applicable):

CDA-YES

	5 Day Turnaround	3 Day Turnaround	☒ 2 Day Turnaround	1 Day Turnaround * Call Ahead						
No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	Temp at Time of Receipt:
1	MBHS-44-FP-2	KITCHEN POT FILLER	8/28/18	9:38	AM/PM					
2	MBHS-45-S-2	CRAFTERIA SINK	8/28/18	9:43	AM/PM					
3					AM/PM					
4					AM/PM					
5					AM/PM					
6					AM/PM					
7					AM/PM					
8					AM/PM					
9					AM/PM					
10					AM/PM					

Released by: MICHAEL MOSIER Signature: Mosier Date/Time: 8/28/18

Released by: STEVE B/B Signature: 8/30/18 11 Date/Time: PER MWR CHANGE TO 1 DAY TAT