

Phone: 465-3181

Department of Health

Cape May County

CAPE MAY COURT HOUSE, N. J. 08210

PERMIT

Permission has this date been given to:

No. 50198C

Date

ROSALIND FOTASH

c/o AVALON REAL ESTATE

SO. MAIN STREET

CAPE MAY COURT HOUSE, N. J. 08210

X to construct a sewage disposal system as described in engineering data submitted in accordance with the provisions of Chapter 199, P. L., 1954 N. J. S. A.

X to construct a water supply system as described in engineering data submitted in accordance with the provisions of Chapter 199, P. L. 1954 N. J. S. A., at:

BOARD AVENUE

CAPE MAY COURT HOUSE

FIFTEEN (15) -- TWO (2) BEDROOM APARTMENTS

Lot	Block
65	163

BOARD OF HEALTH
TOWNSHIP OF MIDDLE


NOTICE:

This system must be inspected by a sanitarian from the Cape May County Department of Health before it is covered from view.

By.....




THIS PERMIT MUST BE POSTED IN PLAIN VIEW

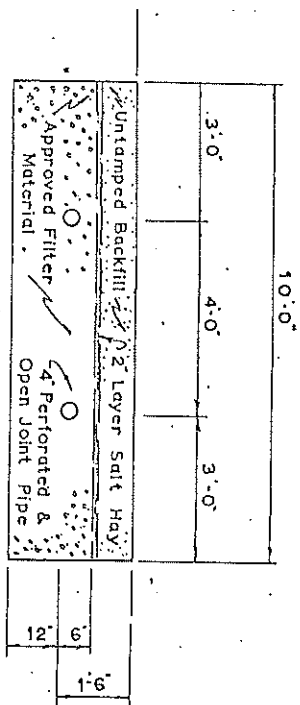

TYPICAL SECTION-DISPOSAL BED

SCALE: 3/8"=1'-0"

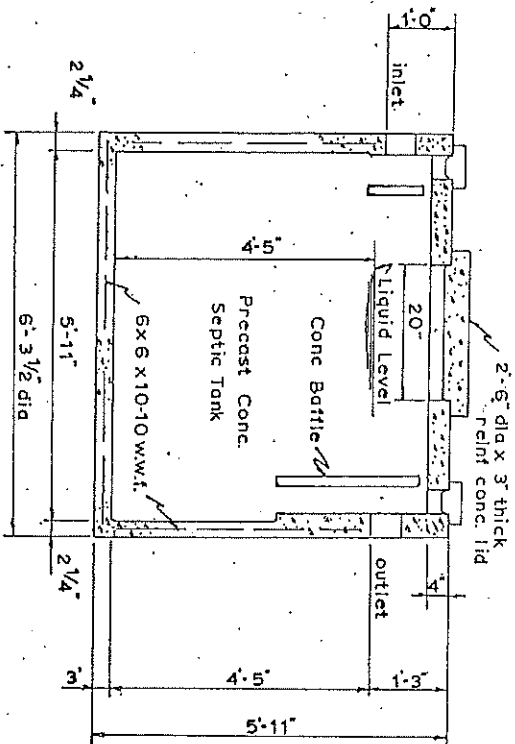

900 GALLON SEPTIC TANK

NO SCALE

CAPE MAY COUNTY
JUL 3 1964

- NOTES: 1. All work on sewage disposal system shall be subject to approval of design engineer as well as Cape May County Health Department. Contractor for sewage disposal system shall be approved by the design engineer.
2. There are no wells or disposal systems within 50 feet of the proposed construction.

System "A" Perc. Rate: 4 min./inch
Ground Water: 10'
Elevation: 20' +

Soil Log:
0'-0" to 0'-4" Decayed Leaves &
0'-4" to 4'-0" Topsoil
4'-0" to 10' Sandy Gravel

System "B" Perc. Rate: 4 min./inch
Ground Water: 9'
Elevation: 20

Soil Log:
0'-0" to 0'-5" Topsoil
0'-5" to 5'-0" Gravel
5'-0" to 10' Sand

System "C" Perc. Rate: 4 min./inch
Ground Water: 10'
Elevation: 20'

Soil Log:
0'-0" to 0'-8" Topsoil
0'-8" to 4'-0" Gravel
4'-0" to 10' Sand

lot 65 A

125,

 $150^{\circ} \pm$

DRIVEWAY

5

150'±

1001

266.90' ±

SITE
"A"

EX-151
SYSTEM

OWELLING

50' MIN

WELLS

WELLS

66.90' ±

When asking for final disposition of
Sewage Disposal System or Water Supply,
Refer to No. 7077.

5
 THE ABOVE ENTIRE PROPERTY OF THE
 UNITED STATES OF AMERICA
 IS HEREBY OFFERED FOR SALE
 TO THE HIGHEST BIDDER
 AT THE OFFICE OF THE
 UNITED STATES DEPARTMENT OF THE INTERIOR
 BUREAU OF LAND MANAGEMENT
 WASHINGTON, D. C. 20500


TYPICAL DISPOSAL BED
1" = 30'

10458

542.04⁺


DISPOSAL BED
DIST. BOX
900 GAL. SEPTIC TANK
4" BLDG. SEWER

RECEIVED
JUL 14 1918
Department of Health
Bureau of Hygiene

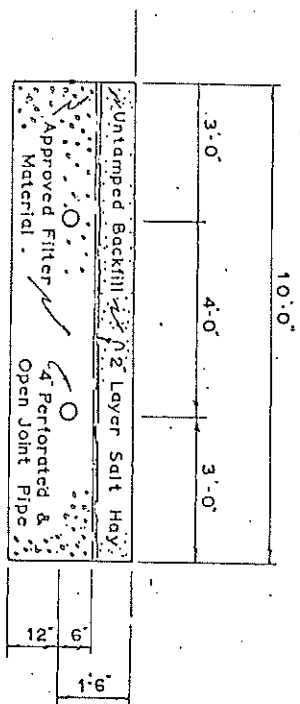

TYPICAL SECTION-DISPOSAL BED

SCALE: 3/8"=1'-0"

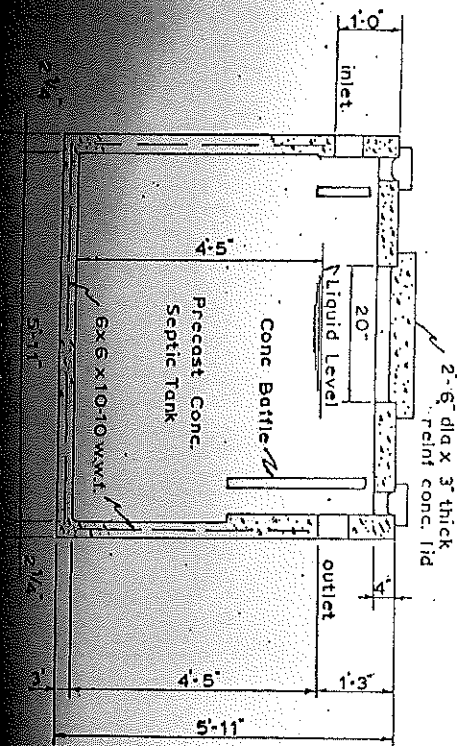

60 GALLON SEPTIC TANK

NO SCALE

NOTES: 1. All work on sewage disposal system shall be subject to approval of design engineer as well as Cape May County Health Department.

2. All work on sewage disposal system shall be approved by the local health department.

System "A" Perc. Rate: 4 min./inch
Ground Water: 10'
Elevation: 20' +

Soil Log:
0'-0" to 0'-4" Decayed Leaves &
Topsoil
0'-4" to 4'-0" Sandy Gravel
4'-0" to 10' Sand



System "B" Perc. Rate: 4 min./inch
Ground Water: 9'
Elevation: 20'

0'-0" to 0'-5" Topsoil
0'-5" to 5'-0" Gravel
5'-0" to 10' Sand

System "C" Perc. Rate: 4 min./inch
Ground Water: 10'
Elevation: 20'

0'-0" to 0'-8" Topsoil
0'-8" to 4'-0" Gravel
4'-0" to 10' Sand

JUL 3 1978



A. C. Herman, P.E. & L.S., N.J. Lic. No. 132

RECEIVED 4-7-78

cc: Mr. [Signature]

I hereby certify that this sewage disposal system complies with Chapter 199 P.L. 1954 according to a perc test made 6-13-78