

BLOCK 1091 LOT 5 ADDRESS (SITE) Old Squan Rd. @ Van Zile Rd. PERMIT NO. 1439-91

583-1994-)
ny - 842-1898)



CONSTRUCTION PERMIT APPLICATION

Applicant Completes: Sections I, II, III (optional), IV, VI and VII

I. IDENTIFICATION

1. Proposed Work-site at: Old Squan Rd. @ Van Zile Road
2. Name of Owner in Fee: Church of St. Dominic Tel. (908)840-1410
Address 250 Old Squan Road Brick Town 08724
street municipality zip code
3. Ownership in Fee: Public _____ Private X
4. Principal Contractor: Woodward Construction Co. Tel. (908)591-1125
Address P.O. Box 393, Matawan, N.J. 07747
License No. OR, if new home, Builder Reg. No. _____ Exp. Date _____
Federal Emp. No. 21-0729911 Social Security No. _____
5. Architect or Engineer Charles G. Surmonte AIA Tel. (908)493-3251
Address 1166 Deal Road, Ocean, N.J. 07712
6. Responsible Person In Charge of Work Charles Woodward Tel. (908)591-1125

Sail
TCO

II. PROPOSED WORK

	Est. Cost
1. ☐ Minor Work (single trade)	
2. ☐ Small Job (\$5,000 and no prior approvals)	
3. ☒ New Building	600,800.
4. ☐ Addition	
5. ☐ Alteration	
6. ☐ Fire Protection	3,900.
7. ☐ Plumbing	37,900.
8. ☒ Electrical	41,000.
9. ☐ Asbestos Abatement	
10. ☐ Demolition	
TOTAL COSTS	683,600.

Church school bldg.
addition

OPTIONAL (for office use only)

Plans Rec'd By	Date Rec'd	Rejection Date	Approval Date	Re-viewer	Resubmission Dates Approval	Re-viewer
			7/17/91		SUBJECT TO FIRE DEPT. APPROVAL	
			final Bldg. OK		1-27-92 OK	
			7/15/91		1-14-92 OK	
			7/29/91		1-8-92 OK	
					1-10-92 OK	
					7/30/92 OK	
					12/16/91 OK	

III. DO YOU WANT: (optional) 1. ☐ Partial Releases 2. ☐ Prototype Processing

IV. DOES OR WILL YOUR BUILDING CONTAIN ANY OF THE FOLLOWING?

- | | | |
|---|---|---|
| 1. ☐ Elevators/Escalators/Lifts/
Dumbwaiters/Moving Walks | 3. ☐ Pressure Vessels | 6. ☐ Hazardous Uses/Places of Assembly |
| 2. ☐ High Pressure Boilers | 4. ☐ Refrigeration Systems | 7. ☐ Sprinklers |
| | 5. ☐ Cross-Connections/Backflow Preventers | 8. ☐ Smoke Control Systems in Open Wells |
| | | 9. ☐ Underground Storage Tanks |

V. FEE SUMMARY (for office use only)

		Update	Update
1. Building	\$ 979.13	/	
2. Electrical		/	
3. Plumbing	185	/	
4. Fire Protection	243	/	
5. Other		/	
6. Subtotal	\$ 1407.13	/	
7. Less 20% for State Plan Review	140.71	/	
8. Subtotal	\$	/	
9. DCA Training Fee	174.07	/	
10. Subtotal	\$	/	
11. Cert. of Occupancy	211.07	/	
12. Other		/	
13. TOTAL	\$ 1932.98	/	

VI. BUILDING/SITE CHARACTERISTICS

1. Number of Stories	one	(office use only)
2. Height of Structure	12 ft.	
3. Area—Largest Floor	9066 sq. ft.	
4. Building Area—All Floors	9066 sq. ft.	
5. Volume of Structure	108,792 cu. ft.	
6. Construction Classification	2C	
7. Total Land Area Disturbed	17,500 sq. ft.	
8. Flood Hazard Zone		
9. Base Flood Elevation	ft.	
10. Wetlands	yes _____ sq. ft. no _____	
11. Fire Grading		
12. Max. Live Load	80	
13. Max. Occupancy Load	313	

VII. DESCRIPTION OF BUILDING USE

- A. RESIDENTIAL-
- 1. ☐ Hotels (R-1)
 - 2. ☐ Multi-Family (R-2)
 - 3. ☐ Two-Family (R-3) BOCA
 - 4. ☐ Two-Family (R-4) CABO
 - 5. ☐ One-Family (R-3) BOCA
 - 6. ☐ One-Family (R-4) CABO
- No of dwelling units:
Before Construction _____
After Construction _____
Net gain or loss _____
- B. NON-RESIDENTIAL
- 1. State Specific Use: School
 - 2. Use Group: E
 - 3. Change in Use Group, Indicate Former:

LDS BR 10515992

7 OK

CERTIFICATION IN LIEU OF OATH

I. OWNER SECTION (to be completed if the applicant is the owner in fee)

I hereby certify that I am the owner in fee of the property listed on Page 1.

Mark the following applicable boxes:

- A. ☐ I further certify that a new home (private residence) will be constructed on this property for my own use and occupancy. This dwelling is to be occupied by myself and is not to be used for any purpose other than single family residential use. I attest that all construction, plumbing, or electrical work will be done, in whole or in part, by me or by subcontractors under my supervision, in accordance with all applicable laws; and, I further acknowledge that said new home is not covered under the New Home Warranty and Builders Registration Act (N.J.S.A. 46:3B-1 et seq.) and that such fact shall be disclosed to any person purchasing this property within ten years of the date of issuance of a certificate of occupancy.

I UNDERSTAND THAT IN MARKING BOX A, I ACKNOWLEDGE THAT I AM ASSUMING RESPONSIBILITY FOR THE WORK DONE ON SAID PROPERTY, THE CONDITION OF THE PROPERTY PRIOR TO, DURING, AND AFTER ANY WORK PERFORMED, AND FOR THE PERFORMANCE OF THE SUBCONTRACTORS I HIRE, EMPLOY, OR OTHERWISE CONTRACT OR WITH WHOM I MAKE AGREEMENTS TO PERFORM WORK. I AM VOLUNTARILY AND KNOWINGLY ASSUMING THIS RESPONSIBILITY.

- B. ☐ I further certify the following as required by the New Jersey Uniform Construction Code, N.J.A.C. 5:23-2.15(e)1.vii:

I personally prepared the plans submitted for: 1) the new home referred to in A.; or, 2) an addition, alteration, renovation, or repair to an existing single family residence owned and occupied by myself and located on the property listed on Page 1; or, 3) a new structure that will be physically separate from, but that will be deemed part of, an existing single family residence that is owned and occupied by myself and located on the property listed on Page 1.

- C. ☐ I further certify that I will perform or supervise the following work:

C.1. ☐ Building C.2. ☐ Fire Protection

I further certify that I will perform the following work:

C.3. ☐ Electrical C.4. ☐ Plumbing

- D. ☐ I agree to advise all contractors on this project that they are required to be registered with the New Jersey Division of Taxation and to comply with all New Jersey tax laws.

I further certify the following as required by the Uniform Construction Code, N.J.A.C. 5:23-2.15(a)5: All required State, county, and local prior approvals have been given, including such certification as the construction official may require.

I understand that if any of the above statements are willfully false, I am subject to punishment.

Signature _____ Date _____

II. AGENT SECTION

(to be completed if the applicant is not the owner in fee)

I hereby certify the following as required by the New Jersey Uniform Construction Code, N.J.A.C. 5:32-2.15(d): the proposed work is authorized by the owner in fee; and I have been authorized by the owner in fee to make this application as his agent.

I further certify the following as required by the Uniform Construction Code, N.J.A.C. 5:23-2.15(a)5: All required State, county, and local prior approvals have been given, including such certification as the construction official may require.

I agree to advise all contractors on this project that they are required to be registered with the New Jersey Division of Taxation and to comply with all New Jersey tax laws.

I understand that if any of the above statements are willfully false, I am subject to punishment.

☐ Check if contractor.

Agent Name Woodward Ernst

Address Box 393

Matamoras NJ 07747

Telephone (591-1125)

Signature Woodward Ernst Date 6/18/99

OFFICE DATE RECEIVED: _____

New Copy

VIII. PRIOR APPROVALS CHECKLIST (office use only)	LOCAL APPROVAL		COUNTY APPROVAL		REGIONAL APPROVAL		STATE APPROVAL		COMMENTS
	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	
☐ Planning Board	5/5/91	7/1/91	9/1						
☐ Zoning Board									
☐ Sewer Authority									
☐ Water Authority									
☐ Fire Department									
☐ Police Department									
☐ Health Department									
☐ Soil Conservation									
☐ N.J. Dept. of Community Affairs									
☐ N.J. Department of Transportation									
☐ N.J. Dept. of Environmental Protection									
☐ Utility Dig No.									
☐ Other <i>SK</i>		7/1/91	<i>sk</i>						
☐ <i>Eng</i>		<i>7/1/91</i>	<i>sk</i>						
☐ <i>1600</i>		<i>7/1/91</i>	<i>sk</i>						
☐ <i>FD</i>									

IX. SUBCODES AND SPECIAL REGULATIONS APPLICABLE (office use only—optional)

Name of Code & Edition	Name of Code & Edition
Building _____	Energy _____
Electrical _____	Barrier Free _____
Plumbing _____	Flood Hazard _____
Fire Protection _____	As Built Elevation Cert. _____
Mechanical _____	Other _____

X. CERTIFICATES ISSUED (office use only)

☒ Temporary Certificate of Occupancy	No. <i>1439</i>	DATE EXPIRED <i>1-28-92</i>
☐ Temporary Certificate of Occupancy	No. _____	<i>and 4/30/92</i>
☐ Continued Certificate of Occupancy	No. <i>1439</i>	
☐ Certificate of Occupancy	No. <i>1439</i>	
☐ Certificate of Approval	No. _____	
☐ None	No. _____	

OFFICE DATE RECEIVED: _____

VIII. PRIOR APPROVALS CHECKLIST (office use only)	LOCAL APPROVAL		COUNTY APPROVAL		REGIONAL APPROVAL		STATE APPROVAL		COMMENTS
	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	
☒ Planning Board	8/15/91	7/11/91							
☐ Zoning Board									
☐ Sewer Authority									
☐ Water Authority									
☐ Fire Department									
☐ Police Department									
☐ Health Department									
☐ Soil Conservation									
☐ N.J. Dept. of Community Affairs									
☐ N.J. Department of Transportation									
☐ N.J. Dept. of Environmental Protect.									
☐ Utility Dig No.									
☒ Other <i>Zoning</i>	<i>SK</i>	<i>7/11/91</i>	<i>Church add.</i>						
☐									
☐									
☐									

IX. SUBCODES AND SPECIAL REGULATIONS APPLICABLE (office use only—optional)

Name of Code & Edition	Name of Code & Edition	Other
Building _____	Energy _____	
Electrical _____	Barrier Free _____	
Plumbing _____	Flood Hazard _____	
Fire Protection _____	As Built Elevation Cert. _____	
Mechanical _____	Other _____	

X. CERTIFICATES ISSUED (office use only)

CERTIFICATES ISSUED	DATE EXPIRED
☐ Temporary Certificate of Occupancy	No. _____
☐ Temporary Certificate of Occupancy	No. _____
☐ Continued Certificate of Occupancy	No. _____
☐ Certificate of Occupancy	No. _____
☐ Certificate of Approval	No. _____
☐ None	

20K

CERTIFICATION IN LIEU OF OATH

I. OWNER SECTION (to be completed if the applicant is the owner in fee)

I hereby certify that I am the owner in fee of the property listed on Page 1.

Mark the following applicable boxes:

- A. ☐ I further certify that a new home (private residence) will be constructed on this property for my own use and occupancy. This dwelling is to be occupied by myself and is not to be used for any purpose other than single family residential use. I attest that all construction, plumbing, or electrical work will be done, in whole or in part, by me or by subcontractors under my supervision, in accordance with all applicable laws; and, I further acknowledge that said new home is not covered under the New Home Warranty and Builders Registration Act (N.J.S.A. 46:3B-1 et seq.) and that such fact shall be disclosed to any person purchasing this property within ten years of the date of issuance of a certificate of occupancy.

I UNDERSTAND THAT IN MARKING BOX A, I ACKNOWLEDGE THAT I AM ASSUMING RESPONSIBILITY FOR THE WORK DONE ON SAID PROPERTY, THE CONDITION OF THE PROPERTY PRIOR TO, DURING, AND AFTER ANY WORK PERFORMED, AND FOR THE PERFORMANCE OF THE SUBCONTRACTORS I HIRE, EMPLOY, OR OTHERWISE CONTRACT OR WITH WHOM I MAKE AGREEMENTS TO PERFORM WORK. I AM VOLUNTARILY AND KNOWINGLY ASSUMING THIS RESPONSIBILITY.

- B. ☐ I further certify the following as required by the New Jersey Uniform Construction Code, N.J.A.C. 5:23-2.15(e)1.vii:

I personally prepared the plans submitted for: 1) the new home referred to in A.; or, 2) an addition, alteration, renovation, or repair to an existing single family residence owned and occupied by myself and located on the property listed on Page 1; or, 3) a new structure that will be physically separate from, but that will be deemed part of, an existing single family residence that is owned and occupied by myself and located on the property listed on Page 1.

- C. ☐ I further certify that I will perform or supervise the following work:

C.1. ☐ Building C.2. ☐ Fire Protection

I further certify that I will perform the following work:

C.3. ☐ Electrical C.4. ☐ Plumbing

- D. ☐ I agree to advise all contractors on this project that they are required to be registered with the New Jersey Division of Taxation and to comply with all New Jersey tax laws.

I further certify the following as required by the Uniform Construction Code, N.J.A.C. 5:23-2.15(a)5: All required State, county, and local prior approvals have been given, including such certification as the construction official may require.

I understand that if any of the above statements are willfully false, I am subject to punishment.

Signature _____ Date _____

II. AGENT SECTION

(to be completed if the applicant is not the owner in fee)

I hereby certify the following as required by the New Jersey Uniform Construction Code, N.J.A.C. 5:32-2.15(d): the proposed work is authorized by the owner in fee; and I have been authorized by the owner in fee to make this application as his agent.

I further certify the following as required by the Uniform Construction Code, N.J.A.C. 5:23-2.15(a)5: All required State, county, and local prior approvals have been given, including such certification as the construction official may require.

I agree to advise all contractors on this project that they are required to be registered with the New Jersey Division of Taxation and to comply with all New Jersey tax laws.

I understand that if any of the above statements are willfully false, I am subject to punishment.

☒ Check if contractor.

Agent Name Woodward Construction Co.

Address P.O. Box 393
Matawan N.J. 07747

Telephone (908) 591-1125

Signature [Signature] Date 6/18/91



CERTIFICATE

Date Issued 4-21-92
Control #
Permit # 1439-91

IDENTIFICATION

Block 1091 Lot 5
Work Site Location Old Squan Road & Van Zile Rd.
Owner in Fee Church of St. Dominic
Address 250 Old Squan Road
Brick, NJ
Tele. ()
Contractor Woodward Construction, Co.
Address P.O. Box 393
Matawan, NJ 07747
Tele. ()
Lic. No. or Bldrs. Reg. No.
Federal Emp. No.
or Social Security No.

Home Warranty No. N/A
Use Group F
Maximum Live Load
Description of Work/Use:

Church school addition

Type of Warranty Plan: [] State [] Private
Construction Classification
Maximum Occupancy Load

CERTIFICATE OF OCCUPANCY/APPROVAL

☒ **CERTIFICATE OF OCCUPANCY**

This serves notice that said building, structure, or equipment has been constructed or installed in accordance with the New Jersey Uniform Construction Code, and is approved for use and/or occupancy.

☐ **CERTIFICATE OF APPROVAL**

☐ **CERTIFICATE OF CONTINUED OCCUPANCY**
This serves notice that based on a general inspection of the visible parts of the building there are no imminent hazards and the building is approved for continued occupancy.

☐ **TEMPORARY CERTIFICATE OF OCCUPANCY**
If this is a Temporary Certificate of Occupancy the following conditions must be met no later than , 19 or the owner will be subject to a fine or order to vacate:

CONSTRUCTION OFFICIAL

Arthur J. Ciesco

Fee \$
Paid [] Check No.
Collected by:



CERTIFICATE

Date Issued 1-28-92
Control #
Permit # 1439-91

IDENTIFICATION

Block 1091 Lot 5
Work Site Location Old Squan Road & Van Zile Rd.
Owner in Fee Church of St. Dominic
Address 250 Old Squan Road
Brick, NJ
Tele. ()
Contractor Woodward Construction, Co.
Address P.O. Box 393
Matawan, NJ 07747
Tele. ()
Lic. No. or Bldrs. Reg. No.
Federal Emp. No.
or Social Security No.

Home Warranty No. N/A
Use Group R
Maximum Live Load
Description of Work/Use:

Church school addition

Type of Warranty Plan: [] State [] Private
Construction Classification
Maximum Occupancy Load

CERTIFICATE OF OCCUPANCY/APPROVAL

☐ CERTIFICATE OF OCCUPANCY

This serves notice that said building, structure, or equipment has been constructed or installed in accordance with the New Jersey Uniform Construction Code, and is approved for use and/or occupancy.

☐ CERTIFICATE OF APPROVAL

☐ CERTIFICATE OF CONTINUED OCCUPANCY

This serves notice that based on a general inspection of the visible parts of the building there are no imminent hazards and the building is approved for continued occupancy.

XXX ☒ TEMPORARY CERTIFICATE OF OCCUPANCY

If this is a Temporary Certificate of Occupancy the following conditions must be met no later than April 30, 1992 or the owner will be subject to a fine or order to vacate:
Pending compliance with Ocean County Soil District.

CONSTRUCTION OFFICIAL

Arthur J. Piers

Fee \$
Paid [] Check No.
Collected by:



CONSTRUCTION PERMIT

Date Issued 7-31-91
Control #
Permit # 1439-91

IDENTIFICATION Block 1091 Lot 5
Work Site Location Old Swan & Van Zile Rd. Contractor Woodward Const. Co.
Owner in Fee Church of H. Dominica Address P.O. Box 393
Address 250 N. H. Lane Rd. Tele. ()
Tele. () Brick, NJ Lic. No. or Bldrs. Reg. No. Exp. Date ***0002**
Federal Emp. No. 1439**
or Social Security No.

is hereby granted permission to perform the following work:

☒ BUILDING ☒ PLUMBING ☐ OTHER
☐ ELECTRICAL ☒ FIRE PROTECTION

DESCRIPTION OF WORK:

Church school bldg.
Addition vol. 108,792.

NOTE: If construction does not commence within one (1) year of date of issuance, or if construction ceases for a period of six (6) months, this permit is void.

Estimated Cost of Work \$ 683,600. A.J. Cieszy

PAYMENTS (Office Use Only) 1091 #	
Building	LOT 0.00
Plumbing	5 #
Electrical	BUILDING 979.13
Fire Protection	PLUMBING 185.00
Other	FIRE 243.00
Other	PLAN REV 140.71
DCA Training Fee	D.C.A. 174.07
Cert. of Occ.	C / O 211.07
Other	TOTAL 932.98
Total	CHECK 932.98
Check No.	CASH 0.00
Cash	CHANGE
Collected By:	

REQUIRED INSPECTIONS

Construction work must be inspected in accordance with the State Uniform Construction Code Regulations N.J.A.C. 5:23-2.18. This agency will carry out such periodic inspections during the progress of work as are necessary to insure that work installed conforms to the approved plans and the requirements of the Uniform Construction Code.

The owner or other responsible person in charge of work must notify this agency when work is ready for any required inspections specified below. Requests for inspections must be made at least 24 hours prior to the time the inspection is desired. Inspections will be performed within three business days of the time for which they are requested. The work must not proceed in a manner which will preclude the inspection until it has been made and approval given.

☐ Required inspections for all subcodes for one and two family dwellings are the following:

1. The bottom of footing trenches before placement of footings, except that in the case of pile foundations, inspections shall be made in accordance with the requirements of the building subcode;
2. Foundations and all walls up to grade level prior to back filling;
3. All structural framing and connections prior to covering with finish or infill material; plumbing underground services, rough piping, water service, sewer, septic services and storm drains; electrical rough wiring, panels and service installations; insulation installations;
4. Installation of all finished materials, sealings of exterior joints; plumbing piping, trim and fixtures; electrical wiring, devices and fixtures; mechanical systems equipment.

☐ Required special inspections. The applicant by accepting the permit will be deemed to have consented to these requirements:

☐ A final inspection is required for each applicable subcode area before a final Certificate of Occupancy or Approval may be issued. Any violations of the approved plans and/or permit will be noted and the holder of the permit notified of discrepancies.

☐ A complete copy of approved plans must be kept on the job site.

If you do not understand any of this information, please ask.



PERMIT UPDATE

Date Update Issued 3/3/92
Control #
Permit # 1437-91
Date Permit Issued

IDENTIFICATION Block 1091 Lot 5
Work Site Location Old Squan Route & Van Zile Contractor J. A. Christman, Inc.
Brick Township, NJ Address 15 Catherine Street
Owner in Fee Church of St. Dominick Red Bank, NJ 07701
Address 250 Old Squan Road Tele. (908) 842-1892
Brick, NJ 08724 Lic. No. or Bldrs. Reg. No. 3896
Tele. (908) 840-1413 Federal Emp. No. 22223270
or Social Security No. _____

is hereby granted permission to perform the following work:

☐ BUILDING ☒ PLUMBING ☐ Other _____

☐ ELECTRICAL ☐ FIRE PROTECTION

DESCRIPTION OF WORK:

addition of two (2) toilets

Estimated Cost of Work \$ 2,085.00

[Signature]
CONSTRUCTION OFFICIAL

PAYMENTS (Office Use Only)	
Building	_____
Plumbing	_____
Electrical	PLUMBING
Fire Protection	TOTAL
Other	CHECK
Other	CASH
DCA Training Fee	NO. 5 3007A005
Cert. of Occ.	_____
Other	_____
Total	_____
Check No.	5234
Cash	_____
Collected By:	_____



PERMIT UPDATE

Date Update Issued 1/5/92

Control #

Permit # 1439-91Date Permit Issued 7-31-91IDENTIFICATION Block 1091 Lot 5+7Work Site Location Rt 88 + VAN ZILEContractor Lubert Co IncAddress 235 DRUM PT RDOwner in Fee St. Dominic ChurchAddress 5THTele. (508) 920-6611Lic. No. or Bldrs. Reg. No. 8414Tele. (800) 840 1410Federal Emp. No. 222 209 329

or Social Security No. _____

is hereby granted permission to perform the following work:

☐ BUILDING☐ PLUMBING☐ Other _____☐ ELECTRICAL☒ FIRE PROTECTION

DESCRIPTION OF WORK:

Replace F-A Panel
ON EXIST FIRE ALARM SYSTEM
Estimated Cost of Work \$ 1500

[Signature]
CONSTRUCTION OFFICIAL

PAYMENTS (Office Use Only)

Building	<u>2000.00</u>	
Plumbing	<u>1437.00</u>	
Electrical	<u>211.00</u>	0.00
Fire Protection	<u>1071.00</u>	
Other	<u>LOI</u>	0.00
Other	<u>5.00</u>	
DCA Training Fee	<u>FIRE</u>	20.00
Cert. of Occ.	<u>TOTAL</u>	20.00
Other	<u>CHARGE</u>	20.00
Total	<u>5121.00</u>	0.00
Check No.	<u>5121</u>	
Cash		
Collected By:	<u>[Signature]</u>	



Date Received 7-31-91
Date Issued
Control #
Permit # 1439-91

A. IDENTIFICATION—APPLICANT: COMPLETE ALL APPLICABLE INFORMATION. WHEN CHANGING CONTRACTORS, NOTIFY THIS OFFICE. CALL UTILITY DIG NO: 1-800-272-1000.

Block 1091 Lot 5
Work Site Location Old Squan Road & Van Zile Road
Brick Township, N.J.
Owner in Fee Church of St. Dominic
Address 250 Old Squan Road
Brick Township, N.J. 08724
Tele (908) 840-1410
Contractor Woodward Construction Company
Address P.O. Box 393
Matawan, N.J. 07747
Tele ()
Lic. No. or Bids. Reg. No.
Federal Emp. No. 21-0729911 or Social Security No.

C. CERTIFICATION IN LIEU OF OATH

I hereby certify that I am the (agent of) owner of record and am authorized to make this application.
Signature

D. TECHNICAL SITE DATA
DESCRIPTION OF WORK

School Building
See Plans

JOB SUMMARY (Office Use Only)

PLAN REVIEW	Date	Initial	INSPECTIONS	Dates (Month/Day)
☐ No Plans Req.				
☒ All	7/27/91		Type: Footing	Approval Initial
☐ Footing			Foundation	8-8-91
☐ Foundation			Slab	8-14-91
☐ Frame			Frame	
☐ Other			Insulation	
Joint Plan Review Required:			Finishes	
☐ Elec. ☐ Plumb. ☐ Fire			Energy	
SUBCODE APPROVAL			Mechanical	
☐ CO ☐ CCO ☒ CA			TCO	
Date: 7-30-91			Other	
Approved By: J. Chumala			Final	

TYPE OF WORK

☐ New Building	
☐ Addition	
☐ Alteration	
☐ Roofing	
☐ Siding	
☐ Other	
☐ Demolition	
☐ Miscellaneous	
☐ Fence	Height
☐ Sign	Sq. Ft.
☐ Pool	
☐ Elevator	
☐ Asbestos Abatement	
☐ Other	

(Office Use Only)
FEE

B. BUILDING CHARACTERISTICS

Use Group Present E Proposed E
Constr. Class Present N/A Proposed 2C
No. of Stories one (1)
Height of Structure 12 Ft.
Area—Largest Floor 9066 Sq. Ft.
Total Bldg. Area/All Floors 9066 Sq. Ft.
Volume of Structure 108,792 Cu. Ft.
Total Land Area Disturbed 17,500± Sq. Ft.

Est. Cost of Bldg. Work:

1. New Bldg. \$ 600,800.
2. Alteration \$
3. Total (1+2) \$ 600,800.

Paid-1	Check #	Administrative Surcharge	\$
Collected by:		Minimum Fee	\$
		TOTAL FEE	\$



PLUMBING
SUBCODE
TECHNICAL SECTION



Date Received 3-3-92
Date Issued 3-3-92
Control #
Permit # 1439-91
update

A. IDENTIFICATION—APPLICANT: COMPLETE ALL APPLICABLE INFORMATION. WHEN CHANGING CONTRACTORS, NOTIFY THIS OFFICE. CALL UTILITY DIG NO: 1-800-272-1000.

Block 1091 Lot 5

Work Site Location Old Squan Road & Van Zile Road
Brick NJ 08724

Owner/in Fee Church of St. Dominics
Address 250 Old Squan Road
Brick, NJ 08724

Tele. (908) 840-1410

Contractor J. A. Christman, Inc.
Address 15 Catherine Street
Red Bank, NJ 07701

Tele. (908) 842-1899

Lic. No. 5896
Federal Emp. No. 222204970 or Social Security No.

B. PLUMBING CHARACTERISTICS

Use Group Present E 4" Proposed E

Building Sewer Size 8"

Water Service Size 2,089.00

JOB SUMMARY (Office Use Only)

PLAN REVIEW:

☐ No Plans Required
☐ Joint Plan Review Required:

☐ Bldg. ☐ Elec. ☐ Fire
☐ Plumb. Plans Approved

Date: 10-31-91

Approved by: [Signature]

SUBCODE APPROVAL:

☐ CO ☐ CCO ☐ CA

Approved by: _____
Date: _____

INSPECTIONS:

Type: Failure Failure Approval Initial

Slab _____
Rough _____
Water _____
Sewer _____
Fixtures _____
Gas Equipment _____
Gas Final _____
Solar _____
TCO _____

C. CERTIFICATION IN LIEU OF OATH

I hereby certify that I am the (agent of) owner of record and am authorized to make this application and perform the work listed on this application.

☒ Licensed Plumbing Contractor ☐ Exempt Applicant

Signature-Contractor Seal

D. TECHNICAL SITE DATA (List all fixtures.)

NO. 2

FIXTURE/EQUIPMENT

Water Closet

Urinal/Bidet

Bath Tub

Lavatory

Shower

Floor Drain

Sink

Dishwasher

Drinking Fountain

Washing Machine

Hose Bibb

Gas Piping

Fuel Oil Piping

Water Heater

Steam Boiler

Hot Water Boiler

Sewer Pump

Interceptor/Separator

Backflow Preventer

Greasetrap

Water Cooled A/C

or Refrigeration Unit

Sewer Connection

Water Service Connection

Gas Service Connection

Active Solar System

Other

FEE (Office Use Only)

10-

Administrative Surcharge \$
Paid ☐ Check # _____ Minimum Fee \$
Collected by: _____ TOTAL \$ 10-

U.C.C. Form F-130A

1 White=Inspector Copy
3 Pink=Office Copy

2 Canary=Office Copy
4 Gold=Applicant Copy



Brick Township
Municipality



ELECTRICAL
SUBCODE
TECHNICAL SECTION



Date Received
Date Issued
Control #
Permit #

JUL 1 191004658

FEE (Office Use Only)

IDENTIFICATION—APPLICANT: COMPLETE ALL APPLICABLE INFORMATION, WHEN CHANG-

CONTRACTORS, NOTIFY THIS OFFICE. CALL UTILITY DIG NO: 1-800-272-1000.

Job No. 1091 Lot 5

Job Site Location Old Squan Road and Van Zile Road

Brick Town, NJ

Owner in Fee Church of St. Dominic

Address 250 Old Squan Road

Brick Town, NJ

Phone (908) 840-1410

Contractor Sodon's Electric, Inc.

Address P.O. Box 408

Atlantic Highlands, NJ 07716

Phone (908) 291-1713

Job No. 1500 A

General Emp. No. 222401656 or Social Security No.

ELECTRICAL CHARACTERISTICS

Reinspection [] Resale [] Meter Set

Pole/Pad # [] Temporary [] Other

Utility Occupied as Utility Co.

Cost of Elec. Work \$ 41,000.00

CB SUMMARY (Office Use Only)

LAN REVIEW:

No Plans Required

Final Plan Review Required:

Bldg. [] Plumb. [] Fire

Elec. Plans Approved

Approved by:

UBCODE APPROVAL:

CO () CO () CA

ate: 2-5-97

Approved by:

Line Dept.

INSPECTIONS:

Type:

Rough

Temporary

Constr. Serv.

TCOD

Other

Service

Final

Temp. Cut-in-Card Date Issued

Final Cut-in-Card Date Issued

Dates (Month/Day)

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

Failure Failure Approval Initial

D. TECHNICAL SITE DATA

NO. SIZE

125

25

217

ITEM

Fixtures (1)

Receptacles (2)

Switches (3)

Total 1 + 2 + 3

Range

Oven(s)

Surface Unit

Dishwasher

Garbage Disposal

Dryer

A/C Unit

Burglar Alarms

Intercoms Panels

Smoke Detectors

Whirlpool/spa

Pool Bonding

Pool Filter Motor

Pool Lights

Water Heater(s)

Central heat:

oil, gas or elec.

Baseboard Heat Units

Thermostats

Heat Pump

Pump(s)

225A

100A

Light Standards

Motors—Fractional H.P.

Motors—All Others

Transformers

Generators

Service Entrance

Other

Administrative Surcharge


Minimum Fee

Collected by:

U.C.C. Form F-120A

1 White=Inspector Copy
2 Canary=Office Copy
3 Pink=Office Copy
4 Gold=Applicant Copy

pd. by owner



528400 JUL

MIDDLE DEPARTMENT INSPECTION AGENCY

9th 2nd Pipe Group with Walker, Bokes,
12-27-91 per Reinspect 12-30-91 #1427
12-30-91 LMS CORNERS MISSING ON ALL FLUORESCENT FIXTURES IN CLASS ROOM #1427



FIRE PROTECTION SUBCODE TECHNICAL SECTION



Date Received
Date Issued 1/8/92
Control #
Permit # 1439-91

A. IDENTIFICATION—APPLICANT: COMPLETE ALL APPLICABLE INFORMATION, WHEN CHANGING CONTRACTORS, NOTIFY THIS OFFICE. CALL UTILITY DIG NO. 1-800-272-1000.

Block 1091 Lot 517
Work Site Location 248 + 17th St
Owner in Fee St. Dominic Church
Address St. Dominic Church
Tele. () 870-1410
Contractor Liberal & Sons
Address 235 Drew St
Tele. () 870-6611
Lic. No. 8414
Federal Emp. No. 222 209 329 or Social Security No. _____

B. FIRE PROTECTION CHARACTERISTICS

Use Group Present A-4 Proposed _____
Constr. Class. Present _____ Proposed _____
Heating Systems [] New [] Existing
Type: [] Gas [] Oil [] Electrical [] Solar
[] Other _____
Location: _____
Total Est. Cost of Fire Prot. Work \$ 1500 [] Other _____

JOB SUMMARY (Office Use Only)

PLAN REVIEW:	INSPECTIONS:	Dates (Month/Day)
[] No Plans Required	Type:	Failure Failure Approval Initial
[] Bidg. [] Plumb. [] Elec.	Suppression Test	
[] Fire Plans Approved	Fire Alarm Test	
Date: <u>1-8-92</u>	Smoke Test	
Approved by: <u>[Signature]</u>	Mechanical	
SUBCODE APPROVAL	TCO	
[] CO [] CCO [] CA	Other <u>Fire Alarm</u>	
Date: <u>1-8-92</u>	Other	
Approved by: <u>[Signature]</u>	Other	

C. CERTIFICATION IN LIEU OF OATH

I hereby certify that I am the (agent of) owner of record and am authorized to make this application.

[Signature]
SIGNATURE

D. TECHNICAL SITE DATA

Description of Work
Water Supply Source
Method of Valve Supervision
Local Alarm Supervision
Central Supervision
Proprietary Supervision

Flammable Liquid Storage Tanks
Combustible Liquid Storage Tanks
L.P.G. Storage Tanks
L.N.G. Storage Tanks

() Capacity _____ Fuel _____
() Capacity _____ Fuel _____
() Capacity _____ Fuel _____
() Capacity _____ Fuel _____

Wet Sprinkler Heads
Dry Sprinkler Heads
TOTAL

Smoke Detectors
Heat Detectors
TOTAL

Stand Pipes
Kitchen Hood Exhaust Systems

Pre-Engineered Systems

CO₂ Suppression
Halon Suppression
Foam Suppression
Dry Chemical
Wet Chemical


Gas or Oil Fired Appliance
OTHER FIRE ALARM

Paid [] Check # _____ Minimum Fee \$ _____
Collected by _____ TOTAL FEE \$ 20

FEE (Office Use Only)

Number _____

Brick Township



FIRE PROTECTION
SUBCODE
TECHNICAL SECTION

A. IDENTIFICATION—APPLICANT: COMPLETE ALL APPLICABLE INFORMATION WHEN CHANGING CONTRACTORS. NOTIFY THIS OFFICE. CALL UTILITY DIG NO. 1-800-272-1000.



Date Received
Date Issued 7-31-91
Control #
Permit # 1439-91

Block 1091 Lot 5

Work Site Location 016 Squan Road, Van Zile Road

Owner in Fee Church of St. Dominick

Address 250 016 Squan Road

Telephone (502) 840-1410

Contractor Sodon's Electric, Inc.

Address P.O. Box 408

Telephone (302) 291-1713

Lic. No. 1500 A

Federal Emp. No. 222401655 or Social Security No. 1091 511

B. FIRE PROTECTION CHARACTERISTICS

Use Group Present Proposed Test on 10/31/91

Constr. Class. Present Proposed Test on 10/31/91

Heating Systems Existing

Type Gas Oil Electrical Solar

Location: Other

Total Est. Cost of Fire Prot. Work \$ 3,900.00

JOB SUMMARY (Office Use Only)

PLAN REVIEW:

☐ No Plans Required

Joint Plan Review Required:

☐ Bidg. ☐ Plumb. ☐ Elec.

☐ Fire Plans Approved

Date: 7/15/91

Approved by: [Signature]

SUBCODE APPROVAL: Q1

Date: 1-14-92

Approved by: [Signature]

INSPECTIONS:

Type: Smoke Test

Failure Failure Approval Initial

Dates (Month/Day)

Suppression Test 12-30-91

Fire Alarm Test 12-30-91

Smoke Test 1-14-92

Mechanical 1-14-92

TOC 1-14-92

Other 1-14-92

Other 1-14-92

Other 1-14-92

5201

D. TECHNICAL SITE DATA

Description of Work New Bldg.

Water Supply Source

Method of Valve Supervision

Local Alarm Supervision

Central Supervision

Proprietary Supervision

Flammable/Liquid Storage Tanks

Combustible Liquid Storage Tanks

L.P.G. Storage Tanks

L.N.G. Storage Tanks

Wet Sprinkler Heads

Dry Sprinkler Heads

TOTAL

Alarm Strobes

Smoke Detectors

Heat Detectors

TOTAL

Emergency Lights

Stand Pipes

Kitchen Hood Exhaust Systems

Exit Lights

Pre-Engineered Systems

CO₂ Suppression

Halon Suppression

Foam Suppression

Dry Chemical

Wet Chemical

Manual Pull Stations

Gas or Oil Fired Appliance

OTHER 1000

Number

3

25

25

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

5

FEE (Office Use Only)

134-

roughing for two extra toilets
01/16/31-91



PLUMBING
SUBCODE
TECHNICAL SECTION



Date Received
Date Issued 7-31-91
Control #
Permit # 1439-91

A. IDENTIFICATION—APPLICANT: COMPLETE ALL APPLICABLE INFORMATION. WHEN CHANGING CONTRACTORS, NOTIFY THIS OFFICE. CALL UTILITY DIG NO: 1-800-272-1000.

Block 1091 Lot 5
Work Site Location Old Squan Road & Van Zile Road
Brick Township, NJ
Owner in Fee Church of St. Dominic
Address 250 Old Squan Road
Brick Town, NJ 08724
Tele. (908) 840-1410
Contractor J.A. Christman Inc.
Address P.O. Box 2037 Red Bank N.J.
07701
Tele. (908) 842-6671
Lic. No. 5896
Federal Emp. No. 222204970 or Social Security No.

B. PLUMBING CHARACTERISTICS

Use Group Present E Proposed E
Building Sewer Size (2) Water
Water Service Size
Estimated Cost of Plumbing Work \$

JOB SUMMARY (Office Use Only)

PLAN REVIEW:		INSPECTIONS:		Dates (Month/Day)	
	Type:	Failure	Approval	Initial	
☐ No Plans Required	Slab				
☐ Joint Plan Review Required:	Rough				
☐ Bldg. ☐ Elec. ☐ Fire	Water				
☒ Plumb. Plans Approved	Sewer				
Date: 7/2/91	Fixtures				
Approved by: [Signature]	Gas Equipment				
	Gas Final				
	Solar				
	TCO				
SUBCODE APPROVAL:					
☒ CO ☐ CCO ☐ CA					
Approved by: [Signature]					
Date: 7-10-92					

C. CERTIFICATION IN LIEU OF OATH

I hereby certify that I am the (agent of) owner of record and am authorized to make this application and perform the work listed on this application.

☒ Licensed Plumbing Contractor ☐ Exempt Applicant

[Signature]
Signature-Contractor Seal


D. TECHNICAL SITE DATA (List all fixtures.)

NO.	FIXTURE/EQUIPMENT	FEE (Office Use Only)
8	Water Closet	40.00
4	Urinal/Bidet	20.
4	Bath Tub	20.-
4	Lavatory	10.-
2	Shower	65.-
13	Floor Drain	5
1	Sink	10.-
2	Dishwasher	
	Drinking Fountain	
	Washing Machine	
	Hose Bibb	
	Gas Piping	
	Fuel Oil Piping	
	Water Heater	
	Steam Boiler	
	Hot Water Boiler	
	Sewer Pump	
	Interceptor/Separator	
	Backflow Preventer	
	Greasetrapp	
1	Water Cooled AC or Refrigeration Unit	5
	Sewer Connection	
	Water Service Connection	
	Gas Service Connection	
	Active Solar System	
	Other	

Administrative Surcharge \$ 185-

Paid ☐ Check # Minimum Fee \$

Collected by: TOTAL \$



Township of Brick

401 Chambers Bridge Road, Brick, N.J. 08723 (201) 477-3000

Office of
Division of Inspections

UNIFORM CONSTRUCTION CODE

Chapter 23, Title 5

Approval of Part
5.23-2.16 (g)

OWNER/AGENT St. Dominic Church
ADDRESS Old Squary Road
TOWN Brick Township ZIP
BLOCK 1094 LOT 527

☒ FOOTING

☒ FOUNDATION

☐ OTHER

only 7/8/91

OWNER/AGENT PROCEED AT OWN RISK ☐

OWNER/AGENT *Carly...*

BUILDING SUB-CODE OFFICIAL *Ray...*

CONSTRUCTION OFFICIAL *Arthur...*

7/8/91



Township of Brick

401 Chambers Bridge Road, Brick, N.J. 08723 (201) 477-3000

Office of
Division of Inspections

Date: July 8, 1991

Subject: St. Dominic School

Block 1091 Lot 5 & 7

AFFIDAVIT:

I Charles G. Sarmonte hereby request a temporary building permit to proceed with construction of footings and foundation (only) on the subject property at my own risk. I understand and acknowledge that the issuance of the full building permit is subject to further approvals as normally required. I understand that adjustments in the foundation and first floor elevation may be necessary in order to comply with the approved plot plan grading. The below department approvals are required prior to issuance of a temporary building permit.

[Signature]
Applicant

7/8/91
Date

[Signature] 7/8/91
Twp. Engineer or Ass't. Engineer Date

[Signature] 7/8/91
Zoning Officer Date
Zoning Department

[Signature] 7/8/91
Building Inspector Date
Building Department

Charles G. Surmonte A.I.A.

1166 Deal Road Ocean, NJ 07712 908-493-3251



July 2, 1991

Art Cierzo
Construction Official
Brick Township Municipal Building
Brick Township, N.J.


Re: Addition to St. Dominic School
Brick Township, N.J.

Dear Mr. Cierzo:

Confirming your telephone conversation with my Mechanical Engineer, Philip Eager, P.E. The actual anticipated population of the addition is thirty students per classroom x 5 equals 150 students total (75 boys + 75 girls). The fixtures provided in the girls and boys rooms (exclusive of the Kindergarten toilets) accommodate 100 boys and 100 girls.

Please advise us if you have any further questions regarding this matter.

Very truly yours,

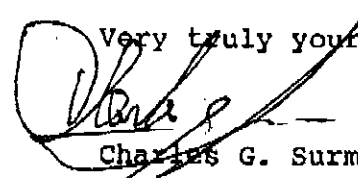

Charles G. Surmonte

CGS:bas

Copy to: Phil Eager
Father Gibbons

Please note our new address:
OCEAN SOIL CONSERVATION DISTRICT
714 Lacey Road
Forked River, NJ 08731
Telephone: 609-971-7002

Forked River, NJ 08754

RECEIVED

APR 20 1992

DIV. OF INSPECTION

REPORT OF COMPLIANCE

TO: CONSTRUCTION CODE OFFICIAL MUNICIPALITY: BRICK

PROJECT: ST. DOMINIC SCHOOL ADDITION SCD NO.: 4279

BLOCK NO.(s) 10 91 LOT NO.(s) 5 & 7

Complete Compliance ☒ Temporary Compliance ☐

BLOCK NO.	LOT NO.	CONDITIONS
		APPLICANT RESPONSIBLE FOR COMPLETE GERMINATION OF ALL SEEDED AREAS.
		Total Fees Due: \$ <u> </u>


This verifies that the soil erosion and sediment control measures for the above designated block and lot numbers are in compliance to the extent indicated above with the soil erosion and sediment control plan as certified by the Ocean County Soil Conservation District and required by Chapter 251, P.L. 1975 as amended, the Soil Erosion and Sediment Control Act. (N.J.S.A. 4:24-39 et. seq.)

AGENT RESPONSIBLE FOR PROJECT: _____

AUTHORIZED DISTRICT SIGNATURE: [Signature]

Date: 4/15/92


Distribution: White-Township Canary-Applicant Pink-District

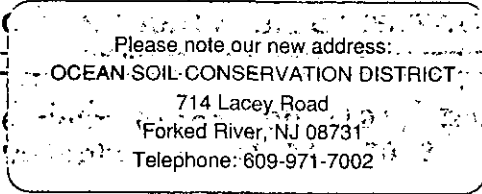

Please note our new address:
OCEAN SOIL CONSERVATION DISTRICT
714 Lacey Road
Forked River, NJ 08754
Telephone: 609-971-7002

Charles G. Surmonte A.I.A.

1166 Deal Road Ocean, NJ 07712 908-493-3251



July 18, 1991

Construction Official
Township of Brick
Brick Township Municipal Bldg.
Brick Township, N.J.

Attn: Building Subcode Official


Re: St. Dominic School
Brick Township, N.J.

Dear Sir:

In accordance with our conversation of July 16, 1991 a posted Fire Access Lane will be created between the south end of the new school building and the existing garage. This Fire Access Lane will be constructed of a 6 inch thick layer of 1½" trap rock or quarry process stone, over which 4 inches of topsoil and lawn will be placed. The lane will be posted with two signs (12" x 18") which read "No Parking - Fire Lane" (see McSweeney & Drewes drawings 2 of 4).

Please advise me if I can be of further assistance in this matter.

Very truly yours,

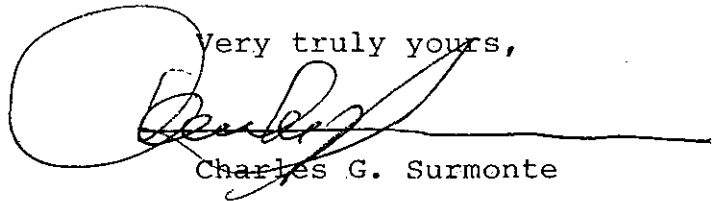


Charles G. Surmonte

CGS:bas

Copy to: Woodward Const. Co.
Father Gibbons

Charles G. Surmonte A.I.A.

1166 Deal Road Ocean, NJ 07712 908-493-3251



July 8, 1991

Construction Official
Township of Brick
Brick Township Municipal Building
Brick Township, N.J.

Attn: Building Subcode Official


Re: St. Dominic School
Brick Township, N.J.

Dear Sir:

As per our discussion I am enclosing three sets of signed and sealed drawings for the above referenced project. Please note that there is an 8 inch thick (2 hour) masonry fire wall to be constructed between the original school building and the new classroom building which is the subject of the enclosed drawings. This complies to BOCA Table 905.2 and Table 907.1 and in my opinion the new classroom building is a separate building.

Please advise me if you have any further questions regarding this matter.

Very truly yours,

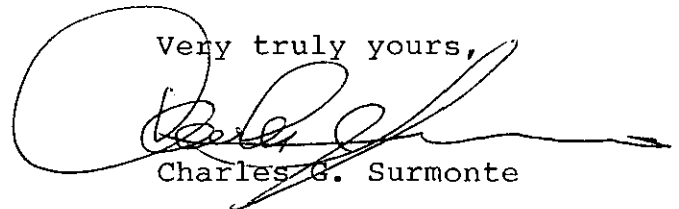

Charles G. Surmonte

CGS:bas

Enc.

INSPECTOR:

GEORGE RIVA

DATE:

12/13/91

JOB:

ST. DOMINICK CHURCH

SECTION:

I

TYPE OF WORK:

FINAL ENGINEERING

WEATHER:

FAIR

LOCATION:

SQUAN RD.

TEMPERATURE:

46°

BLOCK:

LOT:

ENGINEERING RECOMMENDATIONS FOR CERTIFICATE OF OCCUPANCY INSPECTION CHECK LIST

ITEMS TO BE COMPLETED	COMPLETED	DEFICIENT
1. Driveway	✓	
2. Grading	✓	
3. Sidewalk	✓	
4. Road Pavement	✓	
5. Landscaping & Sodding	✓	
6. Clean-up Procedures	✓	
7. Note on going construction in immediate area	✓	
8. Safety	OK	

COMMENTS REFERENCING ITEM NUMBER:

RECOMMENDATIONS:

☐ TEMP. C.O.☒ FINAL C.O.☐ DETAILED REINSPECTION☐ HOLD INSPECTION UNTIL LOT ELEVATION FIELD VERIFIED

PLANNING BOARD ENGINEER


H. W. D. J.

MUNICIPAL ENGINEER

I _____, Authorized representative of _____, hereby acknowledge the above deficiencies, and further realize that the Certificate of Occupancy will be conditioned upon the acceptable resolution thereof within _____ days of the issuance of Certificate of Occupancy.

Charles G. Surmonte A.I.A.

1166 Deal Road Ocean, NJ 07712 908-493-3251



July 18, 1991

Construction Official
Township of Brick
Brick Township Municipal Bldg.
Brick Township, N.J.

Attn: Building Subcode Official


Re: St. Dominic School
Brick Township, N.J.

Dear Sir:

In accordance with our conversation of July 16, 1991 a posted Fire Access Lane will be created between the south end of the new school building and the existing garage. This Fire Access Lane will be constructed of a 6 inch thick layer of 1 1/2" trap rock or quarry process stone, over which 4 inches of topsoil and lawn will be placed. The lane will be posted with two signs (12" x 18") which read "No Parking - Fire Lane" (see McSweeney & Drewes drawings 2 of 4).

Please advise me if I can be of further assistance in this matter.

Very truly yours,

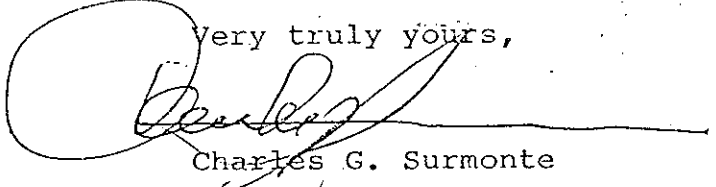
Charles G. Surmonte

CGS:bas

Copy to: Woodward Const. Co.
Father Gibbons

SIZING FOR WATER AND SEWER SERVICES

Property Owner

St Dominic

Date

7/2/91

Property Address

250 Old Spum Rd

Block

1091/B

Lot

5

Zoning

Use Group

Contractor

Chotman

License No. Registration

3896

Water Main Size

Water Pressure

Sewer Main Size

Plumbing Fixtures	Number	(sfu) Water Units	(dfu) Drainage Units
1. Water Closet	<u>8</u>	<u>(10)</u> <u>80</u>	<u>(10)</u> <u>80</u>
2. Lavatory	<u>17</u>	<u>(2)</u> <u>34</u>	<u>()</u> <u>34</u>
3. Bath Tub	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
4. Shower Stall	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
5. Kitchen Sink	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
6. Service Sink	<u>1</u>	<u>(3)</u> <u>3</u>	<u>()</u> <u>3</u>
7. Laundry Tray	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
8. Dishwasher	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
9. Washing Machine	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
10. Urinal	<u>4</u>	<u>()</u> <u>20</u>	<u>()</u> <u>20</u>
11. Floor Drain	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
12. Drinking Fountain	<u>1</u>	<u>()</u> <u>1/2</u>	<u>()</u> <u>1/2</u>
13. Air Conditioner (water cooled)	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
14. Dental Unit	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
15. Lawn Sprinkler No. of Heads	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
16. Fire Sprinkler No. of Heads	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
17. <u> </u>	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>
18. <u> </u>	<u> </u>	<u>()</u> <u> </u>	<u>()</u> <u> </u>

Total

137 1/2

137

Gallons per minute

51'

Size of Service

1 1/2"

Date:

Approved:

Arthur [Signature]

Brick Township Plumbing Inspector



**QUIKIE PRINT
& COPY SHOPS**

FAX TRANSMITTAL SHEET

DATE:

7/2/91

TO:

Construction Official

Brick Township

ATTN:

Art Cierzo

RE:

St. Dominic School

Number of pages including this confirmation:

2

COMMENTS:

FROM:

Charles G. Surmonte

QUIKIE PRINT & COPY SHOPS

CAILED
Pect. 7/2/91

Daniel F. Newman, Mayor

Members of Township Council

Mary Anne L. Butler, Council President

Charles E. Anderson

Patrick L. Bottazzi

Edmund H. Hibbard

Joseph C. Scarpelli

Warren H. Wolf

David W. Wolfe

TOWNSHIP OF BRICK

OCEAN COUNTY, NEW JERSEY

401 CHAMBERS BRIDGE ROAD, BRICK, N.J. 08723



Division of Inspection

A.J. Cierzo,
Construction Official

(201) 477-3000, ext.

ST. DOMINIC
CHURCH

CHECK LIST

RE: Block 1091 Lot 5 Address OLD SQUAN RD.

Please be advised that your application for a construction permit for the subject property has been rejected due to deficiencies in the following areas:

Administrative

Zoning

Engineering

Building

Plumbing

Electric

Fire

pgt 505.2 - CONST TYPE of
EXISTING

pg II | Building DATA

501 TABLE INCLUDES ENTIRE
BUILDING

THIS ADDITION I FALL SHOULD

BE CALCULATED WITH ENTIRE BUILD

See attached review check list(s) for details as to the reason your submission has been rejected. Please revise your application accordingly and resubmit to this office.

There is a 20 working day time limit for review of all documents submitted with a construction permit application. This time limit ceases in the event of a rejection of any type, and starts over again when the rejection(s) have been corrected and the application resubmitted.

Arthur J. Cierzo,
Construction Official

Date



OCEAN COUNTY SOIL CONSERVATION DISTRICT

714 Lacey Road
Forked River, NJ 08731 609.971.7002

NJ 08754

RECEIVED

JAN 24 1992

DIV. OF INSPECTION

REPORT OF COMPLIANCE

TO: CONSTRUCTION CODE OFFICIAL MUNICIPALITY: BRICKPROJECT: St. DOMINIC'S School Addition SCD NO.: 4279BLOCK NO.(s) 1091 LOT NO.(s) 5 & 7Complete Compliance ☐Temporary Compliance ☒

BLOCK NO.	LOT NO.	CONDITIONS
		This TEMPORARY compliance expires on APRIL 30, 1992. The applicant is required to notify this office when work is properly completed. A \$55.00 re-inspection fee will be billed to the applicant for each day required work is not properly completed. NO COMPLIANCES will be issued after APRIL 24, 1992, until ALL temporary compliances have met permanent stabilization requirements. Total Fees Due: \$ <u>55.-</u>

This verifies that the soil erosion and sediment control measures for the above designated block and lot numbers are in compliance to the extent indicated above with the soil erosion and sediment control plan as certified by the Ocean County Soil Conservation District and required by Chapter 251, P.L. 1975 as amended, the Soil Erosion and Sediment Control Act. (N.J.S.A. 4:24-39 et. seq.)

AGENT RESPONSIBLE FOR PROJECT: _____

AUTHORIZED DISTRICT SIGNATURE: M. J. [Signature]Date: 1/29/92

Distribution: White-Township Canary-Applicant Pink-District

A4687

TOWNSHIP OF BRICK

OCEAN COUNTY, NEW JERSEY

401 CHAMBERS BRIDGE ROAD, BRICK, N.J. 08723

Daniel F. Newman, Mayor

Members of Township Council

Mary Anne L. Butler, Council President

Charles E. Anderson

Patrick L. Bottazzi

Edmund H. Hibbard

Joseph C. Scarpelli

Warren H. Wolf

David W. Wolfe



Division:

Const

(201) 41

St. Dominic School

CHECK LIST

RE: Block 1091

Lot 5

Address Von Zile Rd

Please be advised that your application for a construction for the subject property has been rejected due to deficiency the following areas:

Administrative

Zoning

Engineering

Building

Plumbing

Electric

Fire

FIRE - LANE REMOVED

Fire Lane Removal

See attached review check list(s) for details as to the reason your submission has been rejected. Please revise your application accordingly and resubmit to this office.

There is a 20 working day time limit for review of all documents submitted with a construction permit application. This time ceases in the event of a rejection of any type, and starts again when the rejection(s) have been corrected and the application resubmitted.

Arthur J. Cierzo,
Construction Officer

Date

INSPECTOR: *T. OR / 11 12 1*

JOB: *5 Denmark* SECTION: *Chart*

WEATHER: Fair

TEMPERATURE: 46°

DATE: 11/15/11

TYPE OF WORK: *1. 22*

LOCATION: *7-10* *52*

BLOCK: LOT:

LOT:

ENGINEERING RECOMMENDATIONS FOR CERTIFICATE OF OCCUPANCY INSPECTION CHECK LIST

ITEMS TO BE COMPLETED	COMPLETED	DEFICIENT
1. Driveway	✓	
2. Grading	✓	
3. Sidewalk	✓	
4. Road Pavement	✓	
5. Landscaping & Sodding	✓	
6. Clean-up Procedures	✓	
7. Note on going construction in immediate area	✓	
8. Safety	✓	

COMMENTS REFERENCING ITEM NUMBER:

RECOMMENDATIONS:

☐ TEMP. C.O.

☒ FINAL C.O.☐ DETAILED REINSPECTION☐ HOLD INSPECTION UNTIL LOT ELEVATION FIELD VERIFIED

PLANNING BOARD ENGINEER

MUNICIPAL ENGINEER

I, _____, Authorized representative of _____, hereby acknowledge the above deficiencies, and further realize that the Certificate of Occupancy will be conditioned upon the acceptable resolution thereof within _____ days of the issuance of Certificate of Occupancy.

FIRE WATCH XVI CONTROL PANEL

FEATURES:

- Listed for Power Limited Applications
- Field Expandable
- Full Class "A" Capability
- 8, 12 or 16 Zone Formats
- Ground Fault Monitoring
- Field Selectable City Tie
- Supervised Zone Alarm Annunciation
- Auxiliary Zone Alarm Contacts
- Subsequent Alarm
- Auxiliary Alarm Contact
- Auxiliary Trouble Contact
- Waterflow Capability
- 2- or 4-Wire Smoke Detector Capability
- Brown Out Protection
- Built-in Battery Charger
- Battery Supervision
- Meets NFPA 72A, B, C
- UL Listed File S405
- California State Fire Marshal Listed File 7165-065: 109, 111, 112
- BSA Approved - Calendar Number 524-77-SA

DESCRIPTION:

Versatile, reliable and loaded with features. The Fire Watch XVI Control is a field expandable 8-zone control panel designed to meet most intermediate fire alarm system requirements. Additional four zone modules allow for expansion of the basic panel to either 12-zone or 16-zone configurations.


The internally current limited, supervised 2-wire or 4-wire Class "B" initiating circuits include individual zone alarm and zone trouble indicators, form "A" auxiliary alarm contacts as well as a current limited supervised remote annunciator output. Field conversion of the initiating circuits to 4-wire Class "A" operation is accomplished by adding the appropriate number of 7839 Class "A" adapter kits. A special sprinkler zone is included for connection to waterflow switches. The sprinkler circuit includes a sprinkler alarm LED indicator and is not affected by the alarm silence switch per NFPA criteria.

Parallel connected 21 to 28 Volt D.C. polarized bells, horns, strobes or lights may be connected to the alarm indicating circuit. The signals can be interconnected in either one 2-wire Class "B" circuit, two 2-wire Class "B" circuits, or one 4-wire Class "A" circuit format.

Standard functions include a field selectable city tie capable of either local energy or lease line transmission and a positive or negative D.C. ground fault detection circuit. The power supply section includes a 2.5 amp 24VDC supply, an integral battery charger, and an AC sensing circuit which monitors for low AC input voltage as well as the total loss of the 120VAC 60 Hertz source. The FIRE WATCH XVI CONTROL meets all of the requirements for power limited circuits as defined by Article 760, Section C of the National Electric Code and is UL listed for such applications per UL Standard 864.

Common system alarm contacts, common system trouble contact, a complete system trouble circuit with audible signal, LED trouble indicator and trouble silence switch are included with the panel. Additional switches are provided for system reset, city disconnect and alarm silence. The alarm silence switch includes a subsequent alarm function which allows for alarm signal resound if any zone actuates an alarm after the signals have been silenced. LED indicators are provided for power on, system trouble, city cutoff and ground on system conditions.

Standby operation with full supervision can be maintained for 60 hours followed by 5 minutes of alarm with the recommended bat-

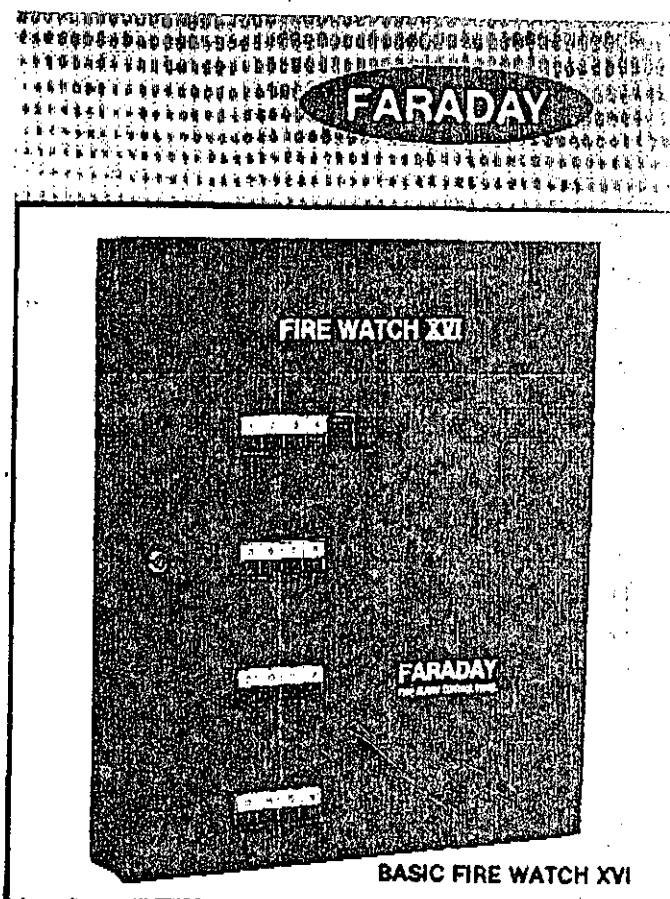

OPTIONS

- 15014 **Four-Zone Adder**
Allows field expansion of 8 or 12 zone panels by 4 zones to 16 zones total.
- 7839 **Class "A" Adapter**
Allows field conversion of 4-wire Class "B" initiating circuits to 4-wire Class "A" operation. One 7839 is required for each zone of detection.
- 401180 **Meter Option**
Provides battery voltmeter and battery charge current meter. The option is field installed and does not reduce the panel's zone capacity.
- 401181 **Meter Option**
Provides battery voltmeter and circuit supervisory current ammeter. The option is field installed and does not reduce the panel's zone capacity.
- 401087 **Battery Supervision Module**
Monitors not only the wiring to the battery set, but also the batteries ability to supply a load.
- 401095 **California Coder Module**
Field installed option. The module provides either a 10 second steady output followed by five seconds of silence, or a pulsed output for 10 seconds followed by five seconds of silence. Both formats are repeated until either the signals are silenced or the panel is reset.
- 401097 **March Time Beat Module**
Field installed module which provides a 60 beat per minute pulsed output on the signal circuit.
- 15010 **Semi-Flush Kit**
Trim kit which allows semi-flush mounting of the control panel enclosure. Door assembly protrudes 1 inch from wall.
- 14044 **Battery Set**
15 amp-hour sealed battery set, gel type, capable of providing 60 hours of standby operation followed by 5 minutes of full alarm output.
- (T) **Special Cabinet**
Includes door with lexan insert and anodized, brushed aluminum trim. Finish is black spartex.

SUPERVISION

All initiating circuits, zone alarm annunciator circuits, and alarm indicating circuits are electrically supervised for the presence of open circuit and D.C. ground fault wiring conditions. In addition the signal circuit is also supervised to detect short circuit wiring faults. Detection of a short circuit will activate an inhibit circuit which prevents signal circuit activation and possible damage to the control panel. Field wiring to 4-wire or 6-wire smoke detectors as well as the city tie is constantly monitored for ground fault conditions. Local energy city tie interconnections are also supervised for open circuit wiring disarrangements.

The 120 Volt, 60 Hertz input is monitored not only for low voltage input but also for the total loss of the power input. Automatic transfer to the standby battery will occur whenever the AC input voltage drops to a level below 102 Volts. The recommended standby battery will continue to power the system for up to 60 hours. Automatic return to the AC source will occur only when the input voltage returns to at least 108 Volts.

An optional supervision module is available to monitor the standby battery source. The unique design not only monitors the wiring to the battery set but also periodically tests the battery sets capability to supply a load.

Any supervisory fault condition or power fault will automatically activate the system trouble circuit, transfer the form "C" auxiliary trouble contact, flash the system trouble LED, and pulse the audible trouble sonalert. The audible sonalert may be silenced by operation of the trouble silence switch. The system trouble LED will continue to flash. Restoration of the fault condition will cause the audible buzzer to resound at a steady rate until the silence switch is returned to its normal position.

NOTE: A supervisory fault will not cause a false alarm.

TECHNICAL DATA

Input Power: 120VAC, 60 Hz, 2.0 Amp. Max.
Signal Output Power: 24VDC, 2.5 Amp. Max. Continuous
4-Wire Smoke Power: 0.080 Amp. Standby;
 0.250 Amp. Alarm

Panel Battery Standby Power
 — 8 Zone: 0.16 Amp.
 — 12 Zone: 0.197 Amp.
 — 16 Zone: 0.235 Amp.

Initiating Circuit Data:
 — Alarm Threshold: 0.014 Amp.
 — Max. Short Circuit Current: 0.087 Amp.
 — Annunciator Output: 0.040 Amp.

Maximum Loop Resistance:
 — Initiating Circuit: 100 Ohms
 — Signal Circuit: 10 Ohms Max.,
 5 Ohms Recommended.

Contact Rating:
 — Alarm Relay: Form "C"; 5 Amp, 28VDC resistive
 — Trouble Relay: Form "C"; 1 Amp, 28VDC resistive
 — Zone Alarm: Form "A"; 1 Amp, 28VDC resistive


Indicators: All LED type
 — Zone Alarm: Red
 — Zone Trouble: Amber
 — Sprinkler Alarm: Red
 — Power On: Green
 — System Trouble: Amber
 — City Cutoff: Amber
 — Ground on System: Amber

Switches:
 — System Reset
 — Alarm Silence
 — City Cutoff
 — Trouble Silence

Cabinet:
 — Size: 26" high x 22" wide x 3-9/16" deep
 — Material: 16 Gage CRS, bonderized and painted
 — Backbox: 16 Gage CRS, bonderized and painted
 — Door: 16 Gage CRS, bonderized and painted

Ordering Information:
 8-Zone Panel: 15108 (T)
 12-Zone Panel: 15112 (T)
 16-Zone Panel: 15116 (T)

Add suffix "T" if Aluminum Trim and Lexan Insert Door is required.

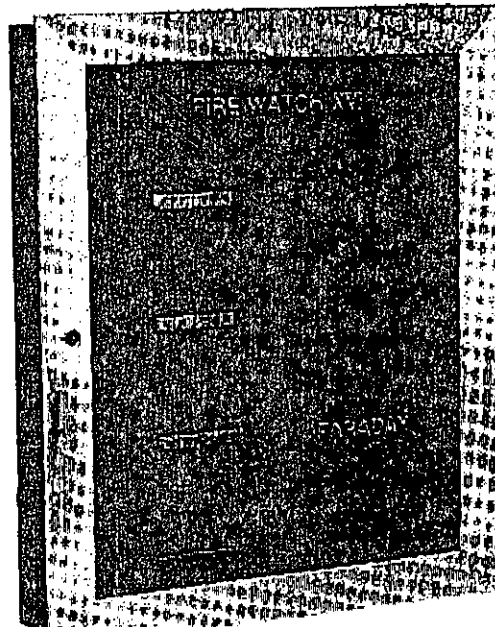

**FIRE WATCH XVI WITH
 OPTIONAL TRIM AND LEXAN INSERT**

SAMPLE SPECIFICATIONS

5.0 CONTROL PANEL

5.1 Furnish and install where indicated on the plans a complete, non-code, supervised multi-zone fire alarm detection and signaling panel. The control panel shall be of dead front construction, housed in an all metal cabinet with all function switches mounted behind a key locked door. Furnish a complete owner's manual with installation guide, programming instructions, operating instructions, basic hook-up diagram and trouble shooting guide with the control panel. The control panel shall include all of the following functions:

A. A total of **specify (8, 12, 16)** internally current limited initiating circuits capable of operation with normally open contact devices. In addition, the circuits shall be capable of supplying power for standby and alarm operation of system smoke detectors. Each circuit shall include a red alarm LED indicator, an amber zone trouble indicator, a set of normally open alarm contacts rated at 1 amp at 28VDC resistive and a supervised current limited alarm annunciator output.

B. The capability of connecting either waterflow detection devices or waterflow supervisory switches to a separate supervised circuit. If waterflow switches are connected to this circuit, an alarm activation shall light the common alarm indicator. If waterflow supervisory switches are connected to this circuit, operation of the supervisory switch shall flash the common system LED and pulse the common system trouble buzzer.

C. One signal circuit designed for connection to polarized 21 to 28VDC parallel connected audible or visual alarm indicating devices. Provide **specify (one 2-wire Class "B" circuit; two 2-wire Class "B" circuits; one 4-wire Class "A" circuit).**

D. A positive or negative DC ground fault detection circuit which monitors all field wiring for ground fault or near ground fault wiring conditions.

E. A set of single pole double throw (SPDT) auxiliary alarm contacts rated at 5 amps at 28VDC resistive.

PICK ONE OF THE FOLLOWING:

F.1A field programmable current limited city tie circuit capable of operation over leased telephone lines. The circuitry shall be capable of transmitting not only an alarm condition, but also a system trouble condition. Output current for standby and alarm operation shall be field adjustable to insure proper interface to the receiving circuit.

F.2 A field selectable local energy city tie. The circuit shall be internally current limited and supervise all wiring to the municipal box. Circuits which operate from dry contacts will not be acceptable.

5.2 Power Supply

Provide as part of the control panel a full wave rectified 24VDC power supply with a continuous output rating of 2.5 amperes. The power supply shall derive its operating power from a 120V 60 Hz source. Include as part of the power supply section a fully automatic battery charger capable of recharging a fully discharged battery set in less than 48 hours. All power supply circuiting and standby power circuiting shall be so arranged to allow for the use of limited energy cable. All field wiring including the initiating, signal, city tie and smoke detector power circuits shall meet all of the requirements for power limited circuits as outlined in Article 760 Section C of the National Electric Code. The control panel shall be UL listed for power limited applications and suitably marked and labeled as outlined in UL Standard 864.

5.3 Standby Battery

Furnish and install in the fire alarm panel cabinet a 24VDC sealed lead acid or gel type battery set. The batteries provided shall have sufficient capacity to maintain the system for 60 hours of standby operation and 5 minutes of alarm at the full power supply output capability of 2.5 amperes.

The battery set shall have been tested by UL with the control panel and recharging circuit to insure that the standby and alarm cycle drain as well as the recharge requirements specified are met completely.

The system shall automatically changeover to the standby battery whenever the AC input voltage drops below 102VAC. The battery shall continue to power the system until the AC input voltage returns to at least 108VAC. If this changeover sequence occurs while the system is in alarm, system reset shall not occur.

5.4 Function Switches and Indicators

Provide panel mounted switches for the following functions:

- A. **System Reset:** shall restore the entire system including all panel circuitry and system smoke detectors to a normal standby operating condition. Two stage system reset shall not be permissible.
- B. **Signal Silence:** shall silence all audible signaling devices. Provisions shall be included for subsequent signal operation should addition zones initiate alarm conditions. At no time shall it be possible to silence signals if the designated waterflow switch zone initiates an alarm.
- C. **City Tie Disconnect:** shall prevent the transmission of an alarm condition over the municipal circuit.
- D. **Trouble Silence Switch:** shall silence only the audible system trouble device.

Provide the following LED type status indicators on the control panel.

- A. **Power On:** green LED to indicate the presence of the 120V 60 Hz source.
- B. **System Trouble:** amber LED to flash whenever any supervisory fault is present on the system.
- C. **City Tie Cutoff:** amber LED to operate whenever the city tie circuitry has been isolated by operation of the city cutoff switch.
- D. **Ground on System:** amber LED to activate whenever a D.C. ground fault condition occurs anywhere on the system.
- E. **Zone Alarm and Trouble:** provide individual red zone alarm and amber zone trouble LED indicators for each of the 4 initiating circuits.
- F. **Sprinkler Zone Alarm:** provide a red alarm LED indicator for the designated waterflow switch initiating circuit.

5.5 System Supervision

The control panel shall provide for supervision of the following conditions. Detection of any of these fault conditions shall activate the system trouble circuitry.

- A. An open circuit or ground fault on the initiating circuits or initiating circuit annunciator output.
- B. An open circuit, short circuit or ground fault on the signal circuit. In addition detection of a short circuit shall prevent the operation of the signal circuit.
- C. Detection of a positive or negative D.C. ground fault condition on any system field wiring.
- D. A drop in the 120V 60 Hz input voltage to a point less than 102 volts.
- E. A total loss of the AC input.
- F. The off normal position of any system function switch including the city tie disconnect switch and the trouble buzzer silence switch.

ADD IF NECESSARY:

- G. The operation of any waterflow supervisory switch.
- H. The loss of the standby battery set.

5.6 System Trouble Circuit

The control panel shall contain a complete system trouble circuit. The circuitry shall include an audible trouble sounding device, a visual system trouble indicator, a set of form "C" trouble contacts and a trouble buzzer silence switch. The detection of any supervisory fault shall cause the audible trouble sounding device to pulse, the system trouble LED to flash, and the system trouble contact to transfer. The trouble buzzer may be silenced by operation of the trouble silence switch. The common system trouble indicator shall continue to flash. Restoration of the fault condition to normal operating condition shall cause the trouble buzzer to re-sound at a steady rate until the trouble silence switch is returned to its normal position.

These instructions do not purport to cover all the details or variations in the equipment described, nor do they provide for every possible contingency to be met in connection with installation, operation and maintenance. All specifications subject to change without notice. Should further information be desired or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to FARADAY INC., Tecumseh, Michigan.

