



CONSTRUCTION PERMIT APPLICATION

005-136644

Application Completes: Sections I, II, III (optional), IV, VI, and VII

I. IDENTIFICATION

1. Proposed Work Site at: 1710 West Princeton Ave.
2. Name of Owner in Fee: McRoberts Michelle Te
Address 1710 West Princeton Ave. 08524
Street Municipality Zip Code
3. Ownership in Fee: Public _____ Private X
4. Principal Contractor: Pool Town, Inc. Tel. (732) 901-9071
Address 5500 U.S. Highway 9 South, Howell, NJ 07731
License No. OR if new home, Builder Reg. No. _____ Exp. Date _____
Federal Employee No. 22-2763004 FAX (732) 364-1815
5. Architect or Engineer _____ Tel. () _____
Address _____
6. Responsible Person in Charge of Work PoolTown, Inc.
Tel. (732) 901-9071 FAX (732) 364-1815

Proposed 16x34 Inground Pool • Existing/Proposed 6' STOCKRADE
Fence with self latching, locking gate, opening outward, installed by homeowner.

V. FEE SUMMARY (for office use only)

		Update	Update
1. Building	\$ <u>125</u>		
2. Electrical	<u>0.5</u>		
3. Plumbing			
4. Fire Protection			
5. Elevator Devices			
6. Subtotal	\$		
7. Less 20% for State Plan Review			
8. Subtotal	\$ <u>2.7</u>		
9. State Permit Surcharge Fee			
10. Subtotal	\$		
11. Cert. of Occupancy			
12. Other <u>ZIA+EP</u>	<u>60</u>		
13. TOTAL	\$ <u>307</u>		

VI. BUILDING/SITE CHARACTERISTICS

1. Number of Stories _____
2. Height of Structure _____ ft.
3. Area — Largest Floor _____ sq. ft.
4. New Building Area _____ sq. ft.
5. Volume of New Structure _____ cu. ft.
6. Construction Classification INGROUND POOL
7. Total Land Area Disturbed _____ sq. ft.
8. Flood Hazard Zone _____
9. Base Flood Elevation _____ ft.
10. Wetlands yes _____
no _____
11. Max. Live Load _____
12. Max. Occupancy Load _____

(office use only)

II. PROPOSED WORK

	Est. Cost	Plans Rec'd by	Date Rec'd	Rejection Date	Approval Date	Re-viewer	Resubmission Dates Approval	Rejection	Re-viewer
1. ☐ Minor Work									
2. ☐ New Building									
3. ☐ Addition									
4. ☐ a. Repair									
☒ b. Alteration	<u>18,599</u>		<u>7/8/05</u>		<u>7/29/05</u>		<u>10/21/05</u>		
☐ c. Renovation									
☐ d. Reconstruction									
5. ☐ Fire Protection									
6. ☐ Plumbing									
7. ☒ Electrical	<u>400</u>				<u>8.05</u>	<u>11/2/05</u>	<u>8/22/05</u>		
8. ☐ Elevator Devices									
9. ☐ Asbestos Abat. Subch. 8									
10. ☐ Lead Hazard Abatement									
11. ☐ Demolition									
TOTAL COSTS	<u>18,999</u>	<u>EW</u>	<u>7/29/05</u>		<u>7/29/05</u>				

VII. DESCRIPTION OF BUILDING USE

A. RESIDENTIAL

1. State Specific Use:
2. Use Group:
3. Change in Use Group, Indicate Former:

4. No. of dwelling units: All Units income-restricted
Before Construction _____
After Construction _____
Net Gain or Loss _____

B. NON-RESIDENTIAL

1. State Specific Use:
2. Use Group:
3. Change in Use Group, Indicate Former:

III. DO YOU WANT: (optional)

1. ☐ Partial Releases
2. ☐ Prototype Processing

IV. DOES OR WILL YOUR BUILDING CONTAIN ANY OF THE FOLLOWING?

1. ☐ Elevators/Escalators/Lifts/
Dumbwaiters/Moving Walks
2. ☐ High Pressure Boilers
3. ☐ Pressure Vessels
4. ☐ Refrigeration Systems
5. ☐ Cross-Connections/Backflow Preventers
6. ☐ Hazardous Uses/Places of Assembly
7. ☐ Sprinklers
8. ☐ Smoke Control Systems in Open Wells
9. ☐ Underground Storage Tanks
10. ☐ Swimming Pools, Spas and Hot Tubs

CERTIFICATION IN LIEU OF OATH

I. OWNER SECTION (to be completed if the applicant is the owner in fee)

I hereby certify that I am the owner in fee of the property listed on Page 1.

Mark the following applicable boxes:

- A. ☐ I further certify that a new home (private residence) will be constructed on this property for my own use and occupancy. This dwelling is to be occupied by myself and is not to be used for any purpose other than single family residential use. I attest that all construction, plumbing, or electrical work will be done, in whole or in part, by me or by subcontractors under my supervision, in accordance with all applicable laws; and, I further acknowledge that said new home is not covered under the New Home Warranty and Builders Registration Act (N.J.S.A. 46:3B-1 et seq.) and that such fact shall be disclosed to any person purchasing this property within ten years of the date of issuance of a certificate of occupancy.

I UNDERSTAND THAT IN MARKING BOX A, I ACKNOWLEDGE THAT I AM ASSUMING RESPONSIBILITY FOR THE WORK DONE ON SAID PROPERTY, THE CONDITION OF THE PROPERTY PRIOR TO, DURING, AND AFTER ANY WORK PERFORMED, AND FOR THE PERFORMANCE OF THE SUBCONTRACTORS I HIRE, EMPLOY, OR OTHERWISE CONTRACT OR WITH WHOM I MAKE AGREEMENTS TO PERFORM WORK. I AM VOLUNTARILY AND KNOWINGLY ASSUMING THIS RESPONSIBILITY.

- B. ☐ I further certify the following as required by the New Jersey Uniform Construction Code, N.J.A.C. 5:23-2.15(e)1.vii:

I personally prepared the plans submitted for: 1) the new home referred to in A.; or, 2) an addition, alteration, renovation, or repair to an existing single family residence owned and occupied by myself and located on the property listed on Page 1; or, 3) a new structure that will be physically separate from, but that will be deemed part of, an existing single family residence that is owned and occupied by myself and located on the property listed on Page 1.

- C. ☐ I further certify that I will perform or supervise the following work:

C.1. ☐ Building C.2. ☐ Fire Protection

I further certify that I will perform the following work:

C.3. ☐ Electrical C.4. ☐ Plumbing

- D. ☐ I agree to advise all contractors on this project that they are required to be registered with the New Jersey Division of Taxation and to comply with all New Jersey tax laws.

I further certify the following as required by the Uniform Construction Code, N.J.A.C. 5:23-2.15(a)5: All required State, county, and local prior approvals have been given, including such certification as the construction official may require.

I understand that if any of the above statements are willfully false, I am subject to punishment.

Signature _____ Date _____

II. AGENT SECTION (to be completed if the applicant is not the owner in fee)

I hereby certify the following as required by the Uniform Construction Code, N.J.A.C. 5:23-2.15(d): the proposed work is authorized by the owner in fee; and I have been authorized by the owner in fee to make this application as his agent.

I further certify the following as required by the Uniform Construction Code, N.J.A.C. 5:23-2.15(a)5: All required State, county, and local prior approvals have been given, including such certification as the construction official may require.

I agree to advise all contractors on this project that they are required to be registered with the New Jersey Division of Taxation and to comply with all New Jersey tax laws.

I understand that if any of the above statements are willfully false, I am subject to punishment.

☒ Check if contractor.

Agent Name POOL TOWN, INC.

Address 5500 RT. 9 S.
HOWELL, NJ 07731

Telephone (732) 505-9000

Signature [Signature]

III. ☐ LEAD HAZARD ABATEMENT: Include Homeowner or Building Owner Affidavit as per N.J.A.C. 5:17.

OFFICE DATE RECEIVED: _____

VIII. PRIOR APPROVALS CHECKLIST (office use only)	LOCAL APPROVAL		COUNTY APPROVAL		REGIONAL APPROVAL		STATE APPROVAL		COMMENTS
	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	Prelimin. Initial	Final Date	
☐ Zoning Officer			X	X	X	X	X	X	
☐ Planning Board			X	X	X	X	X	X	
☐ Zoning Board			X	X	X	X	X	X	
☐ Sewer Authority			X	X	X	X	X	X	
☐ Water Authority			X	X	X	X	X	X	
☐ Police Department			X	X	X	X	X	X	
☐ Health Department			X	X	X	X	X	X	
☐ Soil Conservation			X	X	X	X	X	X	
☐ N.J. Department of Community Affairs			X	X	X	X	X	X	
☐ N.J. Department of Transportation			X	X	X	X	X	X	
☐ N.J. Department of Environmental Protection			X	X	X	X	X	X	
☐ Utility Dig No.			X	X	X	X	X	X	
☐									
☐									

IX. SUBCODES AND SPECIAL REGULATIONS APPLICABLE (office use only—optional)	
Name of Code & Edition	Name of Code & Edition
Building _____	Energy _____
Electrical _____	Barrier Free _____
Plumbing _____	Flood Hazard _____
Fire Protection _____	As Built Elevation Cert. _____
Mechanical _____	Other _____

X. CERTIFICATES ISSUED (office use only)	DATE ISSUED	DATE EXPIRED	DATE REISSUED	DATE EXPIRED
☐ Temporary Certificate of Occupancy	No. _____	_____	_____	_____
☐ Temporary Certificate of Compliance	No. _____	_____	_____	_____
☐ Continued Certificate of Occupancy	No. _____	_____	_____	_____
☐ Certificate of Compliance	No. _____	_____	_____	_____
☐ Certificate of Occupancy	No. _____	_____	_____	_____
☐ Certificate of Approval	No. _____	_____	_____	_____
☐ Lead Abatement Clearance Certificate	No. _____	_____	_____	_____

IMPORTANT
A.H.B.T. - MANDATORY FEE - RESIDENTIAL

Handwritten:
7/21/05
P. 10/05
P. 10/05



Brick Township
401 Chambersbridge Rd
Brick, NJ 08723

Date Issued 10/16/2006
Tracking Number C-05-136644
Permit Number 05-3140
Permit Issue Date 08/05/2005

Certificate

Construction Code Division
(Certificate of Occupancy)

Identification

Work Site Location: 1710 W. PRINCETON AVE. Brick Township, Block: 842 Lot: 27 Qual:
NJ
Owner in Fee: MCROBERTS, M L & ROTH, MICHAEL
Owner Address: 1710 W PRINCETON AVE BRICK NJ 08724
Telephone:
Contractor POOL TOWN INC
Address 5500 RT 9 SOUTH HOWELL NJ 07731-
Telephone: 800/882-0152 Fax:
License Number or Builders Registration Number: 13VH00923100 Federal Emp. Number: 22-2763004

Home Warranty Number:

Type of Warranty Plan: ☐ State ☐ Private

Use Group: U Construction Classification:

Maximum Live Load: 0 Maximum Occupancy Load: 0

Description of Work Use:

INGROUND SWIMMING POOL 16X34 SIZE W/ EXISTING 6' STOCKADE FENCE

Certificate Comments:

☒ **Certificate of Occupancy**

This serves notice that said building or structure has been constructed in accordance with the New Jersey Uniform Construction Code and is approved for occupancy.

☐ **Certificate of Approval**

This serves notice that the work completed has been constructed or installed in accordance with the New Jersey Uniform Construction Code and is approved. If the permit was issued for minor work, this certificate was based upon what was visible at the time of inspection.

☐ **Certificate of Continued Occupancy**

This serves notice that based on a general inspection of the visible parts of the building there are no imminent hazards and the building is approved for continued occupancy.

☐ **Temporary Certificate of Compliance**

The following conditions must be met no later than or the owner will be subject to fine or order to vacate:
This certificate has an expiration date of:

Conditions to be met:

☐ **Certificate of Clearance - Lead Abatement 5:17**

This serves notice that based on written certification, lead abatement was performed as per NJAC5:17 to the following extent.

- ☐ Total removal of lead-based paint hazards in scope of work
☐ Partial or limited time period (years); see file

☐ **Certificate of Clearance - Asbestos Abatement**

This serves notice that based on written certification, asbestos abatement was performed to the following extent.

- ☐ Total removal of asbestos hazards in scope of work
☐ Partial or limited time period (years); see file


☐ **Certificate of Compliance**

This serves notice that said potentially hazardous equipment has been installed and/or maintained in accordance with the New Jersey Uniform Construction Code and is approved for use until

☐ **Temporary Certificate of Occupancy**

The following conditions must be met no later than: or the owner will be subject to fine or order to vacate:
This certificate has an expiration date of:

Conditions to be met:

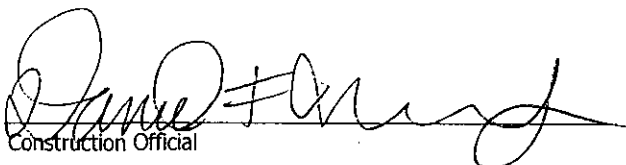
Construction Official

Fee: \$0.00
Check Number: 1550
Collected By: Stephanie Capozzi

Date Printed: 10/16/2006

Page 1



CONSTRUCTION PERMIT

Date Issued 08/05/2005
Control # C-05-136644
Permit # 05-3140

IDENTIFICATION Block: 842 Lot: 27 Qualifier
Work Site Location: 1710 W. PRINCETON AVE. Brick Township, NJ Contractor POOL TOWN INC
Address 5500 RT 9 SOUTH HOWELL NJ 07731-
Owner in Fee MCROBERTS, M L & ROTH, MICHAEL
Address 1710 W PRINCETON AVE BRICK NJ 08724 Telephone: 800/882-0152
Lic. No. or Bldrs. Reg. No.
Telephone: Federal Employee No. 22-2763004

Is hereby granted permission to perform the following work:

- ☒ BUILDING ☐ PLUMBING ☐ LEAD HAZARD ABATEMENT
☒ ELECTRICAL ☐ FIRE PROTECTION ☐ DEMOLITION
☐ ELEVATOR DEVICES ☐ ASBESTOS ABATEMENT (Subchapter 8 only) ☐ OTHER

DESCRIPTION OF WORK:

INGROUND SWIMMING POOL 16X34 SIZE W/ EXISTING 6' STOCKADE FENCE

Note: If construction does not commence within one (1) year of date of issuance, or if construction ceases for a period of six (6) months, this permit is void.

Estimated Cost of Work \$19,399

Construction Official 08/05/2005
Date

U.C.C. F170
equiv (rev 8/03)

1 WHITE - INSPECTOR

2 CANARY - OFFICE

3 PINK - TAX ASSESSOR

4 GOLD - APPLICANT

PAYMENTS (Office Use Only)

Building	\$125
Electrical	\$95
Plumbing	\$0
Fire Protection	\$0
Elevator Devices	\$0
Other	\$0.00
DCA Training Fee	\$27
CO Fee	
Other	\$60
Total	\$307
Check No.	1550
Cash	\$0
Credit	\$0
Collected By	Stephanie Capozzi

REQUIRED INSPECTIONS

Construction work must be inspected in accordance with the State Uniform Construction Code Regulations N.J.A.C. 5:23-2.18. This agency will carry out such periodic inspections during the progress of work as are necessary to insure that the work installed conforms with the requirements of the Uniform Construction Code.

The owner or other responsible person in charge of work must notify this agency when work is ready for any required inspections specified below. Requests for inspections must be made at least 24 hours prior to the time the inspection is desired. Inspections will be performed within three business days of the time for which they are requested. The work must not proceed in a manner which will preclude the inspection until it has been made and approval granted.

- ☐ Required inspections for all subcodes for one- and two-family dwellings are as follows:

1. The bottom of footing trenches before placement of footings, except that in cases of pile foundations, inspections shall be made in accordance with the requirements of the building subcode.
2. Foundations and all walls up to grade level prior to back filling.
3. All structural framing, connections, wall and roof sheathing and insulation; electrical rough wiring, panel and service installation; rough plumbing. The framing inspection shall take place after the rough electrical and plumbing inspections and after the installation of the heating, ventilation and/or air conditioning duct system. The insulation inspection shall be performed after all other subcode rough inspections and prior to the installation of any interior finish material.
4. Installation of all finished materials, sealings of exterior joints, plumbing piping, trim and fixtures; electrical wiring, devices and fixtures; mechanical systems equipment.

Additional required inspections for all subcodes of construction, for other than one- and two-family dwellings, are fire suppression systems, heat producing devices and Barrier Free subcode accessibility, if applicable.

- ☐ Required special inspections. The applicant by accepting the permit will be deemed to have consented to these requirements:

- ☐ A final inspection is required for each applicable subcode area before a final Certificate of Occupancy or Approval may be issued. The final inspections include the installation of all interior and exterior finish materials, sealing of exterior joints, mechanical system and other required equipment; electrical wiring, devices and fixtures; plumbing pipes, trim and fixtures; tests required by any provision of the adopted subcodes, Barrier Free accessibility, if applicable; and verification of compliance with NJAC 5:23-3.5, "Posting structures".

- ☐ A complete copy of released plans must be kept on the job site.

If you do not understand any of this information, please ask.



BUILDING SUBCODE TECHNICAL SECTION



A. IDENTIFICATION—APPLICANT: COMPLETE ALL APPLICABLE INFORMATION. WHEN CHANGING CONTRACTORS, NOTIFY THIS OFFICE. CALL UTILITY DIG NO: 1-800-272-1000.

Block 842 Lot 27 Qualification Code _____
Work Site Location 1710 West Princeton Ave.

Owner in Fee McRoberts, Michelle
Address 1710 West Princeton Ave.

Contractor Pool Town, Inc.

Address 5500 U.S. Highway 9 South, Howell, NJ 07731

Tele (732) 901-9071 Fax (732) 364-1815

Lic. No. or Bids. Reg. No. _____
Federal Emp. No. 22-2763004

JOB SUMMARY (Office Use Only)

PLAN REVIEW	Date	Initial	INSPECTIONS	Dates (Month/Day)
☒ No Plans Required			Type: <u>Failure</u>	Approval/Initial
☒ All	<u>7-29-05</u>	<u>MM</u>	<u>Footings</u>	<u>8/18/05</u>
☐ Footing			<u>Bonding</u>	
☐ Foundation			<u>Foundation</u>	
☐ Frame			<u>Slab</u>	
☐ Other			<u>Frame</u>	
			<u>Truss Sys/Bracing</u>	
			<u>Barrier-Free</u>	
Joint Plan Review Required:			<u>Insulation</u>	
☐ Elec. ☐ Plumb. ☐ Fire ☐ Elevator			<u>Finishes - Base Layer</u>	
SUBCODE APPROVAL			<u>Finishes - Final</u>	
☐ CO ☐ CCO			<u>Energy</u>	
Date: <u>10/27/05</u>			<u>Mechanical</u>	
Approved by: <u>MM</u>			<u>TCO</u>	
			<u>Other</u>	
			<u>Final</u>	
			<u>Barrier-Free</u>	

B. BUILDING CHARACTERISTICS

Use Group	Present	Proposed	Est. Cost of Bldg. Work:
Constr. Class			1. New Bldg. \$
No. of Stories			2. Rehabilitation \$
Height of Structure			3. Total (1+2) \$ <u>18,999</u>
Area — Largest Floor			
New Bldg. Area/All Floors			
Volume of New Structure			
Total Land Area Disturbed			

C. CERTIFICATION IN LIEU OF OATH

I hereby certify that I am the agent of owner of record and am authorized to make this application.

Signature [Signature]

Date Received
Control #

Date Issued 8/5/05
Permit # 05-3140

D. TECHNICAL SITE DATA

DESCRIPTION OF WORK

Proposed 16x34' Inground Pool.

Existing/Proposed 6'S STOCKADE

Fence with self latching, locking gate, opening outward, installed by homeowner.


Final Engineering Also Reserve

TYPE OF WORK:

- ☐ New Building
- ☐ Addition
- ☐ Rehabilitation
- ☐ Roofing
- ☐ Siding
- ☐ Fence
- ☐ Sign
- ☒ Pool
- ☐ Asbestos Abatement Subchapter 8
- ☐ Lead Haz. Abatement NJAC 5:17
- ☐ Other
- ☐ Demolition

FEE (Office Use Only)

Administrative Surcharge \$	
Minimum Fee \$	
State Permit Surcharge Fee \$	
TOTAL FEE \$	



1 White = Inspector Copy
3 Pink = Office Copy

2 Canary = Office Copy
4 Gold = Applicant Copy

8/18/05 No access, No Plans, No one home J/K



ELECTRICAL SUBCODE TECHNICAL SECTION



A. IDENTIFICATION - APPLICANT'S COMPLETELY APPLICABLE INFORMATION. WHEN CHANGING CONTRACTORS, NOTIFY THIS OFFICE. CALL UTILITY DIG NO: 1-800-272-1000.

Block 842 Lot 27 Qualification Code _____
Work Site Location 1710 West Princeton Ave

Owner in Fee McRoberts, Michelle
Address 1710 West Princeton Ave.

Tel [REDACTED]
Contractor CRB Electric
Address 1371 Bridport Drive
Toms River, N.J. 08755

Tel (732) 244-2570 FAX (732) 244-3825
Contractor License No. 3984
Federal Emp. No. 22-2852256

B. ELECTRICAL CHARACTERISTICS

Use Group Present Proposed _____
[] Pole/Pad # _____ [] Temporary [] Other _____
Building Occupied as _____ Utility Co. _____
Est. Cost of Elec. Work \$ 400-

JOB SUMMARY (Office Use Only)

PLAN REVIEW	Date	Initial	INSPECTIONS	Dates (Month/Day)			
			Type:	Failure	Failure	Approval	Initial
☒ No Plans Required			Rough				
Joint Plan Review Required:			Barrier-Free				
[] Building [] Plumbing			Trench				
[] Fire [] Elevator			Temp. Serv.				
[] Elec. Plans Approved			Const. Serv.				
Date: <u>8/10/05</u>			Other				
Approved by: <u>[Signature]</u>			Service				
			Final				
			Barrier-Free				
SUBCODE APPROVAL			Temp. Cut-in-Card Date Issued				
[] CO [] CCO			Final Cut-in-Card Date Issued				
Date: <u>8/22/05</u>			Annual Pool Inspection				
Approved by: <u>[Signature]</u>			Date of Grounding and Bonding				
			Certification				

C. CERTIFICATION IN LIEU OF OATH

I hereby certify that I am the (agent of) owner of record and am authorized to make this application and perform the work listed on this application.

[Signature]
[Signature]

Applicant's Signature/Contractor's Seal and Signature
[X] Licensed Elec. Contractor [] Certifd Landscape Irrigation Contr [] Exempt Applicant

D. TECHNICAL SITE DATA

QTY	SIZE	ITEMS
1		Lighting Fixtures
1		Receptacles
		Switches
		Detectors
		Light Poles
		Motors—Fract. HP
		Emergency & Exit Lights
		Communications Points
		Alarm Devices/F.A.C. Panel

TOTAL NUMBERS

- Pool/Permit/with UW Lights
- Storable Pool/Spa/Hot Tub
- KW Elec. Range/Receptacle
- KW Oven/Surface Unit
- KW Elec. Water Heater
- KW Elec. Dryer/Receptacle
- KW Dishwasher
- HP Garbage Disposal
- KW Central A/C Unit
- HP/KW Space Heater/Air Handler
- KW Baseboard Heat
- HP Motors 1/+ HP
- KW Transformer/Generator
- AMP Service
- AMP Subpanels
- AMP Motor Control Center
- KW Elec. Sign/Outline Light

FEE (Office Use Only)

\$ _____

Administrative Surcharge \$ _____

Minimum Fee \$ _____

State Permit Surcharge Fee \$ _____

TOTAL FEE \$ _____

Date Received
Control #

Date Issued 8/15/05
Permit # 05-3140

**Township of Brick
Zoning Permit**

Approved: Thursday, July 21, 2005 **Number:** 1054

Block 842 **Lot** 27 **Zone:** R-7.5

Property Address: 1710 West Princeton Avenue

Applicant: Laurie Galindo, Pool Town Inc.

Property Owner: Michelle McRoberts


Existing Use: Single Family Residential

Proposed Use: Single Family Residential


Proposed Construction: In-ground swimming pool 16' x 34'.

Conditions: The swimming pool must be set back at least 5 feet from the side and rear property lines.

This permit shall be null, void and of no effect if any of the facts contained in the application upon the basis that this permit was granted are false or untrue in any material respect. This permit shall expire one (1) year after the date of issuance if the use or substantial construction has not been commenced.

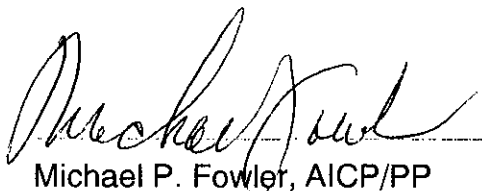

Michael P. Fowler, AICP/PP
Principal Planner



Sean Kinnevy
Zoning Officer

TOWNSHIP OF BRICK ZONING PERMIT APPLICATION

(Please Type or Print Neatly in Ink, Not Pencil)

Applications missing any of the following information
will delay processing and may be returned to you.

BLOCK 842 LOT 27 QUALIFIER _____

PROPERTY ADDRESS 1710 W. Princeton Ave

PERSONAL NAME OF APPLICANT Laurie Galindo

BUSINESS NAME OF APPLICANT Pool Town Inc.

MAILING ADDRESS OF APPLICANT 5300 RT 9, So. Howell, N.J. 07731

PROPERTY OWNER'S FULL NAME Michelle Mc Roberts

PRESENT USE OF PROPERTY (check all that apply)

- ☐ Vacant Lot ☒ Single-family dwelling ☐ Multi-family dwelling
☐ Commercial (please describe) _____

PROPOSED USE OF PROPERTY (check all that apply)

- ☐ Vacant Lot ☒ Single-family dwelling ☐ Multi-dwelling
☐ Commercial (please describe) _____

PROPOSED CONSTRUCTION (check all that apply)

- ☐ New Building (please describe) _____ Height _____
☐ Addition - Height _____
☐ Alteration _____
☐ Porch or deck - Height _____
☐ Shed - Height _____
☐ Fence - Type _____ Height _____
☒ Swimming Pool ☒ in-ground ☐ above-ground
☐ Other (please describe) _____

CHECKLIST

- ☐ All information completed above
☐ Two (2) copies of a plot plan containing:
☐ All existing and proposed structures
☐ All dimensions of the lot and structures
☐ All setbacks from the structures to the property lines
☐ All adjacent streets and waterways

**Note: No partial, taped, faxed,
reduced or enlarged copies
can be accepted.**

☐ If applicable, include a copy of the Zoning Board of Adjustment Resolution, the date that the map was signed, and/or the date that the subdivision map was filed with the Ocean County Clerk, along with the file map and number.

The applicant certifies that all statements and information made and provided as part of this application are true to the best of the applicant's knowledge, information and belief. The applicant further states that the applicant will comply with all other Municipal approvals and ordinances, and all County, State, and Federal Regulations.

SIGNATURE OF APPLICANT [Signature] Date 7/19/05

Reviewed by Zoning Office [Signature] Date 7/21/05 (X) Approved () Denied

get 7/21/05

TOWNSHIP OF BRICK ZONING PERMIT APPLICATION

(Please Type or Print Neatly in Ink, Not Pencil)

JUL 11 2005

Applications missing any of the following information
will delay processing and may be returned to you.

JUL 19 2005

ZONING BLOCK

842

LOT

27

QUALIFIER

PROPERTY ADDRESS 1710 West Princeton Ave.

PERSONAL NAME OF APPLICANT ~~Laurie Galindo~~ Michelle McRoberts

BUSINESS NAME OF APPLICANT Pool Town Inc

MAILING ADDRESS OF APPLICANT 5500 RT 9 South, Howell 07731

PROPERTY OWNER'S FULL NAME McRoberts Michelle

PRESENT USE OF PROPERTY (check all that apply)

- ☐ Vacant Lot ☒ Single-family dwelling ☐ Multi-family dwelling
☐ Commercial (please describe) _____

PROPOSED USE OF PROPERTY (check all that apply)

- ☐ Vacant Lot ☒ Single-family dwelling ☐ Multi-dwelling
☐ Commercial (please describe) _____

PROPOSED CONSTRUCTION (check all that apply)

- ☐ New Building (please describe) _____ Height _____
☐ Addition - Height _____
☒ Alteration
☐ Porch or deck - Height _____
☐ Shed - Height _____
☐ Fence - Type _____ Height _____
☐ Swimming Pool ☒ in-ground ☐ above-ground
☐ Other (please describe) 16 x 34' in-ground pool

CHECKLIST

- ☐ All information completed above
☐ Two (2) copies of a plot plan containing:
☐ All existing and proposed structures
☐ All dimensions of the lot and structures
☐ All setbacks from the structures to the property lines
☐ All adjacent streets and waterways
☐ If applicable, include a copy of the Zoning Board of Adjustment Resolution, the date that the map was signed, and/or the date that the subdivision map was filed with the Ocean County Clerk, along with the file map and number.

Note: No partial, taped, faxed,
reduced or enlarged copies
can be accepted.

The applicant certifies that all statements and information made and provided as part of this application are true to the best of the applicant's knowledge, information and belief. The applicant further states that the applicant will comply with all other Municipal approvals and ordinances, and all County, State, and Federal Regulations.

SIGNATURE OF APPLICANT

Michelle McRoberts Date June 5, 2005

Reviewed by Zoning Office

Date

7/14/05

()


Approved ☒ Denied

March 2003

7/8/05

Pro™ Series

TOP-MOUNT SAND FILTERS

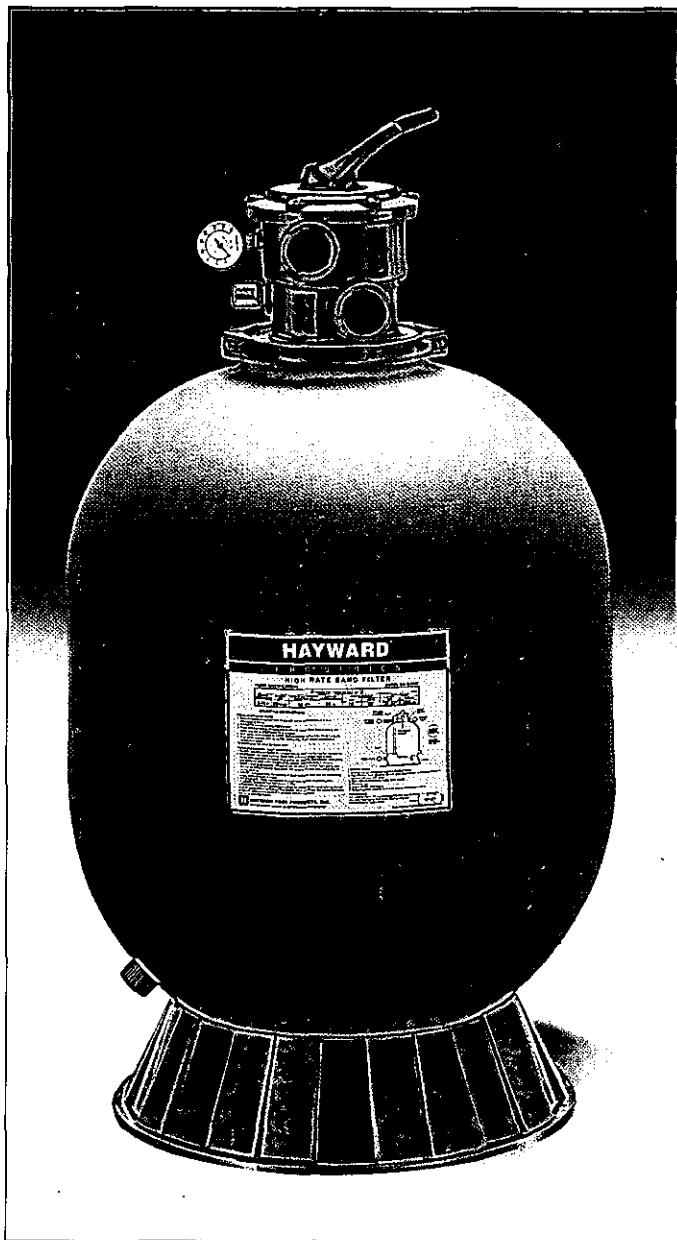

■ Pro-Series S244T 24" filter, shown with Vari-Flo™ top-mount filter control valve.

Hayward Pro Series sand filters are the very latest in pool filter technology, and produce crystal clear, sparkling water with only minimum care.



Molded of durable, corrosion-proof polymeric materials, they feature attractive, unitized construction, and self-cleaning 360°

slotted laterals for smooth, efficient flow and totally-balanced backwashing. Plus, a versatile seven-position control valve allows for easy operation and maximum efficiency.

Pro Series filters set a new standard for performance, value and dependability. And you know it's quality throughout because it's made by Hayward — the first choice of pool professionals.



HAYWARD®

HIGH-RATE SAND FILTERS

Pro™ Series Top-Mount Sand Filters

Flange Clamp Design allows 360° rotation of valve to simplify plumbing.


Integral Top Diffuser assures even distribution of water over the top of the sand media bed. Full-size internal piping gives smooth, free-flowing performance.

Unitized, Corrosion-Proof Filter Tank molded of tough, durable, colorfast polymeric material for dependable, all-weather performance with only minimal care.

Efficient, Multi-Lateral Underdrain Assembly with precision engineered, self-cleaning 360° slotted laterals gives totally balanced flow and backwashing.


Integral Molded Drain Plug for easy draining of tank, without the loss of sand.

Totally Corrosion-Proof Base is rugged and attractively styled to provide strong, stable support.

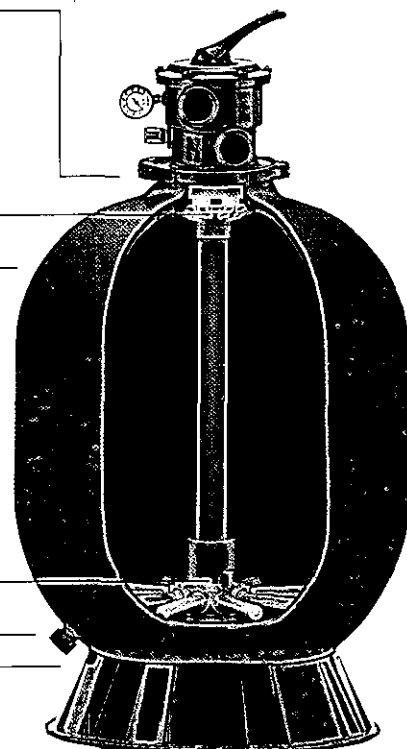

Specifications – Pro Series High-Rate Sand Filters

FILTER TYPE:	High-Rate Sand: No. 1/2 Silica Sand (.45mm – .55mm)
FILTER TANK:	Molded Polymeric
UNDERDRAIN:	360° Self Cleaning Slotted Laterals, Precision Installed in Ball Joint Assembly
CONTROL VALVE:	1 1/2 or 2" 7-Position, Top-Mount Vari-Flo™ With Lever-Action Handle
VALVE FASTENING:	Flange Clamp Design
SUPPORT BASE:	Injection-Molded ABS
PERFORMANCE RANGE:	1/2 to 3 HP (30 to 120 GPM) .37 to 2.2 KW (114 to 454 LPM)
DIMENSIONS:	S180T–18 1/2" W x 35" H (470 mm x 889 mm) S210T–20 1/2" W x 38" H (521 mm x 965 mm) S220T–22 1/2" W x 41" H (572 mm x 1041 mm) S244T–24 1/2" W x 42" H (622 mm x 1067 mm) S310T2–30 1/2" W x 48" H (775 mm x 1219 mm)

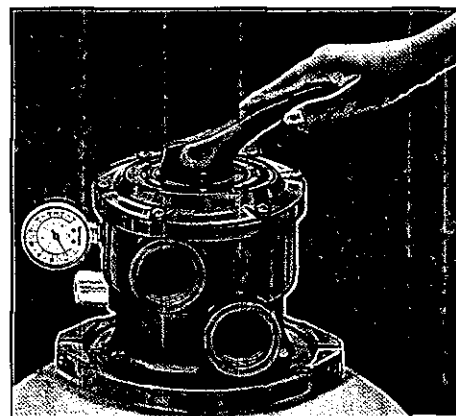


Vari-Flo™ 7-Position Control Valve with easy-to-use lever-action handle lets you "dial" any of seven valve/filter functions.

Performance Data

MODEL NUMBER	EFFECTIVE		DESIGN		TURNOVER				SAND	
	FILTRATION AREA		FLOW RATE*		8 Hr.	10 Hr.	8 Hr.	10 Hr.	REQUIRED	
	ft. ²	m ²	GPM	LPM	GALLONS		KILO LITERS		lbs.	kgs.
S180T	1.75	0.163	35	132	16,800	21,000	63.59	79.48	150	68
S210T	2.20	0.205	44	167	21,120	26,400	79.94	99.92	200	91
S220T	2.64	0.246	52	197	24,960	31,200	94.47	118.09	250	114
S244T	3.14	0.292	62	235	29,760	37,200	112.64	140.80	300	136
S310T2	4.91	0.457	98	371	47,040	58,800	178.05	222.56	500	227

*Based upon 20 GPM per ft.² (814 LPM per m²). Maximum allowable NSF rating.




Patented Service Ease Design

Unique folding ball-joint design allows lateral assembly to be easily accessed for simple servicing.

HAYWARD®

Super Pump®

HIGH-PERFORMANCE PUMP SERIES

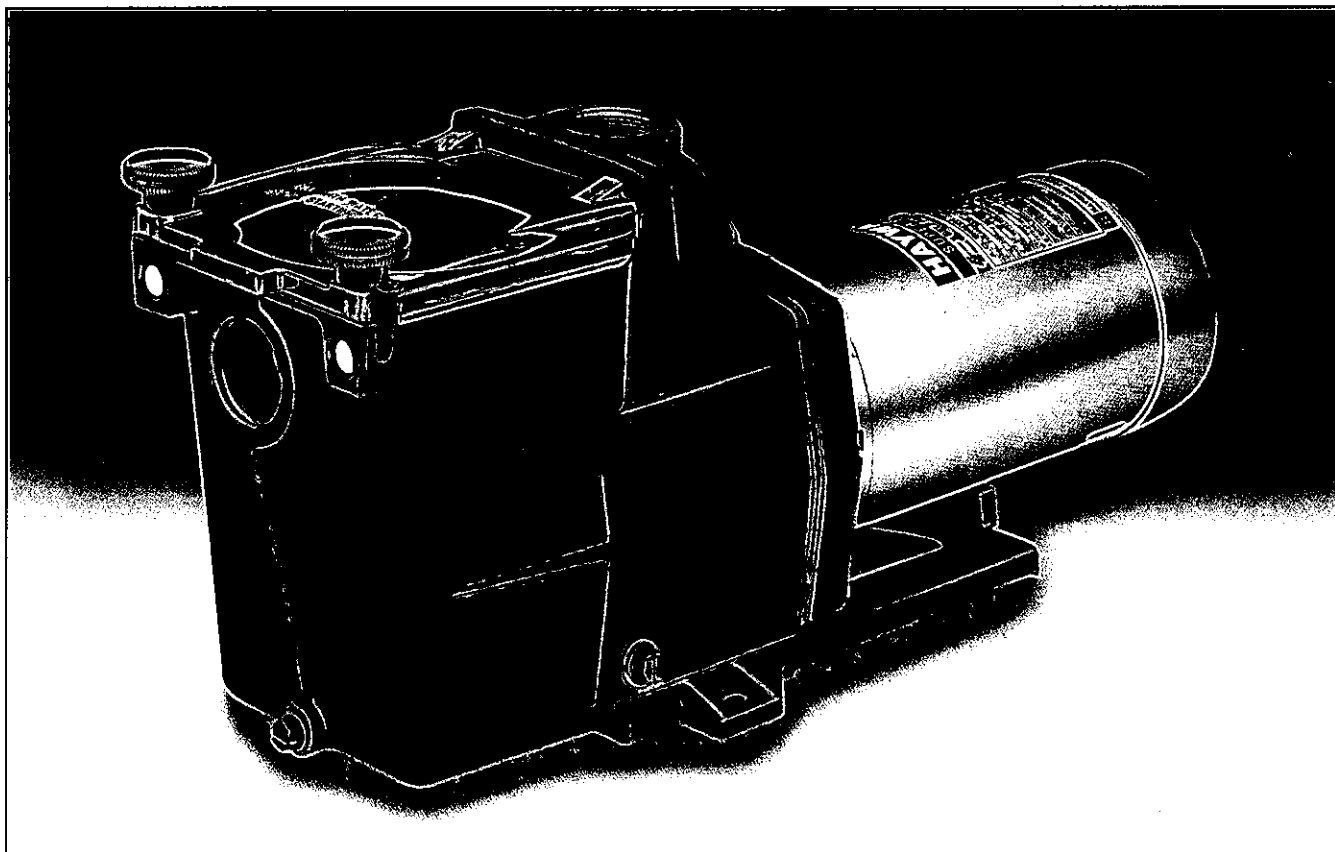

■ *Super Pump: high performance and quiet operation.*

Hayward's Super Pump is a series of large capacity, high technology pumps that blend cost-efficient design with durable corrosion-proof construction.

Designed for pools of all types and sizes, Super Pump features a large "see-thru" strainer cover, super-size debris basket and exclusive "service-ease"



design for extra convenience.

Quiet, efficient, dependable, and proven, the Super Pump has all the quality features you expect from Hayward — the first choice of pool professionals.



HAYWARD®

Super Pump® High Performance Pump Series

Exclusive, Swing-Aside Hand Knobs make strainer cover removal easy. No tools required...no loose parts...no clamps.

Lexan® See-Thru Strainer Cover lets you see when basket needs cleaning and eliminates guesswork. Special self-adjusting seal assures dependable sealing.

All Components Molded of Corrosion-Proof PermaGlassXL™ for extra durability and long life.

Heavy-Duty, High-Performance Motor with air-flow ventilation for quieter, cooler operation.


Heat Resistant, Industrial Size Ceramic Seal. Long wearing, and 100% drip proof. For fresh or salt water use.

Mounting Base provides stable, stress-free support, plus versatility for any installation requirement. Adapts 48 and 56 frame motors.


Super-Size Housing has extra air handling capacity to assure rapid priming.

Totally Balanced, Corrosion-Proof Noryl® Impeller has smooth, wide openings to prevent fouling or clogging. Energy-efficient design produces more flow at equivalent horsepower.

Service-Ease Design gives simple access to all internal parts. Motor and entire drive group assembly can be removed, without disturbing pipe or mounting connections, by disengaging just four bolts.


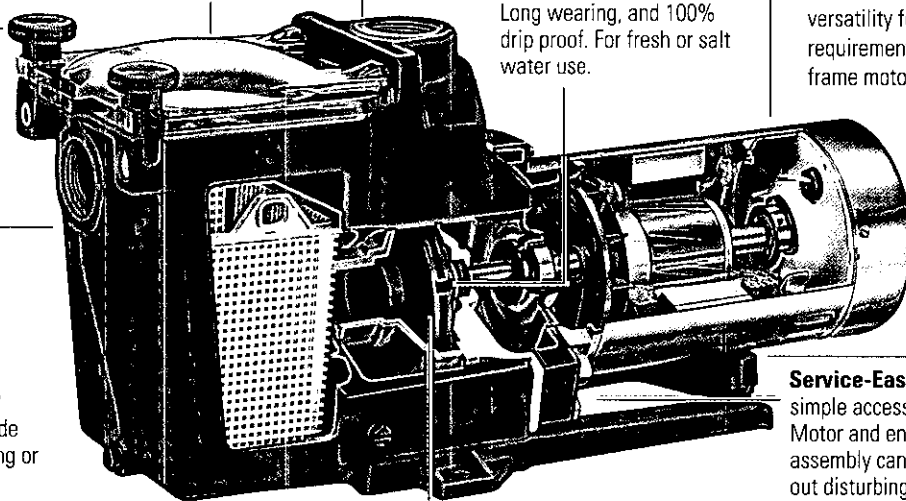


Overall Dimensions

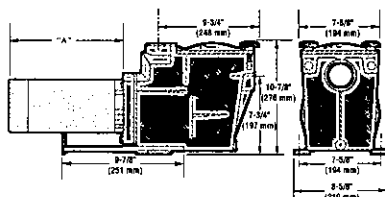

Model	Motor Power HP	KW	Pipe Size inch	Dimension A inch	mm
SP2600X5	1/2	0.37	1 1/2"	11 1/4"	286
SP2605X7	3/4	0.56	1 1/2"	11 5/8"	295
SP2607X10	1	0.75	1 1/2"	11 7/8"	302
SP2610X15	1 1/2	1.12	1 1/2"	12 1/4"	311
SP2615X20	2	1.49	2"	13 1/4"	337
SP2621X25	2 1/2	1.86	2"	13 3/4"	349

Super Pumps are also available with dual speed motors.

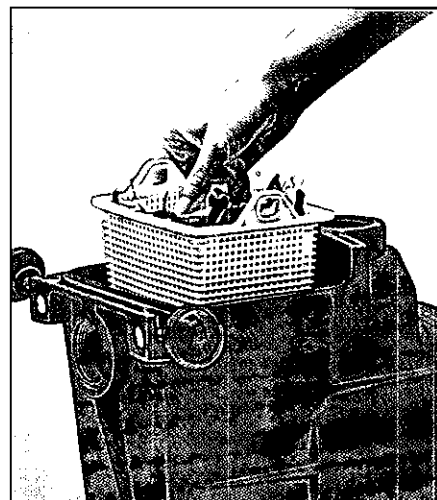
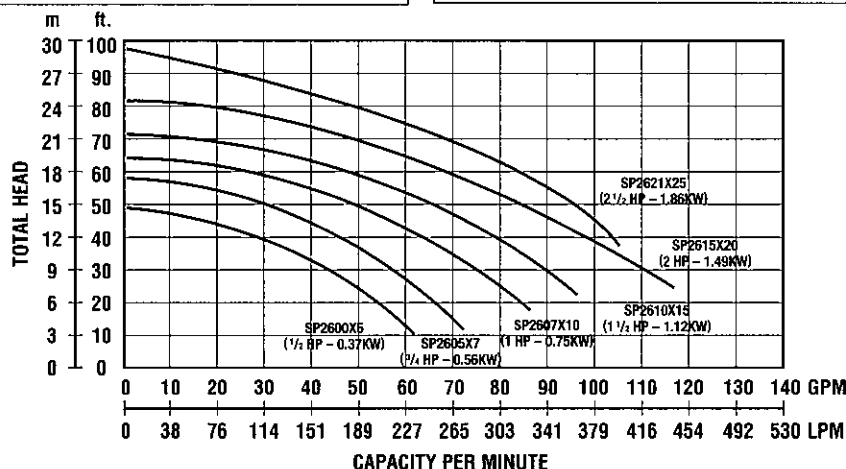


SUPER-SIZE 110 CUBIC INCH BASKET has extra leaf-holding capacity and extends time between cleanings. Rigid construction with load-extender ribbing assures free flowing operation for heavy debris loads.

Super Pump® Series Pumps are listed by:



HAYWARD®

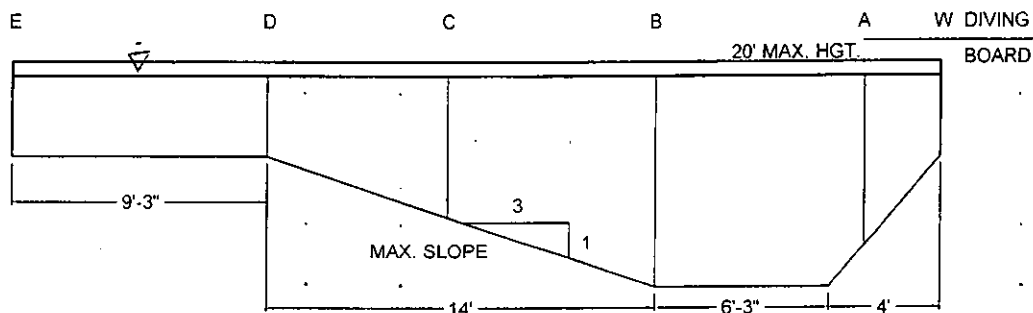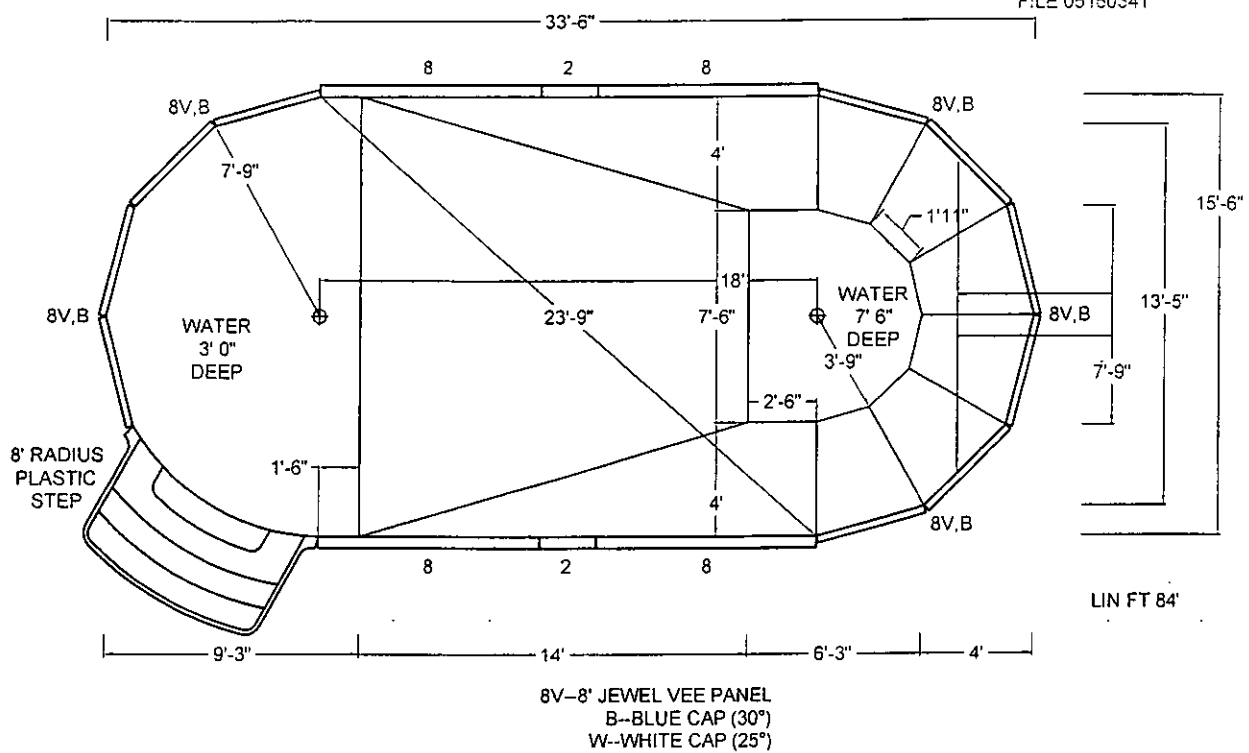

Diving Type	Depths At Point				Widths At Point				Lengths Between Points				
	A	B	C	D	A	B	C	D	WA	AB	BC	CD	DE
I	6' 0"	7' 6"	5'	3'	10' 9 5/8"	15' 5 1/2"	15' 5 1/2"	15' 5 1/2"	2' 6 7/8"	8' 2 1/8"	7' 9 5/8"	6' 2 3/8"	8' 8 1/2"

6' Jump Board or 6" or 6' Diving Board Permitted

All construction shall comply with the 2000 International Building Code, New Jersey Edition (IRC 2000), including ANSI/NSPI-5 Standards for Residential In-Ground Swimming Pools.

SAPPHIRE POOL

Shop Drawing
16' x 34' w/Right Step
Imperial Pools, Inc. No. 05160341

Richard Spafford, P.E.
Professional Engineer

210 Cedar Lake Point
Forked River, NJ 08731
(609) 242-1261 FAX (609) 242-6857

Richard Spafford
N.J. PROFESSIONAL ENGINEER #43642

DATE: 6/3/05

SCALE:
N.T.S.

JOB No.:
N/A


1 OF 1

NO.	DATE	DESCRIPTION	BY

Super Pump®

HIGH-PERFORMANCE PUMP SERIES

HIGH-PERFORMANCE PUMPS

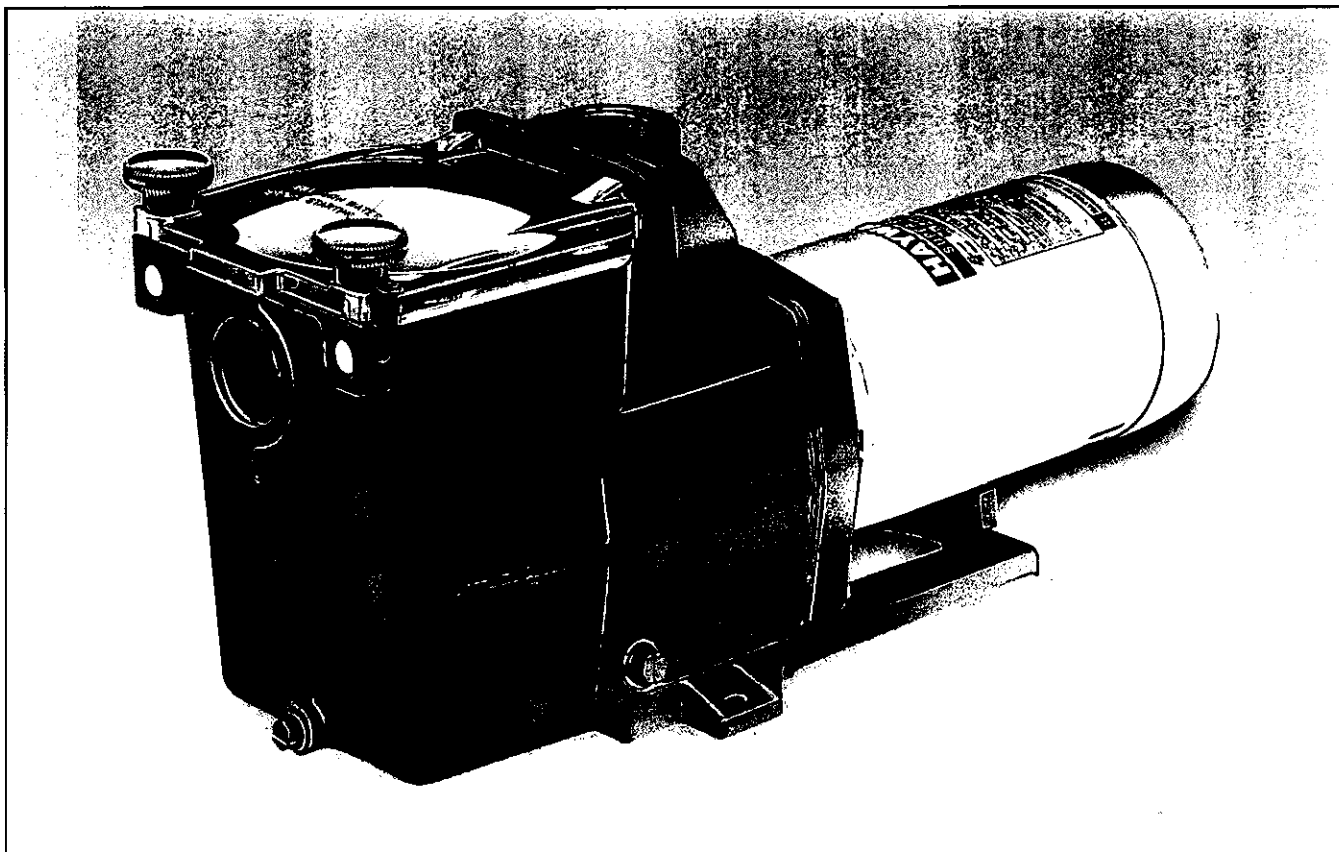

□ Super Pump: high performance and quiet operation.

Hayward's Super Pump is a series of large capacity, high technology pumps that blend cost-efficient design with durable corrosion-proof construction.

Designed for pools of all types and sizes, Super Pump features a large "see-thru" strainer cover, super-size debris basket and exclusive "service-ease"



design for extra convenience.

Quiet, efficient, dependable, and proven, the Super Pump has all the quality features



you expect from Hayward — the first choice of pool professionals.

HAYWARD®

Super Pump® High Performance Pump Series

Exclusive, Swing-Aside Hand Knobs make strainer cover removal easy. No tools required...no loose parts...no clamps.

Lexan® See-Thru Strainer Cover lets you see when basket needs cleaning and eliminates guesswork. Special self-adjusting seal assures dependable sealing.

All Components Molded of Corrosion-Proof PermaGlassXL™ for extra durability and long life.


Heavy-Duty, High-Performance Motor with air-flow ventilation for quieter, cooler operation.

Heat Resistant, Industrial Size Ceramic Seal. Long wearing, and 100% drip proof. For fresh or salt water use.

Mounting Base provides stable, stress-free support, plus versatility for any installation requirement. Adapts 48 and 56 frame motors.


Super-Size Housing has extra air handling capacity to assure rapid priming.

Totally Balanced, Corrosion-Proof Noryl® Impeller has smooth, wide openings to prevent fouling or clogging. Energy-efficient design produces more flow at equivalent horsepower.

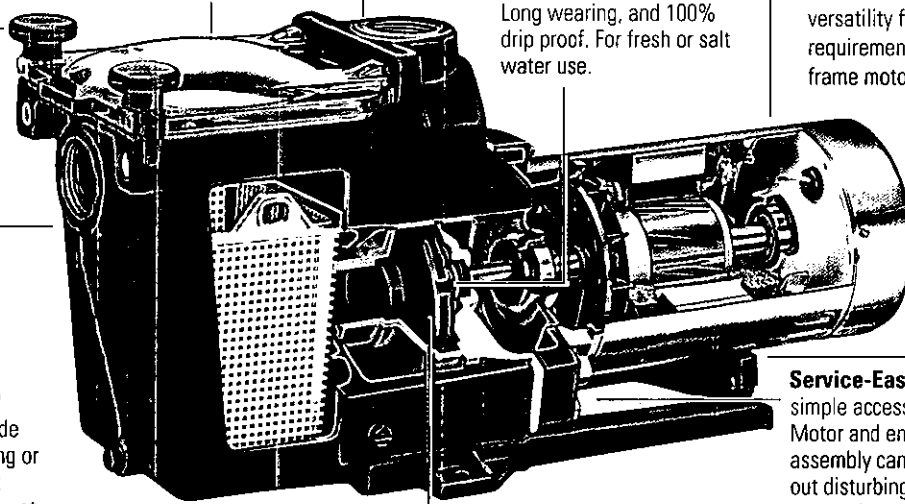



Service-Ease Design gives simple access to all internal parts. Motor and entire drive group assembly can be removed, without disturbing pipe or mounting connections, by disengaging just four bolts.

Overall Dimensions

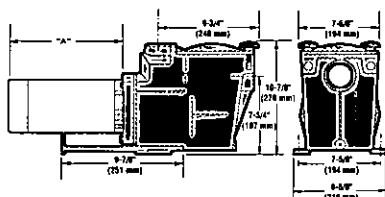

Model	Motor Power		Pipe Size	Dimension "A"	
	HP	KW	inch	inch	mm
SP2600X5	1/2	0.37	1 1/2"	11 1/4"	286
SP2605X7	3/4	0.56	1 1/2"	11 3/8"	295
SP2607X10	1	0.75	1 1/2"	11 7/8"	302
SP2610X15	1 1/2	1.12	1 1/2"	12 1/4"	311
SP2615X20	2	1.49	2"	13 1/4"	337
SP2621X25	2 1/2	1.86	2"	13 3/4"	349

Super Pumps are also available with dual speed motors.

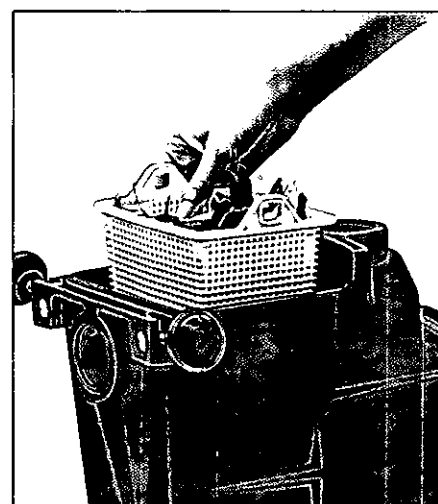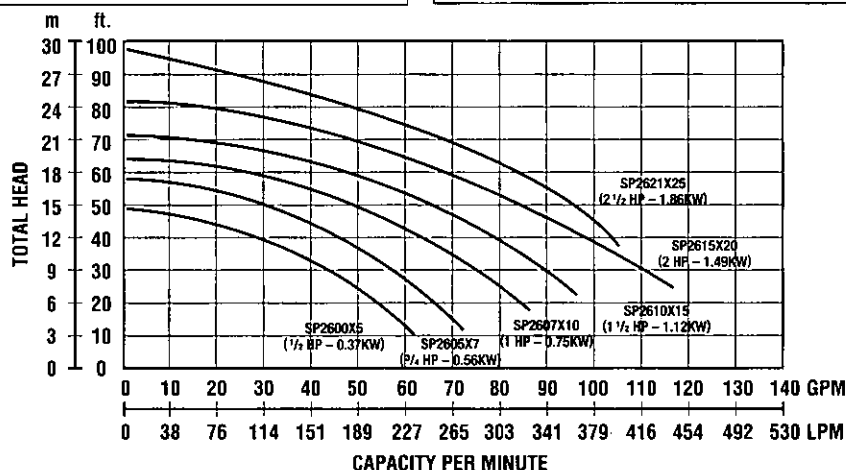

SUPER-SIZE 110 CUBIC INCH BASKET has extra leaf-holding capacity and extends time between cleanings. Rigid construction with load-extender ribbing assures free flowing operation for heavy debris loads.


Super Pump® Series Pumps are listed by:



HAYWARD®

Pro™ Series

TOP-MOUNT SAND FILTERS

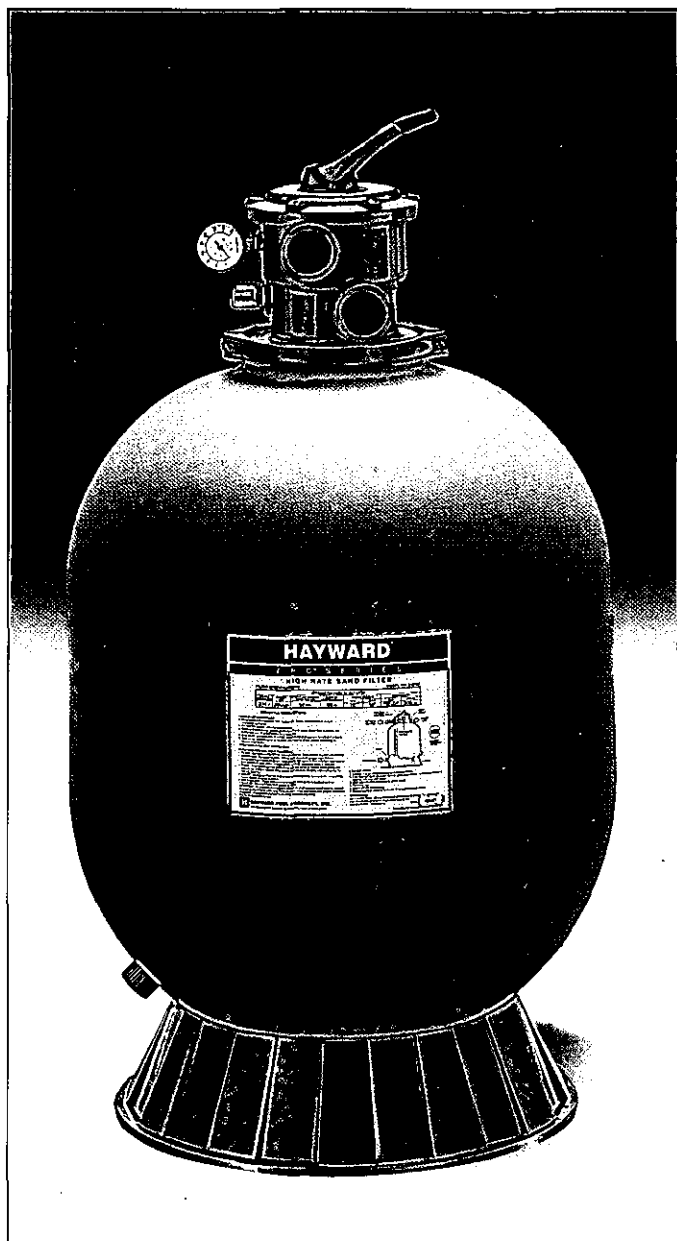

■ Pro-Series S244T 24" filter, shown with Vari-Flo™ top-mount filter control valve.

Hayward Pro Series sand filters are the very latest in pool filter technology, and produce crystal clear, sparkling water with only minimum care.



Molded of durable, corrosion-proof polymeric materials, they feature attractive, unitized construction, and self-cleaning 360°

slotted laterals for smooth, efficient flow and totally-balanced backwashing. Plus, a versatile seven-position control valve allows for easy operation and maximum efficiency.

Pro Series filters set a new standard for performance, value and dependability. And you know it's quality throughout because it's made by Hayward — the first choice of pool professionals.



HAYWARD®

Pro™ Series Top-Mount Sand Filters

Flange Clamp Design allows 360° rotation of valve to simplify plumbing.


Integral Top Diffuser assures even distribution of water over the top of the sand media bed. Full-size internal piping gives smooth, free-flowing performance.

Unitized, Corrosion-Proof Filter Tank molded of tough, durable, colorfast polymeric material for dependable, all-weather performance with only minimal care.

Efficient, Multi-Lateral Underdrain Assembly with precision engineered, self-cleaning 360° slotted laterals gives totally balanced flow and backwashing.


Integral Molded Drain Plug for easy draining of tank, without the loss of sand.

Totally Corrosion-Proof Base is rugged and attractively styled to provide strong, stable support.

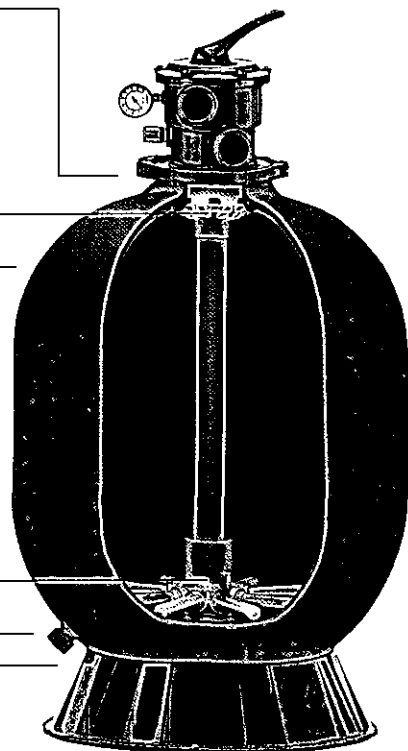

Specifications – Pro Series High-Rate Sand Filters

FILTER TYPE:	High-Rate Sand: No. 1/2 Silica Sand (.45mm – .55mm)
FILTER TANK:	Molded Polymeric
UNDERDRAIN:	360° Self Cleaning Slotted Laterals, Precision Installed in Ball Joint Assembly
CONTROL VALVE:	1½ or 2" 7-Position, Top-Mount Vari-Flo™ With Lever-Action Handle
VALVE FASTENING:	Flange Clamp Design
SUPPORT BASE:	Injection-Molded ABS
PERFORMANCE RANGE:	½ to 3 HP (30 to 120 GPM) .37 to 2.2 KW (114 to 454 LPM)
DIMENSIONS:	S180T–18½" W x 35" H (470 mm x 889 mm) S210T–20½" W x 38" H (521 mm x 965 mm) S220T–22½" W x 41" H (572 mm x 1041 mm) S244T–24½" W x 42" H (622 mm x 1067 mm) S310T2–30½" W x 48" H (775 mm x 1219 mm)

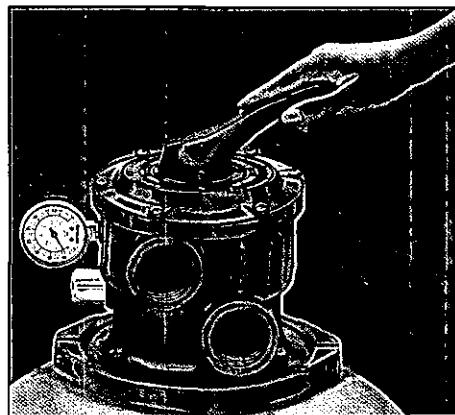


Vari-Flo™ 7-Position Control Valve with easy-to-use lever-action handle lets you "dial" any of seven valve/filter functions.

Performance Data

MODEL NUMBER	EFFECTIVE		DESIGN		TURNOVER				SAND	
	FILTRATION AREA		FLOW RATE*		8 Hr.	10 Hr.	8 Hr.	10 Hr.	REQUIRED	
	ft. ²	m ²	GPM	LPM	GALLONS		KILO LITERS		lbs.	kgs.
S180T	1.75	0.163	35	132	16,800	21,000	63.59	79.48	150	68
S210T	2.20	0.205	44	167	21,120	26,400	79.94	99.92	200	91
S220T	2.64	0.246	52	197	24,960	31,200	94.47	118.09	250	114
S244T	3.14	0.292	62	235	29,760	37,200	112.64	140.80	300	136
S310T2	4.91	0.457	98	371	47,040	58,800	178.05	222.56	500	227

*Based upon 20 GPM per ft.² (814 LPM per m²). Maximum allowable NSF rating.




Patented Service Ease Design

Unique folding ball-joint design allows lateral assembly to be easily accessed for simple servicing.

HAYWARD®

Super Pump®

HIGH-PERFORMANCE PUMP SERIES

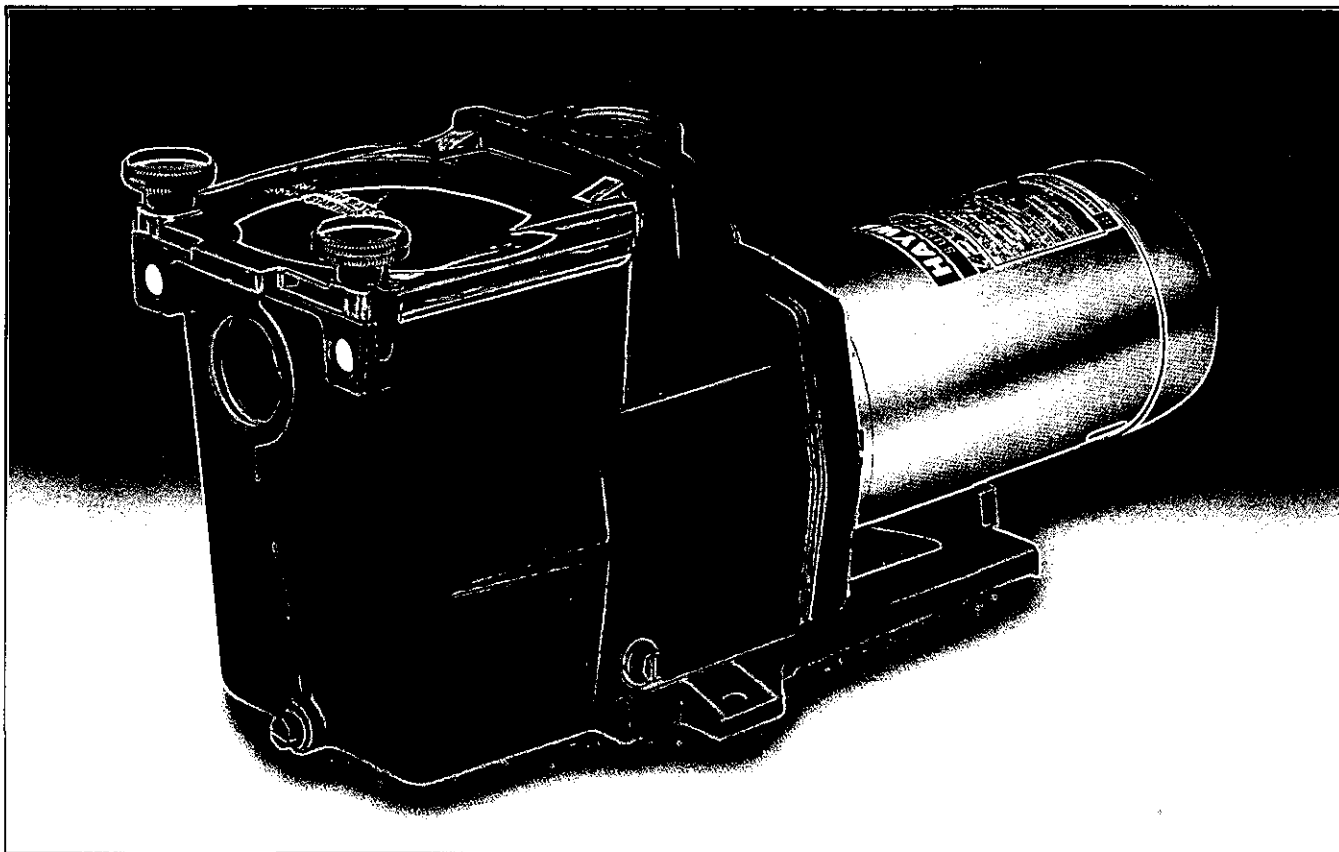

■ Super Pump: high performance and quiet operation.

Hayward's Super Pump is a series of large capacity, high technology pumps that blend cost-efficient design with durable corrosion-proof construction.

Designed for pools of all types and sizes, Super Pump features a large "see-thru" strainer cover, super-size debris basket and exclusive "service-ease"



design for extra convenience.

Quiet, efficient, dependable, and proven, the Super Pump has all the quality features



you expect from Hayward — the first choice of pool professionals.

HAYWARD®

Super Pump® High Performance Pump Series

Exclusive, Swing-Aside Hand Knobs make strainer cover removal easy. No tools required...no loose parts...no clamps.

Lexan® See-Thru Strainer Cover lets you see when basket needs cleaning and eliminates guesswork. Special self-adjusting seal assures dependable sealing.

All Components Molded of Corrosion-Proof PermaGlassXL™ for extra durability and long life.

Heavy-Duty, High-Performance Motor with air-flow ventilation for quieter, cooler operation.


Heat Resistant, Industrial Size Ceramic Seal. Long wearing, and 100% drip proof. For fresh or salt water use.

Mounting Base provides stable, stress-free support, plus versatility for any installation requirement. Adapts 48 and 56 frame motors.


Super-Size Housing has extra air handling capacity to assure rapid priming.

Totally Balanced, Corrosion-Proof Noryl® Impeller has smooth, wide openings to prevent fouling or clogging. Energy-efficient design produces more flow at equivalent horsepower.

Service-Ease Design gives simple access to all internal parts. Motor and entire drive group assembly can be removed, without disturbing pipe or mounting connections, by disengaging just four bolts.


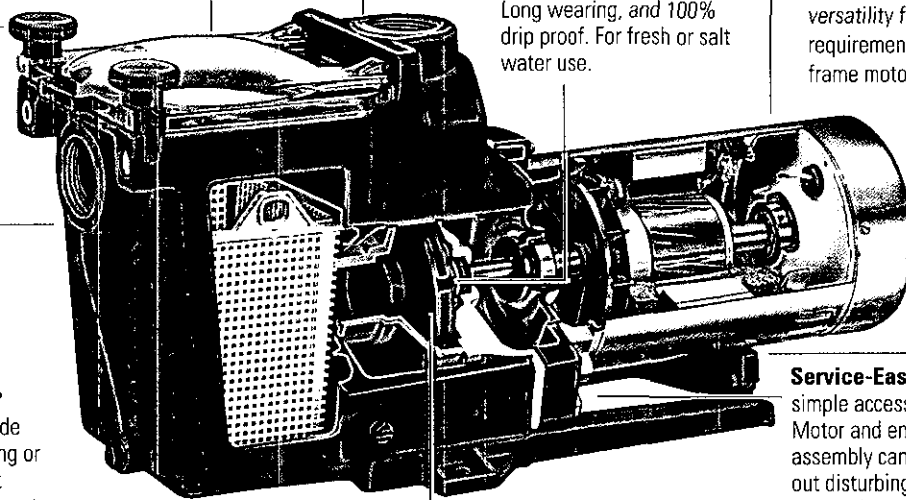


Overall Dimensions

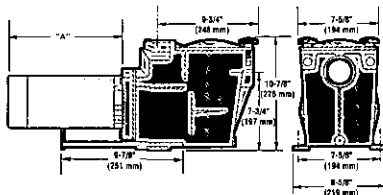

Model	Motor Power		Pipe Size	Dimension "A"	
	HP	KW	inch	inch	mm
SP2600X5	1/2	0.37	1 1/2"	11 1/4"	286
SP2605X7	3/4	0.56	1 1/2"	11 5/8"	295
SP2607X10	1	0.75	1 1/2"	11 7/8"	302
SP2610X15	1 1/2	1.12	1 1/2"	12 1/4"	311
SP2615X20	2	1.49	2"	13 1/4"	337
SP2621X25	2 1/2	1.86	2"	13 3/4"	349

Super Pumps are also available with dual speed motors.

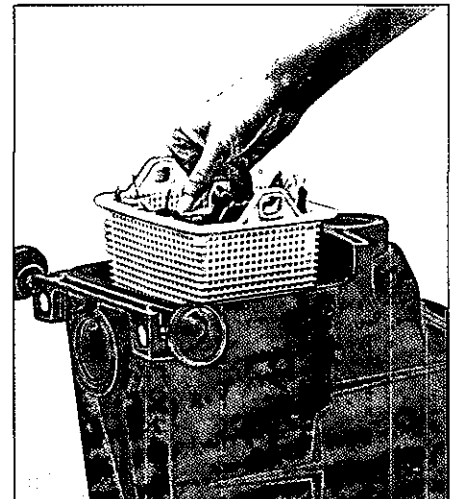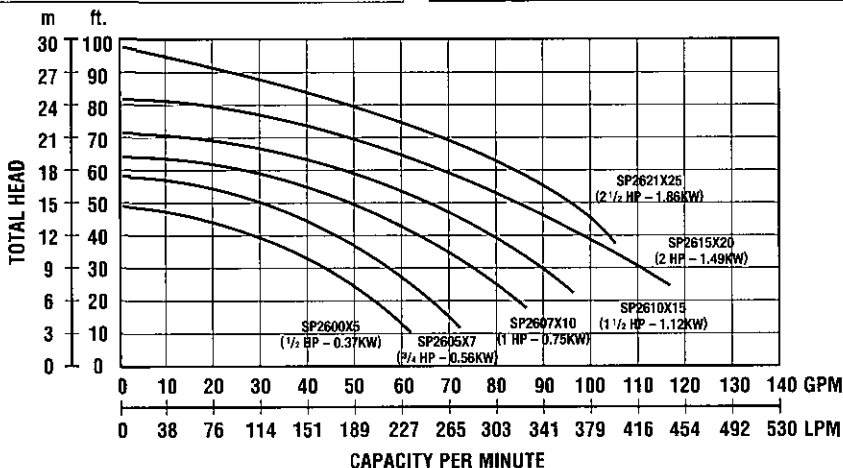

SUPER-SIZE 110 CUBIC INCH BASKET has extra leaf-holding capacity and extends time between cleanings. Rigid construction with load-extender ribbing assures free flowing operation for heavy debris loads.


Super Pump® Series Pumps are listed by:



HAYWARD®

Pro™ Series

TOP-MOUNT SAND FILTERS

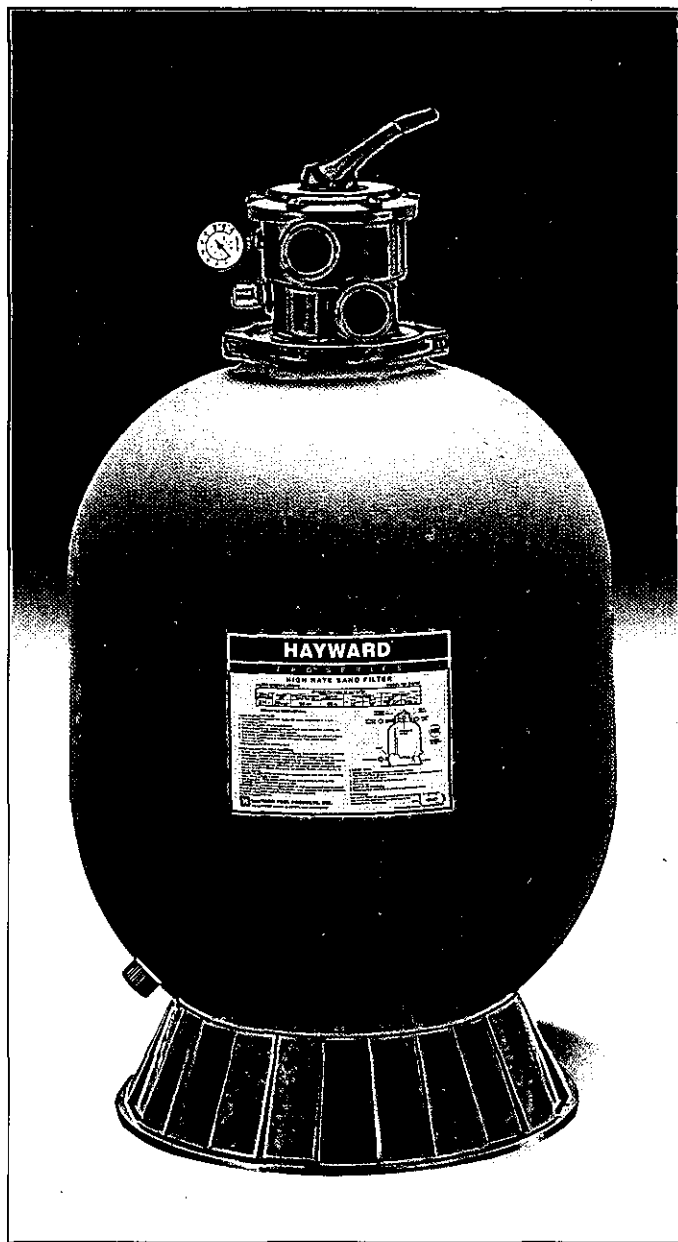

■ Pro-Series S244T 24" filter, shown with Vari-Flo™ top-mount filter control valve.

Hayward Pro Series sand filters are the very latest in pool filter technology, and produce crystal clear, sparkling water with only minimum care.



Molded of durable, corrosion-proof polymeric materials, they feature attractive, unitized construction, and self-cleaning 360°

slotted laterals for smooth, efficient flow and totally-balanced backwashing. Plus, a versatile seven-position control valve allows for easy operation and maximum efficiency.

Pro Series filters set a new standard for performance, value and dependability. And you know it's quality throughout because it's made by Hayward — the first choice of pool professionals.



HAYWARD®

HIGH-RATE SAND FILTERS

Pro™ Series Top-Mount Sand Filters

Flange Clamp Design allows 360° rotation of valve to simplify plumbing.


Integral Top Diffuser assures even distribution of water over the top of the sand media bed. Full-size internal piping gives smooth, free-flowing performance.

Unitized, Corrosion-Proof Filter Tank molded of tough, durable, colorfast polymeric material for dependable, all-weather performance with only minimal care.

Efficient, Multi-Lateral Underdrain Assembly with precision engineered, self-cleaning 360° slotted laterals gives totally balanced flow and backwashing.


Integral Molded Drain Plug for easy draining of tank, without the loss of sand.

Totally Corrosion-Proof Base is rugged and attractively styled to provide strong, stable support.

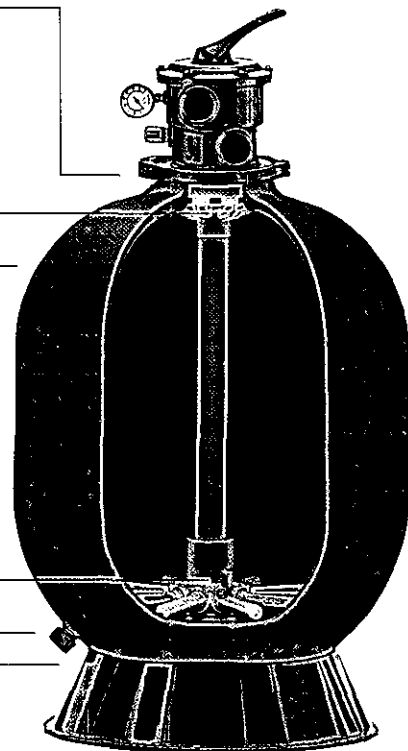

Specifications – Pro Series High-Rate Sand Filters

FILTER TYPE:	High-Rate Sand: No. 1/2 Silica Sand (.45mm – .55mm)
FILTER TANK:	Molded Polymeric
UNDERDRAIN:	360° Self Cleaning Slotted Laterals, Precision Installed in Ball Joint Assembly
CONTROL VALVE:	1 1/2 or 2" 7-Position, Top-Mount Vari-Flo™ With Lever-Action Handle
VALVE FASTENING:	Flange Clamp Design
SUPPORT BASE:	Injection-Molded ABS
PERFORMANCE RANGE:	1/2 to 3 HP (30 to 120 GPM) .37 to 2.2 KW (114 to 454 LPM)
DIMENSIONS:	S180T–18 1/2" W x 35" H (470 mm x 889 mm) S210T–20 1/2" W x 38" H (521 mm x 965 mm) S220T–22 1/2" W x 41" H (572 mm x 1041 mm) S244T–24 1/2" W x 42" H (622 mm x 1067 mm) S310T2–30 1/2" W x 48" H (775 mm x 1219 mm)

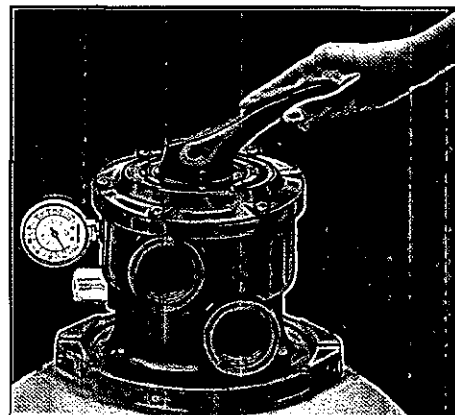


Vari-Flo™ 7-Position Control Valve with easy-to-use lever-action handle lets you "dial" any of seven valve/filter functions.

Performance Data

MODEL NUMBER	EFFECTIVE		DESIGN		TURNOVER				SAND	
	FILTRATION AREA		FLOW RATE*		8 Hr.	10 Hr.	8 Hr.	10 Hr.	REQUIRED	
	ft. ²	m ²	GPM	LPM	GALLONS		KILO LITERS		lbs.	kgs.
S180T	1.75	0.163	35	132	16,800	21,000	63.59	79.48	150	68
S210T	2.20	0.205	44	167	21,120	26,400	79.94	99.92	200	91
S220T	2.64	0.246	52	197	24,960	31,200	94.47	118.09	250	114
S244T	3.14	0.292	62	235	29,760	37,200	112.64	140.80	300	136
S310T2	4.91	0.457	98	371	47,040	58,800	178.05	222.56	500	227

*Based upon 20 GPM per ft.² (814 LPM per m²). Maximum allowable NSF rating.



Patented Service Ease Design


Unique folding ball-joint design allows lateral assembly to be easily accessed for simple servicing.

HAYWARD®

#12 THIN STAND.
TO All Pool Equipment.
All Bonding Done
with Insulated Solid #8
Green.
Copper lugs for Bonding

CPB ELECTRIC

732-244-2570

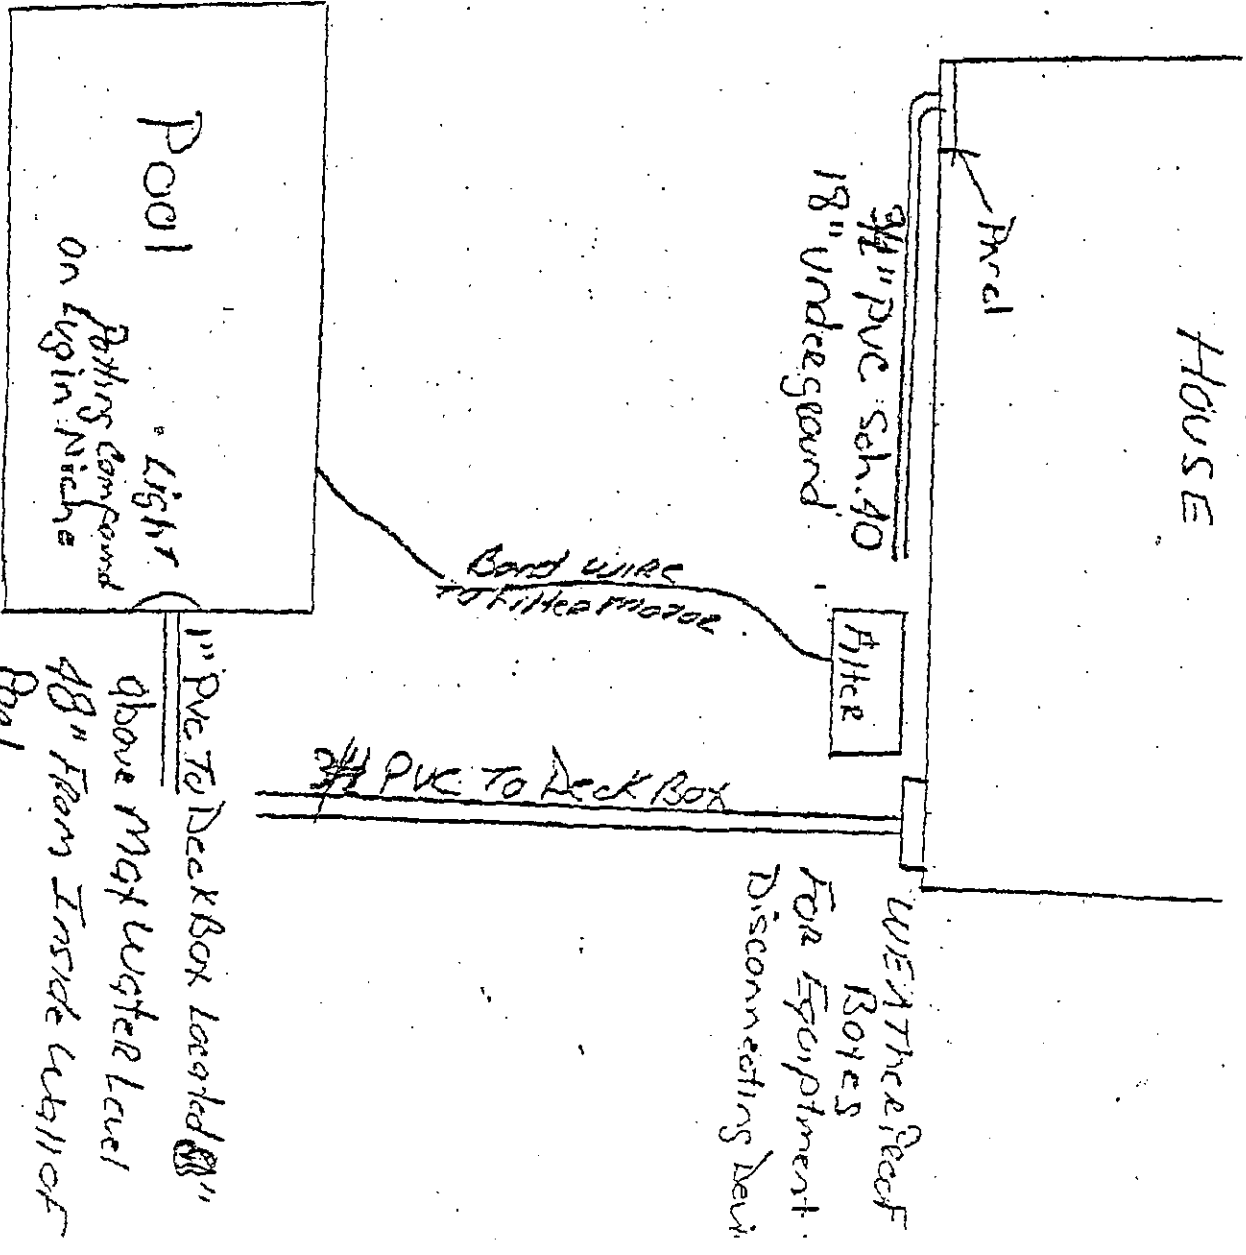

TOWNSHIP OF BRICK

OCEAN COUNTY, NEW JERSEY
401 CHAMBERS BRIDGE ROAD, BRICK, N.J. 08723

Joseph C. Scarpelli, Mayor

Township Council:

Ruthanne Scaturro - President
Michael A. Thulen, Sr. - Vice-President
Stephen C. Acropolis
Gregory S. Kavanagh
Anthony Matthews
Kathy M. Russell
Frederick J. Underwood, Sr.



Department of Administration & Finance
Division of Land Use and Planning

Sean Kinnevy
Zoning Officer
(732) 262-1041
skinn@twp.brick.nj.us

Kate MacDonald
Asst. Zoning Officer
(732) 262-1043
Fax: (732) 262-8954
kmacdon@twp.brick.nj.us
<http://www.twp.brick.nj.us>

July 14, 2005

Laurie Galindo
Pool Town Inc.
5500 Route 9 South
Howell, NJ 07731

Re: Block: 842 Lot: 27
1710 West Princeton Avenue

Dear Ms Galindo,

Your application for a zoning permit for a swimming pool on the referenced property cannot be approved because the application must be signed by the applicant. The applicant's name and signature must match.

Please amend your application and submit the required information to LisaRose Tavaluccio, Zoning Permit Clerk. Ms Tavaluccio can be reached at 732-262-1046 for further information. We will then be able to review your application.

Very Truly Yours,

Kate MacDonald
Assistant Zoning Officer

C: Scott R. MacFadden, Business Administrator
Michael P. Fowler, Principal Planner
Sean Kinnevy, Zoning Officer
LisaRose Tavaluccio, Zoning Permit Clerk
Daniel Newman, Construction Official

7/18/05 - Resubmitted - Not - Wrong

7/19/05 - Called Kate - Pool town will come in to correct application.

7/21/05 - Resubmitted - Not

HOMEOWNER'S POOL CERTIFICATION

FENCE REQUIREMENTS:

Outdoor private swimming pool: An outdoor private swimming pool, includes an in-ground, above-ground or on-ground pool, hot tub or spa shall comply with the following.


1. The top of the barrier shall be at least 48 inches above finished ground level measured on the side of the barrier which faces away from the swimming pool. The maximum vertical clearance between finished ground level and the barrier shall be 2 inches measured on the side of the barrier which faces away from the swimming pool. Where the top of the pool structure is above finished ground level, such as an above-ground pool, the barrier shall be at finished ground level, such as the pool structure, or shall be mounted on top of the pool structure. Where the barrier is mounted on the pool structure, the opening between the top surface of the pool frame and the bottom of the barrier shall not allow passage of a 4 inch diameter sphere.
2. Openings in the barrier shall not allow passage of a 4 inch diameter sphere.
3. Solid barriers shall not contain indentations or protrusions except for normal construction tolerances and tooled masonry joints.
4. Where the barrier is composed of horizontal and vertical members and the distance between the tops of the horizontal members is less than 45 inches, the horizontal members shall be located on the swimming pool side of the fence. Spacing between vertical members shall not exceed 1 1/4 inches in width. Decorative cutouts shall not exceed 1 1/4 inches in width.
5. Where the barrier is composed of horizontal and vertical members and the distance between the tops of the horizontal members is 45 inches or more, spacing between vertical members shall not exceed 4 inches. Decorative cutouts shall not exceed 1 1/4 inches in width.
6. Maximum mesh size for chain link fences shall be a 1 1/4 inch square unless the fence is provided with slats fastened at the top or the bottom which reduce the openings to not more than 1 1/4 inches.
7. Where the barrier is composed of diagonal members, such as a lattice fence, the maximum opening formed by the diagonal members shall be not more than 1 1/4 inches.
8. Access gates shall comply with the requirements of items 1 through 7, and shall be equipped to accommodate a locking device. Pedestrian access gates shall open outwards away from the pool and shall be self-closing and have a self-latching device. Gates other than pedestrian access gates shall have a self-latching device. Where the release mechanism of the self-latching device is located less than 54 inches from the bottom of the gate: (a) the release mechanism shall be located on the pool side of the gate at least 3 inches below the top of the gate and; (b) the gate and barrier shall not have an opening greater than 1/2 inch within 18 inches of the release mechanism.

BLOCK: 842 LOT: 27 ADDRESS: 1710 West Princeton Ave

In accordance with the NJAC 5:23-2.23, no pool shall be used in whole or in part until a Certificate of Approval has been issued by the Construction Official.

I certify that I am the owner of the above referenced pool being built. I further certify that the pool will not be used in whole or in part until a permanent fence is installed and a Certificate of Approval has been issued by the Construction Official.


I have read the fence requirements listed above and understand them.

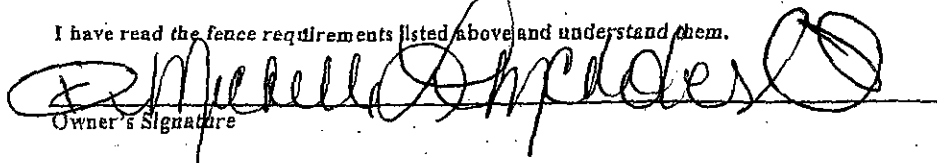
Owner's Signature

Print Name

Sworn and subscribed to before me on this

29th day of June 2008


Notary Signature

KATHLEEN L. PASCOCELLO
NOTARY PUBLIC OF NEW JERSEY
My Commission Expires
October 30, 2007

TOWNSHIP OF BRICK

OCEAN COUNTY, NEW JERSEY
401 CHAMBERS BRIDGE ROAD, BRICK, N.J. 08723

Joseph C. Scarpelli, Mayor

Township Council:

Ruthanne Scaturro - President
Michael A. Thulen, Sr. - Vice-President
Stephen C. Acropolis
Gregory S. Kavanagh
Anthony Matthews
Kathy M. Russell
Frederick J. Underwood, Sr.



Department of Engineering
Office of the Municipal Engineer
(732) 262-1038
Fax: (732) 262-8954
<http://www.twp.brick.nj.us>

INGROUND POOL INSPECTION FORM

NAME: <u>Mc Roberts</u>	CONTRACTOR: <u>Pool Team</u>
ADDRESS: <u>1710 West Princeton Ave</u>	ADDRESS: <u>5500 Rt 9 South</u>
CITY: <u>Brick</u>	CITY: <u>Hammell</u>
STATE: <u>NJ</u> ZIP CODE: <u>08723</u>	STATE: <u>NJ</u> ZIP CODE: <u>07731</u>
PHONE NUMBER: <u>[REDACTED]</u>	PHONE NUMBER: <u>(732) 901-9071</u>
BLOCK: <u>842</u> LOT: <u>27</u>	STATE LICENSE NUMBER: <u>22 2763004</u>

TYOE OF INSPECTION	APPROVED	REJECTED	EXPLANATION
POOL LOCATION:	☒		
POOL ELEVATION:	☒		
CONCRETE WALKWAY:	☒		
CONSTRUCTION ENTRANCE:			
(A) CONCRETE CURB:			
(B) CONCRETE SIDEWALK:			
(C) ROAD PAVEMENT:			
RETAINING WALL:			
BULKHEAD:			
LANDSCAPE BERM:			
BACKWASH HOSE:	☒		
GRADING:	☒		
SOIL STABILIZATION:		☒	
ASBUILT REQUIRED:	YES	NO	
CLEAN UP:		☒	
SAFTEY:		☒	

All Dirt + Debris after concrete
Bottom Clean up in yard
Safety lock on gate

ENGINEER REVIEW BY: _____ DATE: _____
INSPECTORS NAME: R. Capom... DATE: 11/2/05

TOWNSHIP OF BRICK

OCEAN COUNTY, NEW JERSEY
401 CHAMBERS BRIDGE ROAD, BRICK, N.J. 08723

Joseph C. Scarpelli, Mayor

Township Council:

Stephen C. Acropolis – President
Gregory S. Kavanagh
Anthony Matthews
Kathy M. Russell
Ruthanne Scaturro
Michael A. Thulen, Sr.
Frederick J. Underwood, Sr.



Department of Engineering

Office of the Municipal Engineer

(732) 262-1038

Fax: (732) 262-8954

<http://www.twp.brick.nj.us>

Date: 7/7/05

Block: 842 Lot: 27

Property Address: 1710 West Princeton Ave.

I, Michelle McRoberts of 1710 West Princeton Ave
(name) (address)

request to be exempt from the plot plan requirement for an addition, fence, shed, deck, pool, retaining wall, ect. as outlined in the Brick Land Use Book, Chapter 190.31, Part B.

Michelle McRoberts
Applicant's Signature

The following shall be submitted with this request:

1. Submit surveys locating existing dwelling and proposed addition. Dimensions of the addition should be included.
2. Proof that the property is not located in a Flood Hazard Area.

Note: Prior to approval a site inspection by the Engineering Department will be performed to verify that the proposed addition will not create a drainage problem.

FOR OFFICE USE ONLY

Approved on: 7/29/05

Signed: [Signature]

Rejected on: _____

Signed: _____

Comments:

CERTIFICATE OF COMPLIANCE

Block 842 LOT 27 SITE ADDRESS 1715 West Princeton Ave
TYPE OF SITE Residential / Commercial NAME OF BUSINESS Pool & Fence
APPLICANT Laurie Gaiuso (Pool Town) PHONE NUMBER (332) 505-9000
APPLICANT ADDRESS 5500 Rt. 9-S CITY & STATE Howell, NJ 07231

INCLUSIONARY DEVELOPMENT

Affordable	Fee Required _____	Date _____
	Down Payment _____	Date _____
	Balance _____	Date _____
	Paid In Full _____	Date _____
Market Rate	No Fee Required	

STATUTORY DEVELOPER FEES

- ◇ Residential is .005 % PTO
- ◇ Commercial is .01%
- ◇ The estimated equalized assessed value of the proposed construction is

\$ \$15,000

Frederick R. Millman, CTA, Tax Assessor

7/26/05
Date

- ◇ The final equalized assessed value of the construction at the above referenced site is:

\$ 10,200

Frederick R. Millman

Frederick R. Millman, CTA, Tax Assessor

11/10/05
Date

Provisional Fee
Check #

\$ 75.00

33553

Date

7/28/05

Receipt #

Final Fee
Check #

\$27.00

1694

Date

10/16/06

Receipt #

Total Fee Due/Paid
Balance Due

~~\$150.00~~ *102.00

Fees Imposed To Date

Fees Reached \$15,000 _____ Date _____

I hereby certify that the above applicant has complied with all rules and regulations of the Office of Affordable Housing and has paid all required fees and charges.

Prelim

2/6/05

2/6/05 - mailed letter

7/05 - final

11/05 - paid. Pool Town

Jim Bogar
Office of Affordable Housing

9/19/06 - called Pool Town Jennifer

10/4/06
Final inspection completed
violations to be issued
by Bernadette