

1/2/83
Date

No. 5295-83

BOARD OF HEALTH OF LAKEMOND

CERTIFICATE OF COMPLIANCE

Issued to PATRICIA McLAUGHLIN
(Owner of Contractor)

THIS IS TO CERTIFY That the

INDIVIDUAL SEWAGE SYSTEM ✓

INDIVIDUAL WATER SYSTEM _____

INDIVIDUAL PLUMBING SYSTEM _____

Installed at Block No. 126

Lot. No. 9 is in compliance with the

Application for Permit to Locate and Construct or

Alter Such Systems.

No. 5295-83 dated 10-27-83

The issuance of this certification shall not be construed as a guarantee that the system will function satisfactorily nor shall it in any way restrict the powers or responsibilities of the Board of Health in the enforcement of any law or ordinance relating to public health.

Eli Feldman

MUNICIPALITY
Tabernash, CO

10-27-83
Pd 10 - C
received
2060

OCEAN COUNTY HEALTH DEPARTMENT
DATE: 10/27/83
FINAL INSPECTION
APPROVAL
INSPECTOR
OFFICE USE ONLY

APPLICATION FOR A PERMIT: County Copy

to locate and construct an individual Sewage System
to alter or supplement an existing Sewage System

LOCATION - ADDRESS 700 Valley Dr. BLK. 120 LOT 9
OWNER Patricia J. Modugno PHONE 363-8865

PRESENT ADDRESS same
GENERAL CONTRACTOR Manuelito Septic PHONE 349-6686

DIRECTIONS AND LANDMARKS TO LOCATION on E. back trail of Ventral Park

TYPE OF BUILDING TO BE SERVED home (OTHER THAN RESIDENTIAL CONSULT HEALTH DEPT.)
DWELLING UNIT: NO. OF BEDROOMS 3 EXPANSION ATTIC, DEN OR REC. ROOM, YES NO
DIMENSIONS OF PROPERTY: 80 X 179 SQUARE FT. OR ACRES

SEPTIC TANK: Shape round Material pre-cast concrete
Capacities: Required Gal. 908 Designed for 1000 Gals.

DISPOSAL TRENCHES: Width Min. & Max. Depth Min. & Max.
Lineal Ft. of Trenches Distance between Trenches Type of Pipe
Required Square Footage Designed Square Footage

Amount of Stone (in inches) below Above Disposal Pipe
DISPOSAL BBD: Width length Disposal Area Sq. Ft.
Ft. of Pipe Type of Pipe Distance between pipe

Min. & Max. Depth of Bed Amt. of Stone (in inches) below Above Disposal Pipe
Required Square Ft. Designed Square Ft.
SEEPAGE FIT: Number 2 Shape round Material pre-cast concrete

Diameter or Width 7 Liquid Depth 5 Single unit Sq. Ft. 137
Total Required Sq. Ft. 165 Total Designed Sq. Ft. 171 Amt. Size & Type of Stone crushed
PERCOLATION TESTS
SOIL BORING LOG

HOLE NO.	NO. OF SATURATIONS	DEPTH	PERC. RATE MIN PER IN.	SOIL LAYER, TYPE, THICKNESS, GROUND WATER
				1' to 12' sand no water

Date Submitted to Health Dept.



Performed by License No.
Address Phone

If Witnessed, by Whom

Date of Tests Weather Conditions to be Considered
Installing CONTRACTOR James J. Anderson Phone # 349-6686

OWNER'S Signature (Acknowledging design & installer)

Valley Dr.

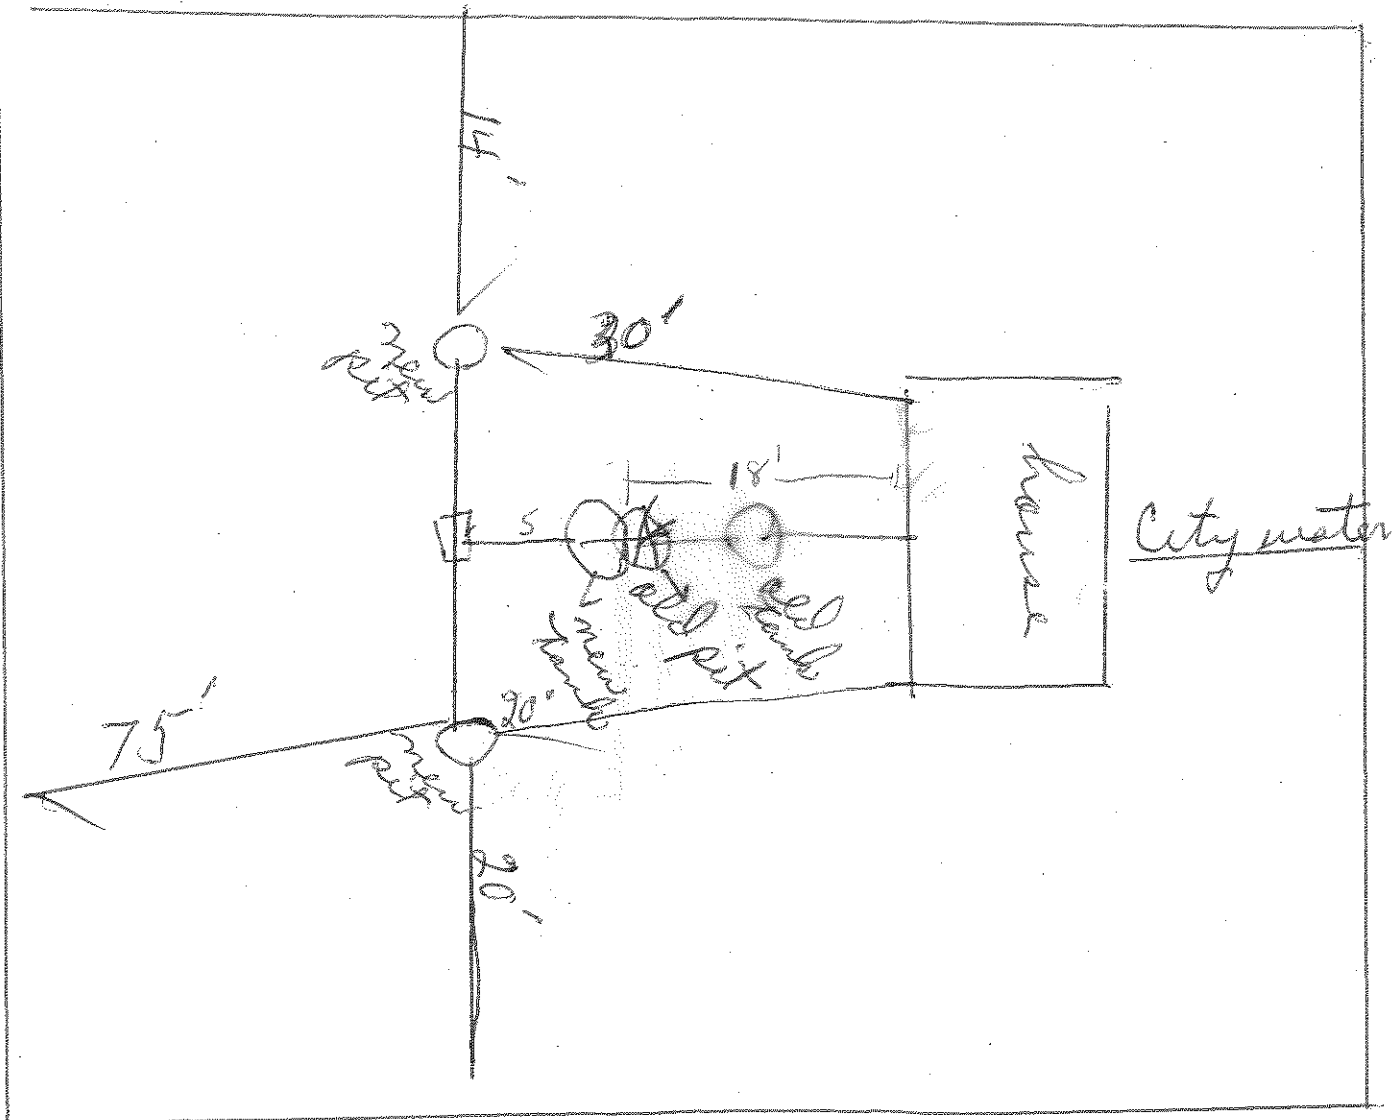

NOTES:

1. Make an accurate sketch showing the following with clear measurements in feet, to at least two permanent points, lot dimensions, location of house, location of each unit of disposal system, all buildings, trees in disposal area and wells. Include neighboring sewage systems, buildings, wells and all water courses, permanent or fluctuating. Location of perc test and soil boring holes.
2. Submit (4) four Complete Legible Copies of Applications.
3. Design, materials and workmanship will be in strict accordance with Township Ordinances and State Laws especially Chapter 199 P.L. 1954 Revised 1963 and any forthcoming revisions.
4. Include any pertinent information.
5. Health Dept. has fifteen (15) days by law to process application.

2413038

NO HEALTH APPROVE
DATE 6/14/83

Permit No.

Fee \$

DATE 6/14/83
FINAL INSPECTION

461250

Board of Health of Lakewood, New Jersey County Copy

APPLICATION FOR PERMIT TO LOCATE AND CONSTRUCT AN INDIVIDUAL DISPOSAL SYSTEM

DATE 6/10/83

LOCATION-ADDRESS 725 Valley Rd or BLOCK NO. 12-5 LOT NO. 9
Number Street

OWNER (print) P.G. McLaughlin

PRESENT ADDRESS SAME

NAME AND ADDRESS OF CONTRACTOR (print) F. R. C. ON ONE SED 928-3600

At 361-A R.O. 2 SEABOARD

TYPE OF BUILDING TO BE SERVED USE: YEARLY SUMMER

DWELLING UNIT - NUMBER OF BEDROOMS 4 EXPANSION ATTIC: YES NO X

OTHER - TYPE OF BUILDING GALLONS PER PERSON

TYPE OF FACILITIES PERSONS

SIZE OF LOT 77-178 16000 AREA SQ. FT.

SEPTIC TANK - Liquid Capacity 1250 Shape Rect Material Percast

Width 5 1/2 Length 8' Diameter

Liquid Depth 59" Distance from liquid level to underside of top 4"

LIQUID DISPOSAL - Disposal Trenches Disposal Bed Seepage Pits

DISPOSAL TRENCHES - Width Depth Lin. Feet of Pipe

Distance between lines Type of pipe

DISPOSAL BED - Width Length Area in sq. ft.

Linear feet of pipe Type of pipe

Distance between lines

SEEPAGE PITS - Number 12 Diameter 4 1/2 x 8'

Depth delow inlet 7'6" Distance between pits 20'

Shape of pits Rect Construction material Percast

Depth of permeable material to be penetrated 12'

PERCOLATION TESTS RESULTS

PERFORMED BY

DATE


No water within 100'

SAT
6/14/83

gd

Sketch of Proposed Installation

Soil Log

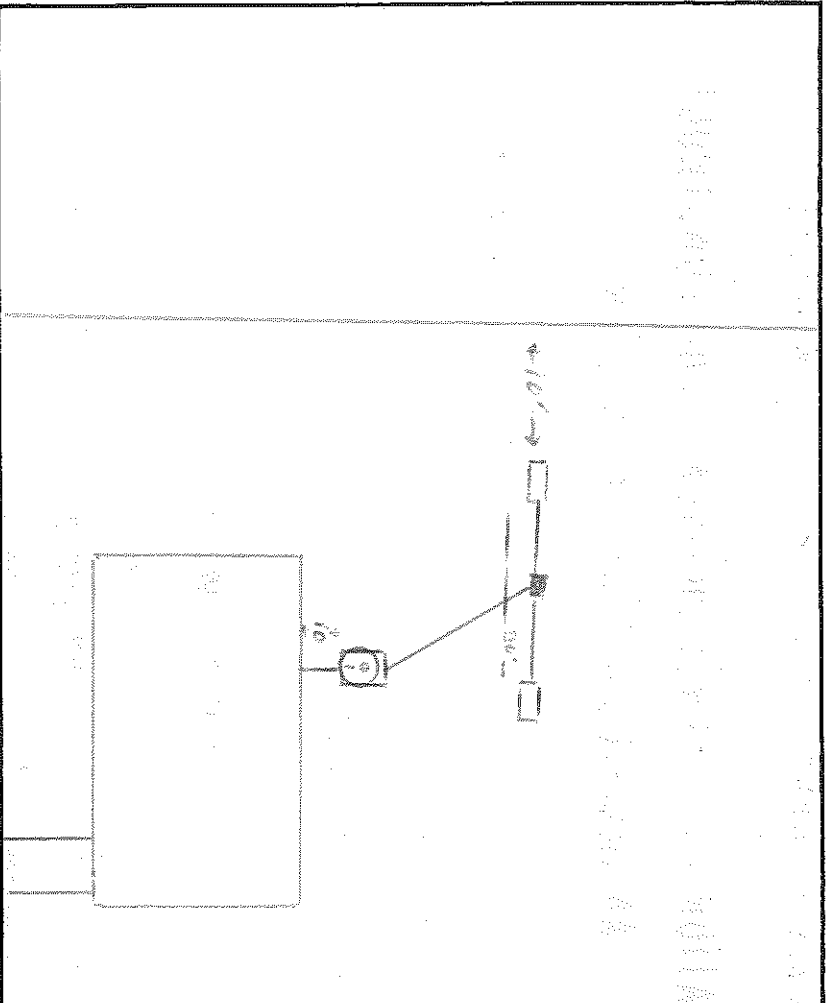

8" Gray Sand
24" Sand Gravel
12" Orange Sand
No water

city water

S. T. - (Show capacity in gallons and Manufacturer's Name)

S. P. - (Show area in square feet, below inlet not including bottom and Manufacturer's Name)

Certify:

Design of individual sewerage disposal system and individual water system in accordance with the Individual Sewage Disposal System Code of New Jersey - 1963

WATER AND SEWERAGE PLAN

Block 10-G Lot 9

Township of Lakewood, County of Ocean
New Jersey