

PURCHASE ORDER REQUISITION

VENDOR	DEPARTMENT	ACTIVITY	REQ. NO.
METRO FIRE 509 WASHINGTON AVE. CARLSTADT NJ 07072	Buildings & Grounds	OUTSIDE CONTRACTOR	61
	VENDOR NO	P.O. NO.	DATE 5/9/2022

ITEM	QUANTITY	DESCRIPTION	ACCOUNT	COST
1	1	FIRE ALARM INSPECTION	1-018-501- 20-55	525.00
2		FUEL SURCHARGE		5.00
3		DATED 4/30/22 INV.#SM46280		
4		CARLSTADT CIVIC CENTER		
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
TOTAL:				\$530.00

MAYOR/COMMISSIONER APPROVAL

5/10/22 
DATE SIGNATURE

BOROUGH OF CARLSTADT
500 MADISON STREET
CARLSTADT, NJ 07072

DEPARTMENTAL CERTIFICATION

5/9/2022
DATE DEPARTMENT HEAD

CERTIFICATION OF FUNDS

5/10/22 
DATE SIGNATURE
CMFO/TREASURER



509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 46280

Invoice Date: 4/30/2022

Completion Date: 4/29/2022

Technician: Toro, Daniel

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt Civic Center
424 Hackensack Street
Carlstadt, NJ 07072

Division: Alarms - Service/Repair
Description: A-Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 5/10/2022

WO#	Item	Description	Qty	Unit Price	Amount
51477	Service				
		A - Fire Alarm Inspection	1.00	525.00	525.00
		(1) Potter Fire Guard 4000 fire alarm system			
		A - Fuel Surcharge	1.00	5.00	5.00

The Fire Safety Professionals Since 1962

Subtotal:	530.00
Sales Tax:	0.00
Total Due:	530.00

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Inspection and Testing Form - Fire Alarm - Pass

Devices	Tested this Inspection	Pass	Fail	Tested YTD	Not Tested YTD	Total
Horn Strobe	3	3	0	3	0	3
Smoke Detector	26	26	0	26	0	26
Heat Detector	6	6	0	6	0	6
Carbon Monoxide Detector	13	13	0	13	0	13
Pull Station	4	4	0	4	0	4
Annunciator	1	1	0	1	0	1

Report of Inspection / Test

Annual NFPA 72-13



2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com

Monitoring Entity

Contact Name	Supreme	Telephone	n/a
Reference Number	n/a	Type Transmission	POTS

Approving Agency

Contact Name	Fire Department	Telephone	201-4384300
Email	n/a	Service Type	N/A

System Type

Control Unit Manufacturer	Potter	Model Number	Fire Guard 4000
Circuit Styles	B	Software Revision	N/A
Date Last Serviced	2022-04-29	Last Date and Software or Configuration was Revised	N/A
Number of Circuits	5		

Power Supply

Main Nominal Voltage	120	Main Nominal Amps	20
Overcurrent Protection	Circuit Breaker	Panel Board Location	Mechanical Room Panel B
Disconnecting Means Location	CB 32	Secondary Standby	2x12vdc
Storage Battery: Amp Hour Rating	7 ah	Calculated Capacity to operate system (Hours)	N/A
Engine-driven generator dedicated to fire alarm system	n/a	Location of fuel storage	n/a
Has Emergency System described in NFPA 70, Article 700	n/a	Has Legally required standby described in NFPA 70, Article 701	N/A
Has Optional standby system described in NFPA 70, Article 702, which also meets the performance requirements of Article 700 or 701	N/A		

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



NOTIFICATIONS MADE PRIOR TO ANY TESTING		Yes	No	N/A	Who	Time
Building Occupants		☒	☐	☐		
AHJ Notified of Any Impairments		☐	☐	☒		
Building Management		☒	☐	☐		
Other (Specify)		☐	☐	☒		
Monitoring Entity		☒	☐	☐	Carlstadt PD	
SYSTEM TESTS AND INSPECTIONS	Visual	Functional	Pass/Fail	Comments		
Functional Test	Yes	Yes	Pass			
Trouble Signals	Yes	Yes	Pass			
Interface Equipment	N/A	N/A	N/A			
Supervision	Yes	Yes	Pass			
Ground-Fault Monitoring	N/A	N/A	N/A			
In-building MNS to wide area MNS	N/A	N/A	N/A			
System Intelligibility - STI	N/A	N/A	N/A			
Primary Power Supply	Yes	Yes	Pass			
Local Annunciator	N/A	N/A	N/A			
MNS to Fire Alarm Interface	N/A	N/A	N/A			
Power Extender Panels	N/A	N/A	N/A			
Prerecorded Message Content	N/A	N/A	N/A			
Software Backup Performed	N/A	N/A	N/A			
CCU Security Mechanism	N/A	N/A	N/A			
Remote Annunciator	Yes	Yes	Pass			
Sound Pressure Level- Ambient	N/A	N/A	N/A			
Reset/Power down Test	Yes	Yes	Pass			
Isolation Modules	N/A	N/A	N/A			
System Intelligibility - CSI	N/A	N/A	N/A			
Test Backup Software	N/A	N/A	N/A			
Fuses	N/A	N/A	N/A			
UPS Power Test	N/A	N/A	N/A			

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Other (Specify)	N/A	N/A	N/A	
Sound Pressure Level- Alarm	N/A	N/A	N/A	
MNS to direct recipient MNS	N/A	N/A	N/A	
Lamps/LEDS	Yes	Yes	Pass	
Control Unit	Yes	Yes	Pass	
Disconnect Switches	N/A	N/A	N/A	
Fire Alarm to MNS Interface	N/A	N/A	N/A	
Prerecorded Message Activation	N/A	N/A	N/A	
SECONDARY POWER	Visual	Functional	Pass/Fail	Comments
Battery Condition	Yes	Yes	Pass	
Charger Test	N/A	N/A	N/A	
Discharge Test	Yes	Yes	Pass	
Transient Suppressors	N/A	N/A	N/A	
Load Voltage	Yes	Yes	Pass	
Remote Annunciators	N/A	N/A	N/A	
NOTIFICATION APPLIANCES	Visual	Functional	Pass/Fail	Comments
Voice Clarity	N/A	N/A	N/A	
Audible	Yes	Yes	Pass	
Speakers	N/A	N/A	N/A	
Visual	Yes	Yes	Pass	
EMERGENCY COMMUNICATION EQUIPMENT	Visual	Functional	Pass/Fail	Comments
Amplifier(s)	N/A	N/A	N/A	
Area of Refuge Communication System	N/A	N/A	N/A	
Phone Jacks	N/A	N/A	N/A	
System Audibility	N/A	N/A	N/A	
Call-in Signal	N/A	N/A	N/A	
Off-Hook Indicator	N/A	N/A	N/A	
Radio Communication Enhancement System	N/A	N/A	N/A	

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Elevator Emergency Communication System	N/A	N/A	N/A		
Tone Generator(s)	N/A	N/A	N/A		
Phone Set	N/A	N/A	N/A		
System Intelligibility	N/A	N/A	N/A		
System Performance	N/A	N/A	N/A		
Other (Specify)	N/A	N/A	N/A		
AUXILIARY FUNCTIONS/INTERFACE EQUIPMENT/SPECIAL HAZARDS	Visual	Functional	Pass/Fail	Comments	
Smoke Management/Smoke Control	N/A	N/A	N/A		
MNS Override of FA signals	N/A	N/A	N/A		
Smoke Damper Operation	N/A	N/A	N/A		
Door-Releasing Devices	N/A	N/A	N/A		
Fan Shutdown	N/A	N/A	N/A		
Smoke Shutter Release	N/A	N/A	N/A		
Door Unlocking	N/A	N/A	N/A		
Elevator Shunt-Trip	N/A	N/A	N/A		
Elevator Recall	N/A	N/A	N/A		
Other (Specify)	N/A	N/A	N/A		
SUPERVISING STATION MONITORING	Yes	No	N/A	Who	Time
Trouble Restoral	☐	☐	☒		
Supervisory Signal	☐	☐	☒		
Alarm Restoration	☐	☐	☒		
Supervisory Restoration	☐	☐	☒		
Trouble Signals	☐	☐	☒		
Alarm Signal	☐	☐	☒		
NOTIFICATIONS THAT TESTING IS COMPLETE	Yes	No	N/A	Who	Time
Monitoring Agency	☒	☐	☐	Carlstadt PD	
Other (Specify)	☐	☐	☒		
AHJ Notified of Any Impairments	☐	☐	☒		

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Building Occupants	☒	☐	☐		
Building Management	☒	☐	☐		

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



INITIATING, SUPERVISORY, AND NOTIFICATION DEVICE TESTS AND INSPECTIONS

Address	Location	Device Type	Factory Setting	Measured Setting	Visual	Functional	Pass/Fail
	By Front Doors	Pull Station			Yes	Yes	Pass (2022-04-29)
	By Front Door	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Front Waitin groom	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Locker Room Closet	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Hall by Bedroom 1	Horn Strobe			Yes	Yes	Pass (2022-04-29)
	Bedroom 1	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Bedroom 2	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Bedroom 2	Heat Detector			Yes	Yes	Pass (2022-04-29)
	Playroom	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Playroom	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Playroom by Stair	Pull Station			Yes	Yes	Pass (2022-04-29)
	Private Office	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Private Office	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Men's Room	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Women's Room	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Top of Stairs	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Civil Center Front Door	Pull Station			Yes	Yes	Pass (2022-04-29)

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Address	Location	Device Type	Factory Setting	Measured Setting	Visual	Functional	Pass/Fail
	Civil Center Front Door	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Man Area Left	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Man Area Left	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Man Area Left	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Man Area Left	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Man Area Right	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Man Area Right	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Man Area Right	Pull Station			Yes	Yes	Pass (2022-04-29)
	Men's Room	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Main Area	Horn Strobe			Yes	Yes	Pass (2022-04-29)
	Main Area	Horn Strobe			Yes	Yes	Pass (2022-04-29)
	2nd Floor Stair	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Garage Left	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Garage Right	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Top of the Stairs	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Generator Room	Heat Detector			Yes	Yes	Pass (2022-04-29)
	Oxygen Room	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Oxygen 2 room	Heat Detector			Yes	Yes	Pass (2022-04-29)

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Address	Location	Device Type	Factory Setting	Measured Setting	Visual	Functional	Pass/Fail
	Medical Supply Room	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Generator room	Heat Detector			Yes	Yes	Pass (2022-04-29)
	Boiler room	Heat Detector			Yes	Yes	Pass (2022-04-29)
	Front Lobby of Emergency Center	Annunciator			Yes	Yes	Pass (2022-04-29)
	Kitchen	Heat Detector			Yes	Yes	Pass (2022-04-29)
	Entrance	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Living room	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Hall by bedroom	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Bedroom	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Living room by kitchen	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Kitchen	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Women's room	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Men's room	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	By FACP	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Upstairs kitchen	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Upstairs women's room	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Upstairs men's room	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)
	Upstairs	Carbon Monoxide Detector			Yes	Yes	Pass (2022-04-29)

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Control Panel and Battery Readings

Location: Boiler room				
Manufacturer: Potter				
Model: Fireguard 4000				
AC Power Supply Volts AC	DC Power Supply Volts DC	Load Test %	Battery w/Charger	Battery w/Out Charger
120VAC	24VDC			
Battery Date	AC Loss Causes Trouble	DC Loss Causes Trouble	Battery Voltage & AH Rating	Ground Fault
	Yes	Yes	12V 7AH	
Battery Voltage AH Rating	Battery Voltage AH Rating w/Charger	Battery Voltage AH Rating w/Out Charger	Battery Voltage & AH Rating Under Load	
12V 7AH				
Second Battery				
AC Power Supply Volts AC	DC Power Supply Volts DC	Load Test %	Battery w/Charger	Battery w/Out Charger
Battery Date	AC Loss Causes Trouble	DC Loss Causes Trouble	Battery Voltage & AH Rating	
	Yes	Yes	12V 7AH	
Battery Voltage AH Rating	Battery Voltage AH Rating w/Charger	Battery Voltage AH Rating w/Out Charger	Battery Voltage & AH Rating Under Load	
12V 7AH				
Comments				

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Civic Center
424 Hackensack Street
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Deficiencies - Fire Alarm


None

PURCHASE ORDER REQUISITION

VENDOR		DEPARTMENT	ACTIVITY	REQ. NO.
METRO FIRE 509 WASHINGTON AVE. CARLSTADT NJ 07072		Buildings & Grounds	OUTSIDE CONTRACTOR	59
		VENDOR NO	P.O. NO.	DATE 5/9/2022

ITEM	QUANTITY	DESCRIPTION	ACCOUNT	COST
1	1	FIRE ALARM INSPECTION	1-018-501- 20-55	295.00
2	1	12V7A 12 VOLT 7 AH		55.00
3		FUELD SURCHARGE		5.00
4		DATED 4/30//22 INV.#SM46282		
5		WASHINGTON AVE. FIREHOUSE		
6				
7				
8				
9				
10				
11				
12				
13				
14				
			TOTAL:	\$355.00

MAYOR/COMMISSIONER APPROVAL



 DATE SIGNATURE

BOROUGH OF CARLSTADT
 500 MADISON STREET
 CARLSTADT, NJ 07072

DEPARTMENTAL CERTIFICATION

5/9/2022

 DATE DEPARTMENT HEAD

CERTIFICATION OF FUNDS

 5/10/22

 DATE SIGNATURE
 CMFO TREASURER

MF METRO FIRE & SAFETY

EQUIPMENT CO., INC.

509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 46282

Invoice Date: 4/30/2022

Completion Date: 4/29/2022

Technician: Toro, Daniel

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt, NJ 07072

Division: Alarms - Service/Repair
Description: A-Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 5/10/2022

WO#	Item	Description	Qty	Unit Price	Amount
59049					
	Service				
		A - Fire Alarm Inspection	1.00	295.00	295.00
		(1) Ademco Vista-32FB fire alarm system			
		Note: Replaced battery for the FACP. (8) heat detectors need to be replaced			
		A - Fuel Surcharge	1.00	5.00	5.00
	Parts				
		12V7A 12 Volt 7 AH	1.00	55.00	55.00

The Fire Safety Professionals Since 1962

Subtotal:	355.00
Sales Tax:	0.00
Total Due:	355.00

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Inspection and Testing Form - Fire Alarm - Fail

Devices	Tested this Inspection	Pass	Fail	Tested YTD	Not Tested YTD	Total
Kitchen Suppression System	1	1	0	1	0	1
Bell	1	1	0	1	0	1
Horn	1	1	0	1	0	1
Smoke Detector	1	1	0	1	0	1
Heat Detector	8	0	8	8	0	8

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Monitoring Entity

Contact Name	Carlstadt PD
--------------	--------------

Approving Agency

Contact Name	N/A	Telephone	N/A
Email	N/A	Service Type	N/A

System Type

Control Unit Manufacturer	Ademco	Model Number	Vista-32FB
Circuit Styles	N/A	Software Revision	N/A
Date Last Serviced	2022-04-29	Last Date and Software or Configuration was Revised	N/A

Power Supply

Main Nominal Voltage	120VAC	Main Nominal Amps	N/A
Overcurrent Protection	N/A	Panel Board Location	N/A
Disconnecting Means Location	N/A	Secondary Standby	N/A
Storage Battery: Amp Hour Rating	7AH	Calculated Capacity to operate system (Hours)	N/A
Engine-driven generator dedicated to fire alarm system	N/A	Location of fuel storage	N/A
Has Emergency System described in NFPA 70, Article 700	N/A	Has Legally required standby described in NFPA 70, Article 701	N/A
Has Optional standby system described in NFPA 70, Article 702, which also meets the performance requirements of Article 700 or 701	N/A		

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



NOTIFICATIONS MADE PRIOR TO ANY TESTING		Yes	No	N/A	Who	Time
AHJ Notified of Any Impairments		☐	☐	☒		
Building Occupants		☒	☐	☐		
Building Management		☒	☐	☐		
Monitoring Entity		☒	☐	☐	Carlstadt PD	
Other (Specify)		☐	☐	☒		
SYSTEM TESTS AND INSPECTIONS	Visual	Functional	Pass/Fail	Comments		
MNS to Fire Alarm Interface	N/A	N/A	N/A			
Disconnect Switches	N/A	N/A	N/A			
System Intelligibility - CSI	N/A	N/A	N/A			
Sound Pressure Level- Ambient	N/A	N/A	N/A			
Isolation Modules	N/A	N/A	N/A			
Power Extender Panels	N/A	N/A	N/A			
Software Backup Performed	N/A	N/A	N/A			
Functional Test	Yes	Yes	Pass			
Sound Pressure Level- Alarm	N/A	N/A	N/A			
MNS to direct recipient MNS	N/A	N/A	N/A			
Fuses	N/A	N/A	N/A			
System Intelligibility - STI	N/A	N/A	N/A			
Control Unit	Yes	Yes	Pass			
Other (Specify)	N/A	N/A	N/A			
Supervision	N/A	N/A	N/A			
Remote Annunciator	Yes	Yes	Pass			
Local Annunciator	N/A	N/A	N/A			
Fire Alarm to MNS Interface	N/A	N/A	N/A			
Primary Power Supply	Yes	Yes	Pass			
UPS Power Test	N/A	N/A	N/A			
Reset/Power down Test	Yes	Yes	Pass			
Interface Equipment	N/A	N/A	N/A			

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Test Backup Software	N/A	N/A	N/A	
Lamps/LEDs	Yes	Yes	Pass	
Prerecorded Message Content	N/A	N/A	N/A	
Ground-Fault Monitoring	N/A	N/A	N/A	
In-building MNS to wide area MNS	N/A	N/A	N/A	
Prerecorded Message Activation	N/A	N/A	N/A	
Trouble Signals	Yes	Yes	Pass	
CCU Security Mechanism	N/A	N/A	N/A	
SECONDARY POWER	Visual	Functional	Pass/Fail	Comments
Charger Test	N/A	N/A	N/A	
Load Voltage	Yes	Yes	Pass	
Remote Annunciators	N/A	N/A	N/A	
Battery Condition	Yes	Yes	Pass	
Discharge Test	Yes	Yes	Pass	
Transient Suppressors	N/A	N/A	N/A	
NOTIFICATION APPLIANCES	Visual	Functional	Pass/Fail	Comments
Audible	Yes	Yes	Pass	
Speakers	N/A	N/A	N/A	
Visual	N/A	N/A	N/A	
Voice Clarity	N/A	N/A	N/A	
EMERGENCY COMMUNICATION EQUIPMENT	Visual	Functional	Pass/Fail	Comments
Phone Jacks	N/A	N/A	N/A	
Elevator Emergency Communication System	N/A	N/A	N/A	
Radio Communication Enhancement System	N/A	N/A	N/A	
Other (Specify)	N/A	N/A	N/A	
System Performance	N/A	N/A	N/A	
System Audibility	N/A	N/A	N/A	
Call-in Signal	N/A	N/A	N/A	

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Amplifier(s)	N/A	N/A	N/A		
Area of Refuge Communication System	N/A	N/A	N/A		
Tone Generator(s)	N/A	N/A	N/A		
System Intelligibility	N/A	N/A	N/A		
Off-Hook Indicator	N/A	N/A	N/A		
Phone Set	N/A	N/A	N/A		
AUXILIARY FUNCTIONS/INTERFACE EQUIPMENT/SPECIAL HAZARDS	Visual	Functional	Pass/Fail	Comments	
Fan Shutdown	N/A	N/A	N/A		
Smoke Shutter Release	N/A	N/A	N/A		
MNS Override of FA signals	N/A	N/A	N/A		
Smoke Damper Operation	N/A	N/A	N/A		
Door Unlocking	N/A	N/A	N/A		
Smoke Management/Smoke Control	N/A	N/A	N/A		
Elevator Shunt-Trip	N/A	N/A	N/A		
Other (Specify)	N/A	N/A	N/A		
Door-Releasing Devices	N/A	N/A	N/A		
Elevator Recall	N/A	N/A	N/A		
SUPERVISING STATION MONITORING	Yes	No	N/A	Who	Time
Alarm Restoration	☐	☐	☒		
Supervisory Signal	☐	☐	☒		
Trouble Restoral	☐	☐	☒		
Trouble Signals	☐	☐	☒		
Supervisory Restoration	☐	☐	☒		
Alarm Signal	☐	☐	☒		
NOTIFICATIONS THAT TESTING IS COMPLETE	Yes	No	N/A	Who	Time
Building Management	☒	☐	☐		
Building Occupants	☒	☐	☐		
AHJ Notified of Any Impairments	☐	☐	☒		

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Monitoring Agency	☒	☐	☐	Carlstadt PD	
Other (Specify)	☐	☐	☒		

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1

460 Washington Avenue

Carlstadt NJ 07072

Paul 2019392857

Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety

P00111

509 Washington Ave

Carlstadt NJ 07072

201-635-0400

reports@metrofire.com



INITIATING, SUPERVISORY, AND NOTIFICATION DEVICE TESTS AND INSPECTIONS

Address	Location	Device Type	Factory Setting	Measured Setting	Visual	Functional	Pass/Fail
	Outside	Bell			Yes	Yes	Pass (2022-04-29)
	Front of bar	Smoke Detector			Yes	Yes	Pass (2022-04-29)
	Kitchen	Heat Detector			Yes	No	Fail (2022-04-29)
	Boiler room	Heat Detector			Yes	No	Fail (2022-04-29)
	Ladies' room	Heat Detector			Yes	No	Fail (2022-04-29)
	Men's room	Heat Detector			Yes	No	Fail (2022-04-29)
	By bathrooms	Kitchen Suppression System			Yes	No	Pass (2022-04-29)
	Garage	Heat Detector			Yes	No	Fail (2022-04-29)
	Garage	Heat Detector			Yes	No	Fail (2022-04-29)
	Garage	Heat Detector			Yes	No	Fail (2022-04-29)
	Garage	Heat Detector			Yes	No	Fail (2022-04-29)
	Above FACP	Horn			Yes	Yes	Pass (2022-04-29)

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Control Panel and Battery Readings

Location: Boiler room				
Manufacturer: Ademco				
Model: Vista-32FB				
AC Power Supply Volts AC	DC Power Supply Volts DC	Load Test %	Battery w/Charger	Battery w/Out Charger
120VAC	24VDC			
Battery Date	AC Loss Causes Trouble	DC Loss Causes Trouble	Battery Voltage & AH Rating	Ground Fault
	Yes	Yes	12V 7AH	
Battery Voltage AH Rating	Battery Voltage AH Rating w/Charger	Battery Voltage AH Rating w/Out Charger	Battery Voltage & AH Rating Under Load	
12V 7AH				
Comments				
Reset code 1234				

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1

460 Washington Avenue

Carlstadt NJ 07072

Paul 2019392857

Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety

P00111

509 Washington Ave

Carlstadt NJ 07072

201-635-0400

reports@metrofire.com



Questions with Photos and Notes

Kitchen Suppression System - By bathrooms -



Report of Inspection / Test

Annual NFPA 72-13



2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com


Deficiencies - Fire Alarm

Heat Detector - Garage -

Status: Fail

Notes:

Device is outdated, must be replaced.

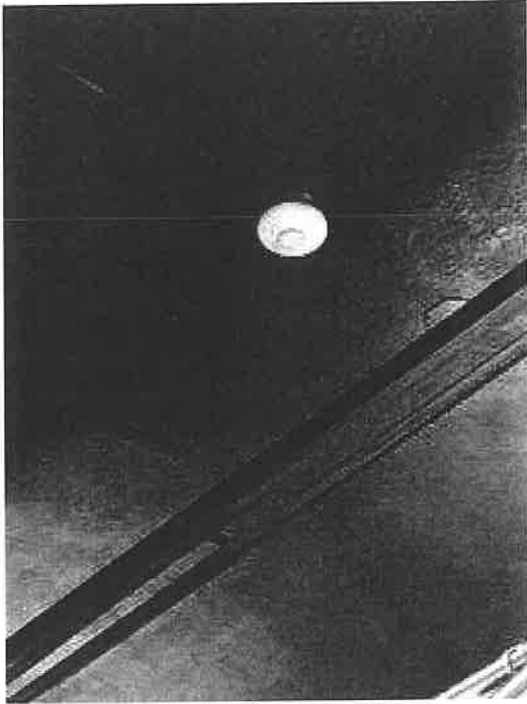

Heat Detector - Garage -

Status: Fail

Notes:

Device is outdated, must be replaced.

Report of Inspection / Test

Annual NFPA 72-13




2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com

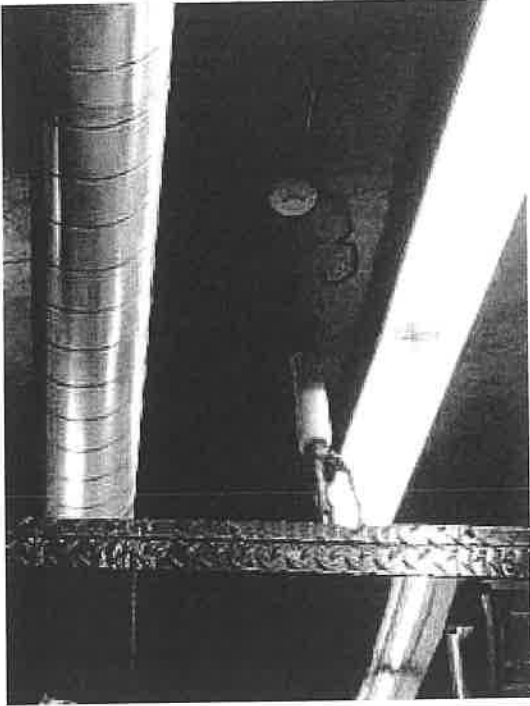

Heat Detector - Garage -

Status: Fail

Notes:

Device is outdated, must be replaced.

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Heat Detector - Garage -

Status: Fail

Notes:

Device is outdated, must be replaced.

Report of Inspection / Test

Annual NFPA 72-13


2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com

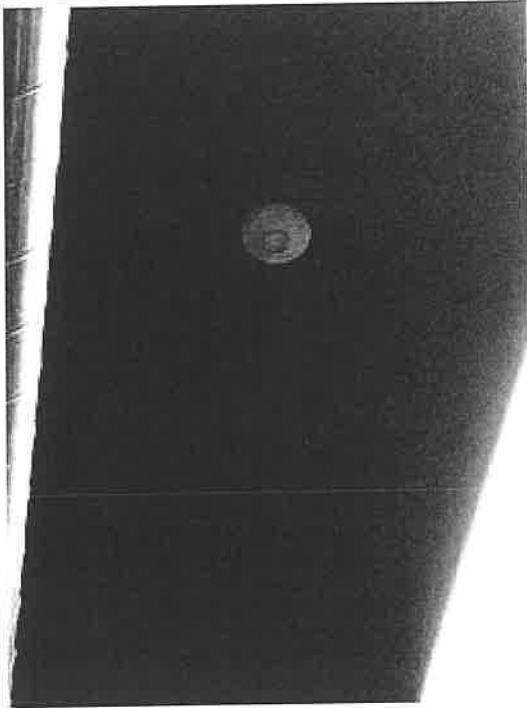

Heat Detector - Men's room -

Status: Fail

Notes:

Device is outdated, must be replaced.

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1

460 Washington Avenue

Carlstadt NJ 07072

Paul 2019392857

Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety


P00111

509 Washington Ave

Carlstadt NJ 07072

201-635-0400

reports@metrofire.com

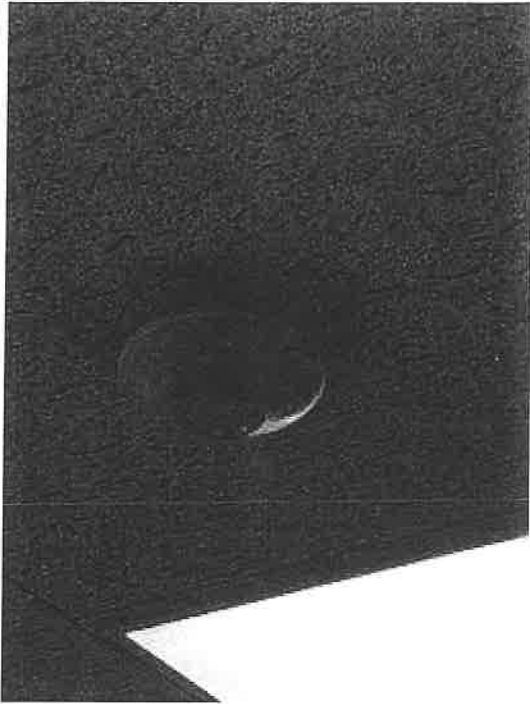

Heat Detector - Ladies' room -

Status: Fail

Notes:

Device is outdated, must be replaced.

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Heat Detector - Boiler room -

Status: Fail

Notes:

Device is outdated, must be replaced.

Report of Inspection / Test

Annual NFPA 72-13



2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



Heat Detector - Kitchen -

Status: Fail

Notes:

Device is outdated, must be replaced.

Report of Inspection / Test

Annual NFPA 72-13

2022-04-29

Property

Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt NJ 07072
Paul 2019392857
Print Date: 2022-05-02

Conducted by: Alarm_1

Metro Fire & Safety
P00111
509 Washington Ave
Carlstadt NJ 07072
201-635-0400
reports@metrofire.com



**BOROUGH OF CARLSTADT**

500 MADISON STREET • P.O. BOX 466

CARLSTADT, N.J. 07072

(201) 939-2850

PURCHASE ORDERTHIS NUMBER MUST APPEAR ON ALL INVOICES,
PACKING LISTS, CORRESPONDENCE, ETC.

No. 23-00221

ORDER DATE 01/27/23
REQUISITION NO
DELIVERY DATE
STATE CONTRACT NO
F O B TERMS

PAYMENT RECORD

CHECK NO. 18853	CHECK DATE 2/15/23
VOUCHER NO.	VENDOR INV #

SHIP TO

VENDOR

VENDOR # MET16
METRO FIRE & SAFETY EQUIP, INC
509 WASHINGTON AVE.
MIJACK COURT
CARLSTADT NJ 07072BILLS ARE APPROVED AT BOROUGH COUNCIL MEETINGS ON 3RD MONDAY OF EACH MONTH
AND MUST BE RENDERED NO LATER THAN THE WEDNESDAY PRECEDING THE MEETING.

QUANTITY/UNIT	DESCRIPTION	ACCOUNT NO.	UNIT PRICE	TOTAL COST
1.00	SERVICE REPAIR EXTINGUISHERS	3-01-26-310-248	381.9500	381.95
			TOTAL	381.95

TAX EXEMPTION NO. 22-600-1704

CLAIMANT'S CERTIFICATION & DECLARATION

I do solemnly declare and certify under the penalties of the law that the within bill is correct in all its particulars; that the articles have been furnished or services rendered as stated therein; that no bonus has been given or received by any person or persons within the knowledge of this claimant in connection with the above claim; that the amount therein stated is justly due and owing; and that the amount charged is a reasonable one.

X *Kira Espinal*
SIGNATURE OF VENDOR2/1/23 Receptionist
DATE OFFICIAL POSITION22-383651
FEDERAL ID NO. or SOCIAL SECURITY NO.

APPROVAL FOR PAYMENT

DEPARTMENT COMMISSIONER

[Signature]

FINANCE COMMITTEE

FINANCE COMMITTEE

OFFICER'S OR EMPLOYEE'S CERTIFICATION

Having knowledge of the facts and in the course of regular procedures, I certify that the materials and supplies have been received or the services rendered; said certification based on delivery slips acknowledged by a municipal officer or employee or other reasonable procedures.

SIGNATURE

TITLE

APPROVAL TO PURCHASE

I hereby certify that funds are available and encumbered

SIGNATURE

TITLE

VOUCHER COPY - SIGN AT X AND RETURN TO CHIEF FINANCE OFFICER - SEE REVERSE SIDE



509 Washington Avenue
 Carlstadt, NJ 07072
 Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 53834

Invoice Date: 1/6/2023

Completion Date: 1/4/2023

Technician: Butruk;Anthony

Bill To: Carlstadt Borough Hall
 500 Madison Street
 Attn: Paul Richie
 Carlstadt, NJ 07072

Service At: Carlstadt Municipal, Police, & Fire Bldg.
 500 Madison Street
 Carlstadt, NJ 07072

Division: Extinguishers - Service/Repair
Description: E-Walk In

PO Number:
Alt #:

Terms: 10 Days
Due Date: 1/16/2023

WO#	Item	Description	Qty	Unit Price	Amount
67896					
	Service				
		E - Reconditioned P/W	1.00	100.00	100.00
		E - 10# ABC Dry Chem Hydro/Recharge	2.00	57.75	115.50
		E - 5# ABC Dry Chem 6 Year Tear Down	1.00	34.50	34.50
		E - 2.5# ABC Dry Chem Hydro/Recharge	1.00	35.50	35.50
		E - Fire Extinguisher Inspection	2.00	12.50	25.00
		E - 5# ABC Vehicle Bracket	1.00	15.00	15.00
		E - O-Ring	4.00	4.00	16.00
		E - VOS Collar	4.00	2.25	9.00
		E - UN 1044 Compliance Label	2.00	1.60	3.20
		E - Hose Strap Assembly	1.00	12.75	12.75
		E - Gauge	1.00	15.50	15.50

The Fire Safety Professionals Since 1962

Subtotal:	381.95
Sales Tax:	0.00
Total Due:	381.95



BOROUGH OF CARLSTADT
500 MADISON STREET
CARLSTADT
NJ, NJ 07072
Phone: (201)939-1779

SHIP TO**VENDOR**

Vendor #: MET16

METRO FIRE & SAFETY EQUIP, INC
509 WASHINGTON AVE.
MIJACK COURT
CARLSTADT, NJ 07072

VOUCHER

THIS NUMBER MUST APPEAR ON ALL INVOICES,
PACKING LISTS, CORRESPONDENCE, ETC.

NO. 23-00379

ORDER DATE: 02/27/23

DELIVERY DATE:

STATE CONTRACT:

PURCHASE TYPE:

VENDOR ACCT NUM:

VENDOR PHONE #: (201)635-0400

VENDOR FAX #:

REQUISITION #:

REQUISITION USER:

PAYMENT RECORD

CHECK NO. 18975

DATE PAID 3/6/23

QUANTITY	DESCRIPTION	ACCOUNT NO	UNIT PRICE	TOTAL
1.00	SERVICE & INSPECTION #SM 55179 #SM 55180 #SM 55181 #SM 55182 #SM 55183 #SM 55184 #SM 55185 #SM 55186	3-01-26-310-229 Alarm Maintenance	2,489.0000	2,489.00
			TOTAL	2,489.00

TAX EXEMPTION NO. 22-600-1704

CLAIMANT'S VERIFICATION & DECLARATION

I do solemnly declare and certify under the penalties of the law that the within bill is correct in all its particulars; that the articles have been furnished or services rendered as stated therein; that no bonus has been given or received by any person or persons within the knowledge of this claimant in connection with the above claim; that the amount therein stated is justly due and owing; and that the amount charged is a reasonable one.

X *Kira Espinal*
3/6/23
DATE
22 318 3651
FEDERAL I.D. NO. or SOCIAL SECURITY NO.

SIGNATURE OF VENDOR

OFFICIAL POSITION

APPROVAL FOR PAYMENT

DEPARTMENT COMMISSIONER

FINANCE COMMITTEE

FINANCE COMMITTEE

OFFICER'S OR EMPLOYEE'S CERTIFICATION

Having knowledge of the facts and in the course of regular procedures, I certify that the materials and supplied have been received or the services rendered; said certifications based on delivery slips acknowledged by a municipal office or employee or other reasonable procedures.

SIGNATURE

TITLE

APPROVAL TO PURCHASE

I HEREBY CERTIFY THAT FUNDS ARE AVAILABLE AND ENCUMBERED.

SIGNATURE

CFO

MF METRO FIRE & SAFETY

EQUIPMENT CO., INC.

509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

23 00379
Invoice #: SM 55179

Invoice Date: 2/15/2023

Completion Date: 2/14/2023

Technician: Meyers; Ronald

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt Ambulance Corps.
424 Hackensack Street
Carlstadt, NJ 07072

Division: Extinguishers - Service/Repair
Description: E-Extinguisher Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 2/25/2023

WO#	Item	Description	Qty	Unit Price	Amount
68573					
	Service				
		E - Fire Extinguisher Inspection	4.00	6.50	26.00
		E - 10# ABC Dry Chem 6 Year Tear Down	2.00	46.50	93.00
		E - O-Ring	2.00	4.00	8.00
		E - VOS Collar	2.00	2.25	4.50
		E - Hazmat Transportation	1.00	15.00	15.00
	Parts				
		15310 FE B402T New 5# ABC Dry Chemical	2.00	78.25	156.50

Met 14
Fire Extinguisher
service: 11/5/22
2-01-26310-229

The Fire Safety Professionals Since 1962

Subtotal:	303.00
Sales Tax:	0.00
Total Due:	303.00

MF METRO FIRE & SAFETY

EQUIPMENT CO., INC.

509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 55180

Invoice Date: 2/15/2023

Completion Date: 2/14/2023

Technician: Meyers;Ronald

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt Civic Center
424 Hackensack Street
Carlstadt, NJ 07072

Division: Extinguishers - Service/Repair
Description: E-Extinguisher Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 2/25/2023

WO#	Item	Description	Qty	Unit Price	Amount
68569					
	Service				
		E - 10# ABC Dry Chem 6 Year Tear Down	2.00	46.50	93.00
		E - O-Ring	2.00	4.00	8.00
		E - VOS Collar	2.00	2.25	4.50
		E - Hazmat Transportation	1.00	15.00	15.00

The Fire Safety Professionals Since 1962

Subtotal:	120.50
Sales Tax:	0.00
Total Due:	120.50



509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 55181

Invoice Date: 2/15/2023

Completion Date: 2/14/2023

Technician: Meyers;Ronald

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt D.P.W.
105 Kero Road
Carlstadt, NJ 07072

Division: Extinguishers - Service/Repair
Description: E-Extinguisher Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 2/25/2023

WO#	Item	Description	Qty	Unit Price	Amount
68574					
	Service				
		E - Fire Extinguisher Inspection	26.00	6.50	169.00
		E - 10# ABC Dry Chem 6 Year Tear Down	1.00	46.50	46.50
		E - 10# ABC Dry Chem Hydro/Recharge	1.00	57.75	57.75
		E - O-Ring	2.00	4.00	8.00
		E - VOS Collar	2.00	2.25	4.50
		E - Hazmat Transportation	1.00	15.00	15.00
	Parts				
		01714 FE 330 New 10# Carbon Dioxide	1.00	365.75	365.75

The Fire Safety Professionals Since 1962

Subtotal:	666.50
Sales Tax:	0.00
Total Due:	666.50

MF METRO FIRE & SAFETY

EQUIPMENT CO., INC.

509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 55182

Invoice Date: 2/15/2023

Completion Date: 2/14/2023

Technician: Meyers;Ronald

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt Fire House # 1
460 Washington Avenue
Carlstadt, NJ 07072

Division: Extinguishers - Service/Repair
Description: E-Extinguisher Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 2/25/2023

WO#	Item	Description	Qty	Unit Price	Amount
<u>68575</u>					
	Service				
		E - Fire Extinguisher Inspection	3.00	6.50	19.50
		E - 2.5 Gal Water Recharge	1.00	14.00	14.00
		E - 6L Wet Chem Hydro/Recharge	1.00	105.00	105.00
		E - Wet Chem Valve Rebuilt	1.00	40.00	40.00
		E - O-Ring	1.00	4.00	4.00
		E - VOS Collar	2.00	2.25	4.50
		E - Hazmat Transportation	1.00	15.00	15.00

The Fire Safety Professionals Since 1962

Subtotal:	202.00
Sales Tax:	0.00
Total Due:	202.00



509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 55183

Invoice Date: 2/15/2023

Completion Date: 2/14/2023

Technician: Meyers;Ronald

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt Lindbergh Field House
541 Lincoln Street
Carlstadt, NJ 07072

Division: Extinguishers - Service/Repair
Description: E-Extinguisher Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 2/25/2023

WO#	Item	Description	Qty	Unit Price	Amount
<u>68576</u>					
	Service				
		E - Fire Extinguisher Inspection	2.00	6.50	13.00
		E - 10# ABC Dry Chem Hydro/Recharge	1.00	57.75	57.75
		E - O-Ring	1.00	4.00	4.00
		E - VOS Collar	1.00	2.25	2.25
		E - Hazmat Transportation	1.00	15.00	15.00

The Fire Safety Professionals Since 1962

Subtotal:	92.00
Sales Tax:	0.00
Total Due:	92.00



509 Washington Avenue
Carlstadt, NJ 07072
Phone: (201) 635-0400 - Fax: (201) 635-0410

Invoice #: SM 55184

Invoice Date: 2/15/2023

Completion Date: 2/14/2023

Technician: Meyers;Ronald

Bill To: Carlstadt Borough Hall
500 Madison Street
Attn: Paul Richie
Carlstadt, NJ 07072

Service At: Carlstadt Little League Field
9th Street
Carlstadt, NJ 07072

Division: Extinguishers - Service/Repair
Description: E-Extinguisher Inspection Needed

PO Number:
Alt #:

Terms: 10 Days
Due Date: 2/25/2023

WO#	Item	Description	Qty	Unit Price	Amount
68577					
	Service				
		E - Fire Extinguisher Inspection	1.00	6.50	6.50
		E - 10# ABC Dry Chem 6 Year Tear Down	2.00	46.50	93.00
		E - 6L Wet Chem Hydro/Recharge	1.00	105.00	105.00
		E - Wet Chem Valve Rebuilt	1.00	40.00	40.00
		E - O-Ring	2.00	4.00	8.00
		E - VOS Collar	3.00	2.25	6.75
		E - Hazmat Transportation	1.00	15.00	15.00

The Fire Safety Professionals Since 1962

Subtotal:	274.25
Sales Tax:	0.00
Total Due:	274.25